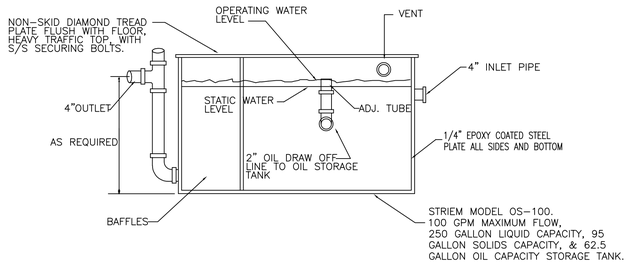

1 DETAIL - OIL SEPARATOR
Scale: No Scale

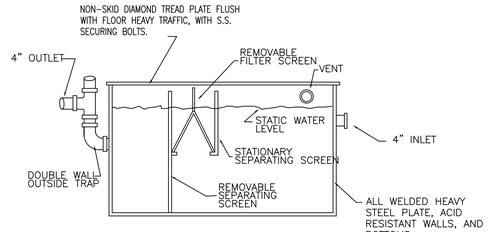

2 DETAIL - GREASE TRAP
Scale: No Scale

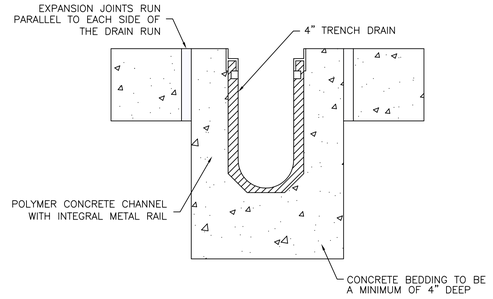

3 DETAIL - TRENCH DRAIN INSTALLATION IN CONCRETE
Scale: No Scale



4 DETAIL - HUB DRAIN
Scale: No Scale

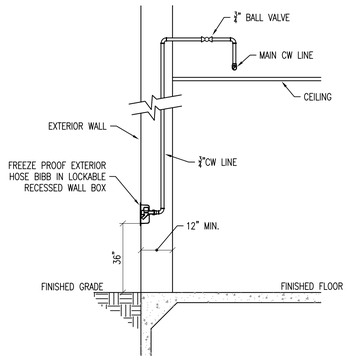

5 DETAIL - FREEZE PROOF HOSE BIBB
Scale: No Scale

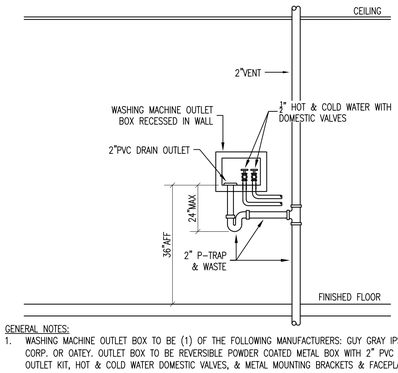

GENERAL NOTES:
1. WASHING MACHINE OUTLET BOX TO BE (1) OF THE FOLLOWING MANUFACTURERS: GUY GRAY IPS CORP. OR OATEY. OUTLET BOX TO BE REVERSIBLE POWDER COATED METAL BOX WITH 2" PVC DRAIN OUTLET KIT, HOT & COLD WATER DOMESTIC VALVES, & METAL MOUNTING BRACKETS & FACEPLATE

6 DETAIL - WASHING MACHINE OUTLET BOX
Scale: No Scale

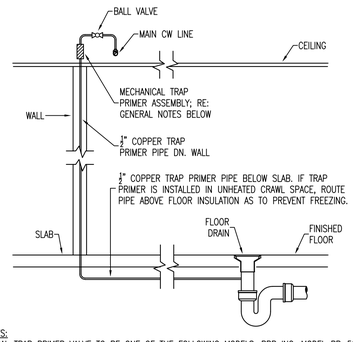

GENERAL NOTES:
1. MECHANICAL TRAP PRIMER VALVE TO BE ONE OF THE FOLLOWING MODELS: PPP INC. MODEL PR-500 WITH MODEL AG-500 AIR GAP FITTING & MODEL DU-4 DISTRIBUTION UNIT OR MIFAB MODEL M-500 WITH MODEL MI-GAP AIR GAP FITTING & MODEL MI-DU DISTRIBUTION UNIT. THE DISTRIBUTION UNIT TO BE PROVIDED AS REQUIRED TO SERVE MULTIPLE DRAINS.
2. (1) MECHANICAL TRAP PRIMER CAN SERVE UP TO (4) INDIVIDUAL DRAINS.
3. IF MECHANICAL TRAP PRIMER IS INSTALLED IN INACCESSIBLE AREA, SUCH AS WITHIN WALL CAVITY OR ABOVE GYPSUM BOARD CEILING, AN ACCESS PANEL OR RECESSED WALL BOX SHALL BE INSTALLED TO ALLOW FOR SERVE TO MECHANICAL TRAP PRIMER VALVE. MECHANICAL TRAP PRIMER SHALL BE INSTALLED A MINIMUM OF 12" A.F.F.
4. ALL COPPER BELOW SLAB SHALL BE SOFT DRAWN WITH NO JOINTS. ALL COPPER PIPING ABOVE SLAB SHALL BE HARD DRAWN COPPER.

7 DETAIL - MECHANICAL TRAP PRIMER
Scale: No Scale

THOMPSON LUKE & ASSOCIATES, L.L.C.
10705 RIEGER RD., STE 101
BATON ROUGE, LA 70809
(225)293-9474 TLA PROJECT #25-035
Frank Saville Thompson - License No. 28854
Landon David Burns - License No. 46484

Stantec
Stantec (Formerly Bradley-Blewster & Associates)
1200 Bickyard Lane, Suite 400
Baton Rouge, LA 70802
Tel: 225-765-7400
www.stantec.com
Copyright Reserved
The Contractor shall verify and be responsible for all dimensions. DO NOT scale the Drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

Consultant

Revision	By	Appd	YYYY.MM.DD

Design Phase Acceptance

Permit/Seal

STATE OF LOUISIANA
FRANK S. THOMPSON
REG. NO. 28854
PROFESSIONAL ENGINEER IN MECHANICAL ENGINEERING

Client/Project
CITY OF NATCHITOCHES
NEW FIRE STATION NO. 3
NATCHITOCHES, LOUISIANA

Project No.: 222706059
File Name: 25-035 PLUMB - USE THIS ONE_RECOVER
Scale:

Dwn.	Dsgn.	Chkd.	2025.09.26 YYYY.MM.DD

Title
PLUMBING DETAILS

Revision: Sheet: 5 of 5
Drawing No. P301