
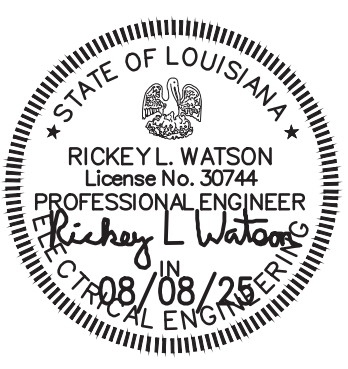


- ELECTRICAL NOTES:**
- E1 ALL EXIT/EMERGENCY LIGHTS SHALL BE ON UNSWITCHED CONDUCTORS.
 - E2 COORDINATE THE EXACT LOCATION OF ALL DEVICES, LIGHT FIXTURES, PANELS, ETC. WITH ARCHITECT PRIOR TO ROUGH-IN.
 - E3 COORDINATE CONTROL OF EXHAUST FAN WITH MECHANICAL PLANS. INTERLOCK MOTORIZED DAMPERS WITH EXHAUST FAN.

PANEL "A"									
120/240 VOLTS, 1 PHASE, 3 WIRE, 200 AMPS, MAIN CIRCUIT BREAKER									
10,000 AMPS. RMS. SYM. I.C. INTEGRATED EQUIPMENT RATING									
SERVES	TRIP								
INT. LIGHTS	20	1	A Ø	2	C Ø	2	TRIP	20	SERVES
EXT. LIGHTS	3	3		4		4		4	RECEPTS
RECEPTS	5	5		6		6		6	RECEPTS
EF-1	7	7		8		8		8	SPARE
DAMPER	9	9		10		10		10	
SPARE	11	11		12		12		12	
	13	13		14		14		14	
	15	15		16		16		16	
	17	17		18		18		18	
	19	19		20		20		20	
PROVISIONS	21	21		22		22		22	PROVISIONS
	23	23		24		24		24	
	25	25		26		26		26	
	27	27		28		28		28	
	29	29		30		30		30	
	31	31		32		32		32	
	33	33		34		34		34	
	35	35		36		36		36	
	37	37		38		38		38	
	39	39		40		40		40	
	41	41		42		42		42	
+ THRU PHOTOCELL ABOVE ROOF									
TOTAL CONN. LOAD _____ KVA									

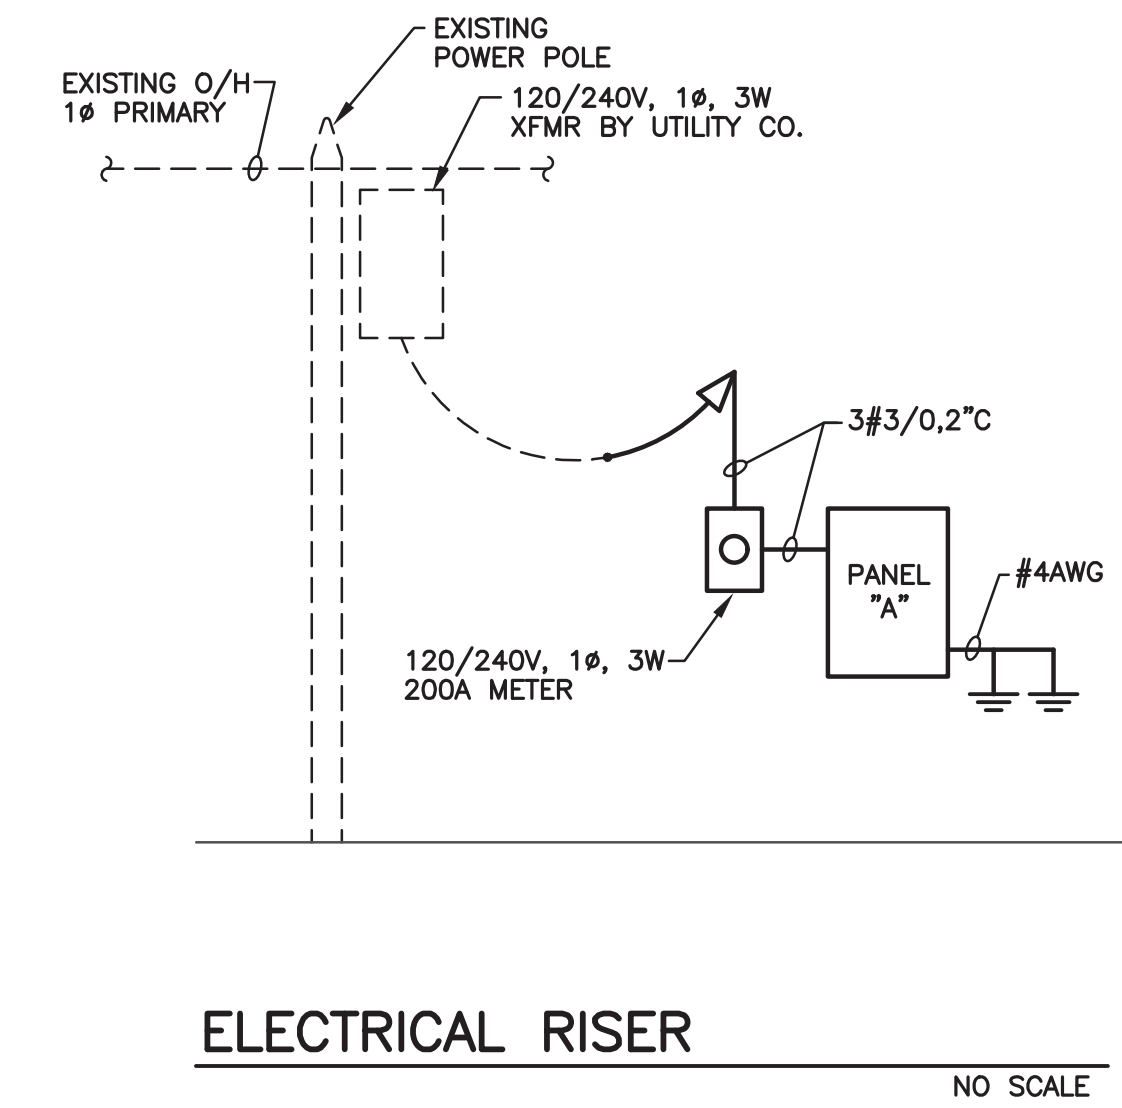

1439 Centre Ct., ste 401
Alexandria, LA 71301
Ph: 318.445.3151
F: 318.445.3988
Em: adg@adgllc.net

EMA Engineering & Consulting, Inc.
844 STEVENS ROAD, SUITE 200
SPRINGFIELD, MA 01108
318.425.4500
www.ema-engineering.com
DESIGN SOLVE ENHANCE
CONSULTANT (IF APPLICABLE)

PHASE 2 - RENOVATIONS TO
CARTER C. RAYMOND
JUNIOR HIGH SCHOOL
2510 SAINT CHARLES AVE, LECOMPT, LA 71346

PROJECT NO: RT
DRAWN: RW
CHECKED: 08.08.25
DATE: 08.08.25
LAST REV:

E-600
© 2008, Alliance Design Group, LLC all rights reserved