




1 Grade Beam Transition Detail
3/4" = 1'-0"

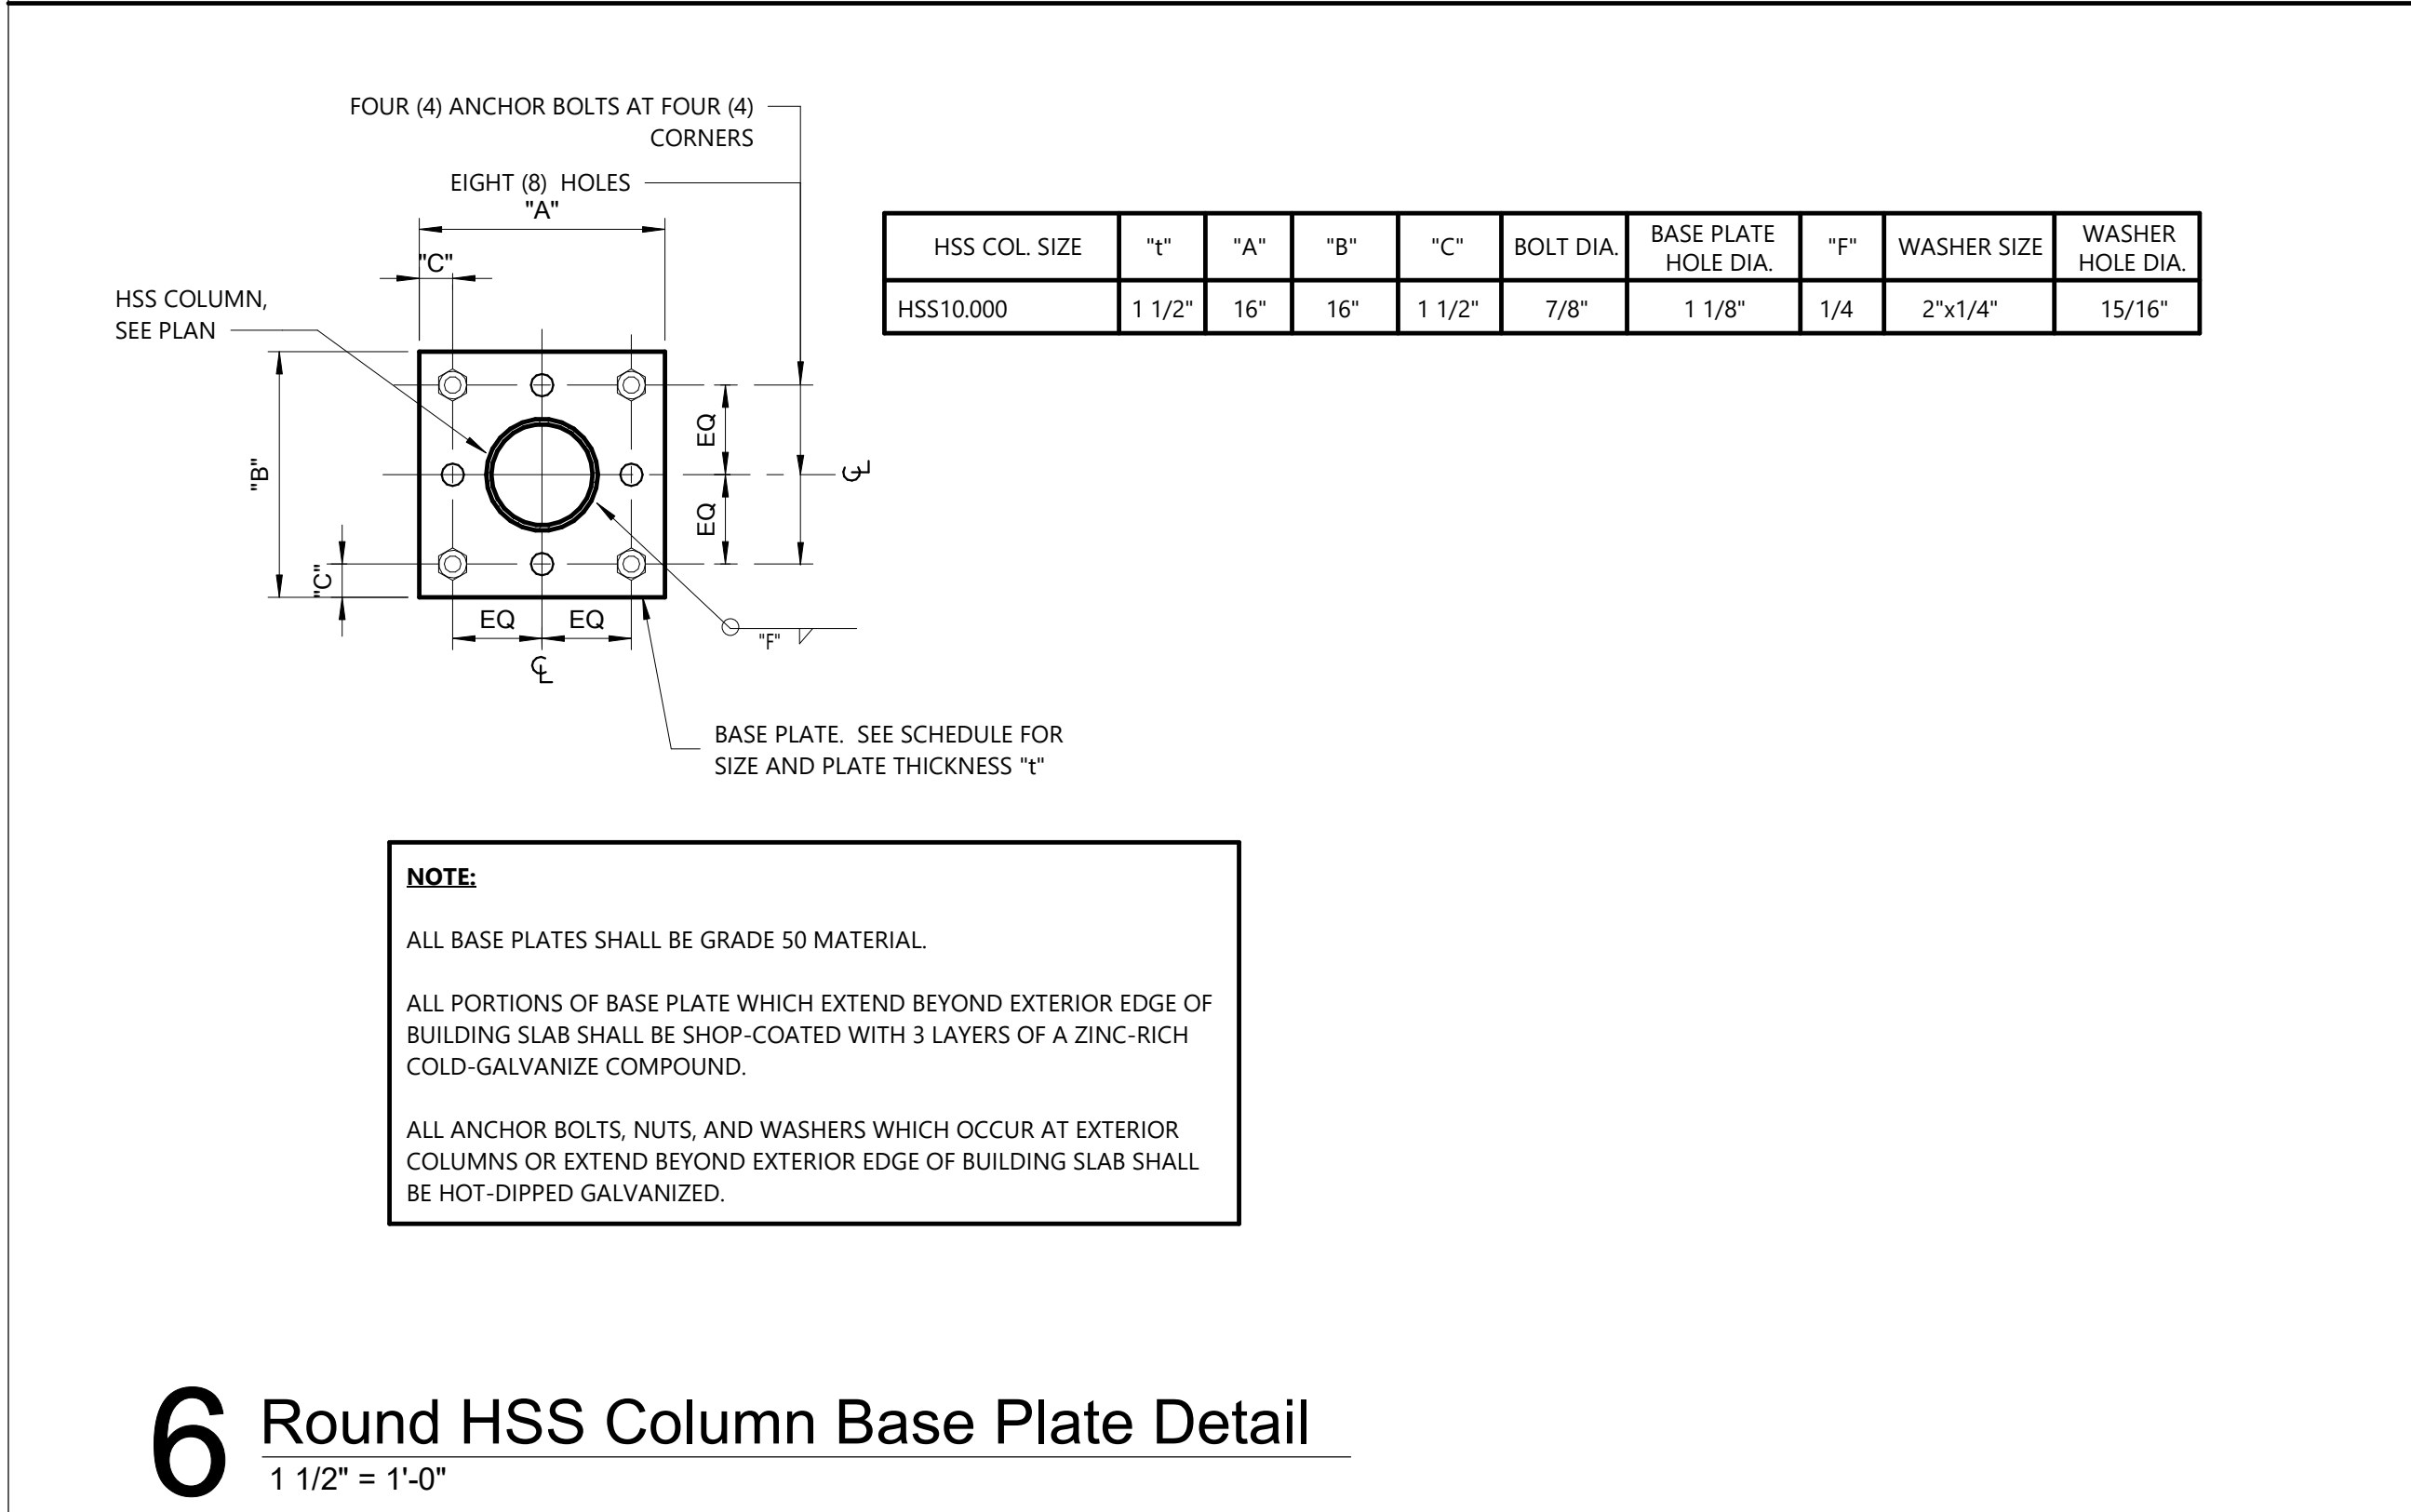


6 Round HSS Column Base Plate Detail
1 1/2" = 1'-0"

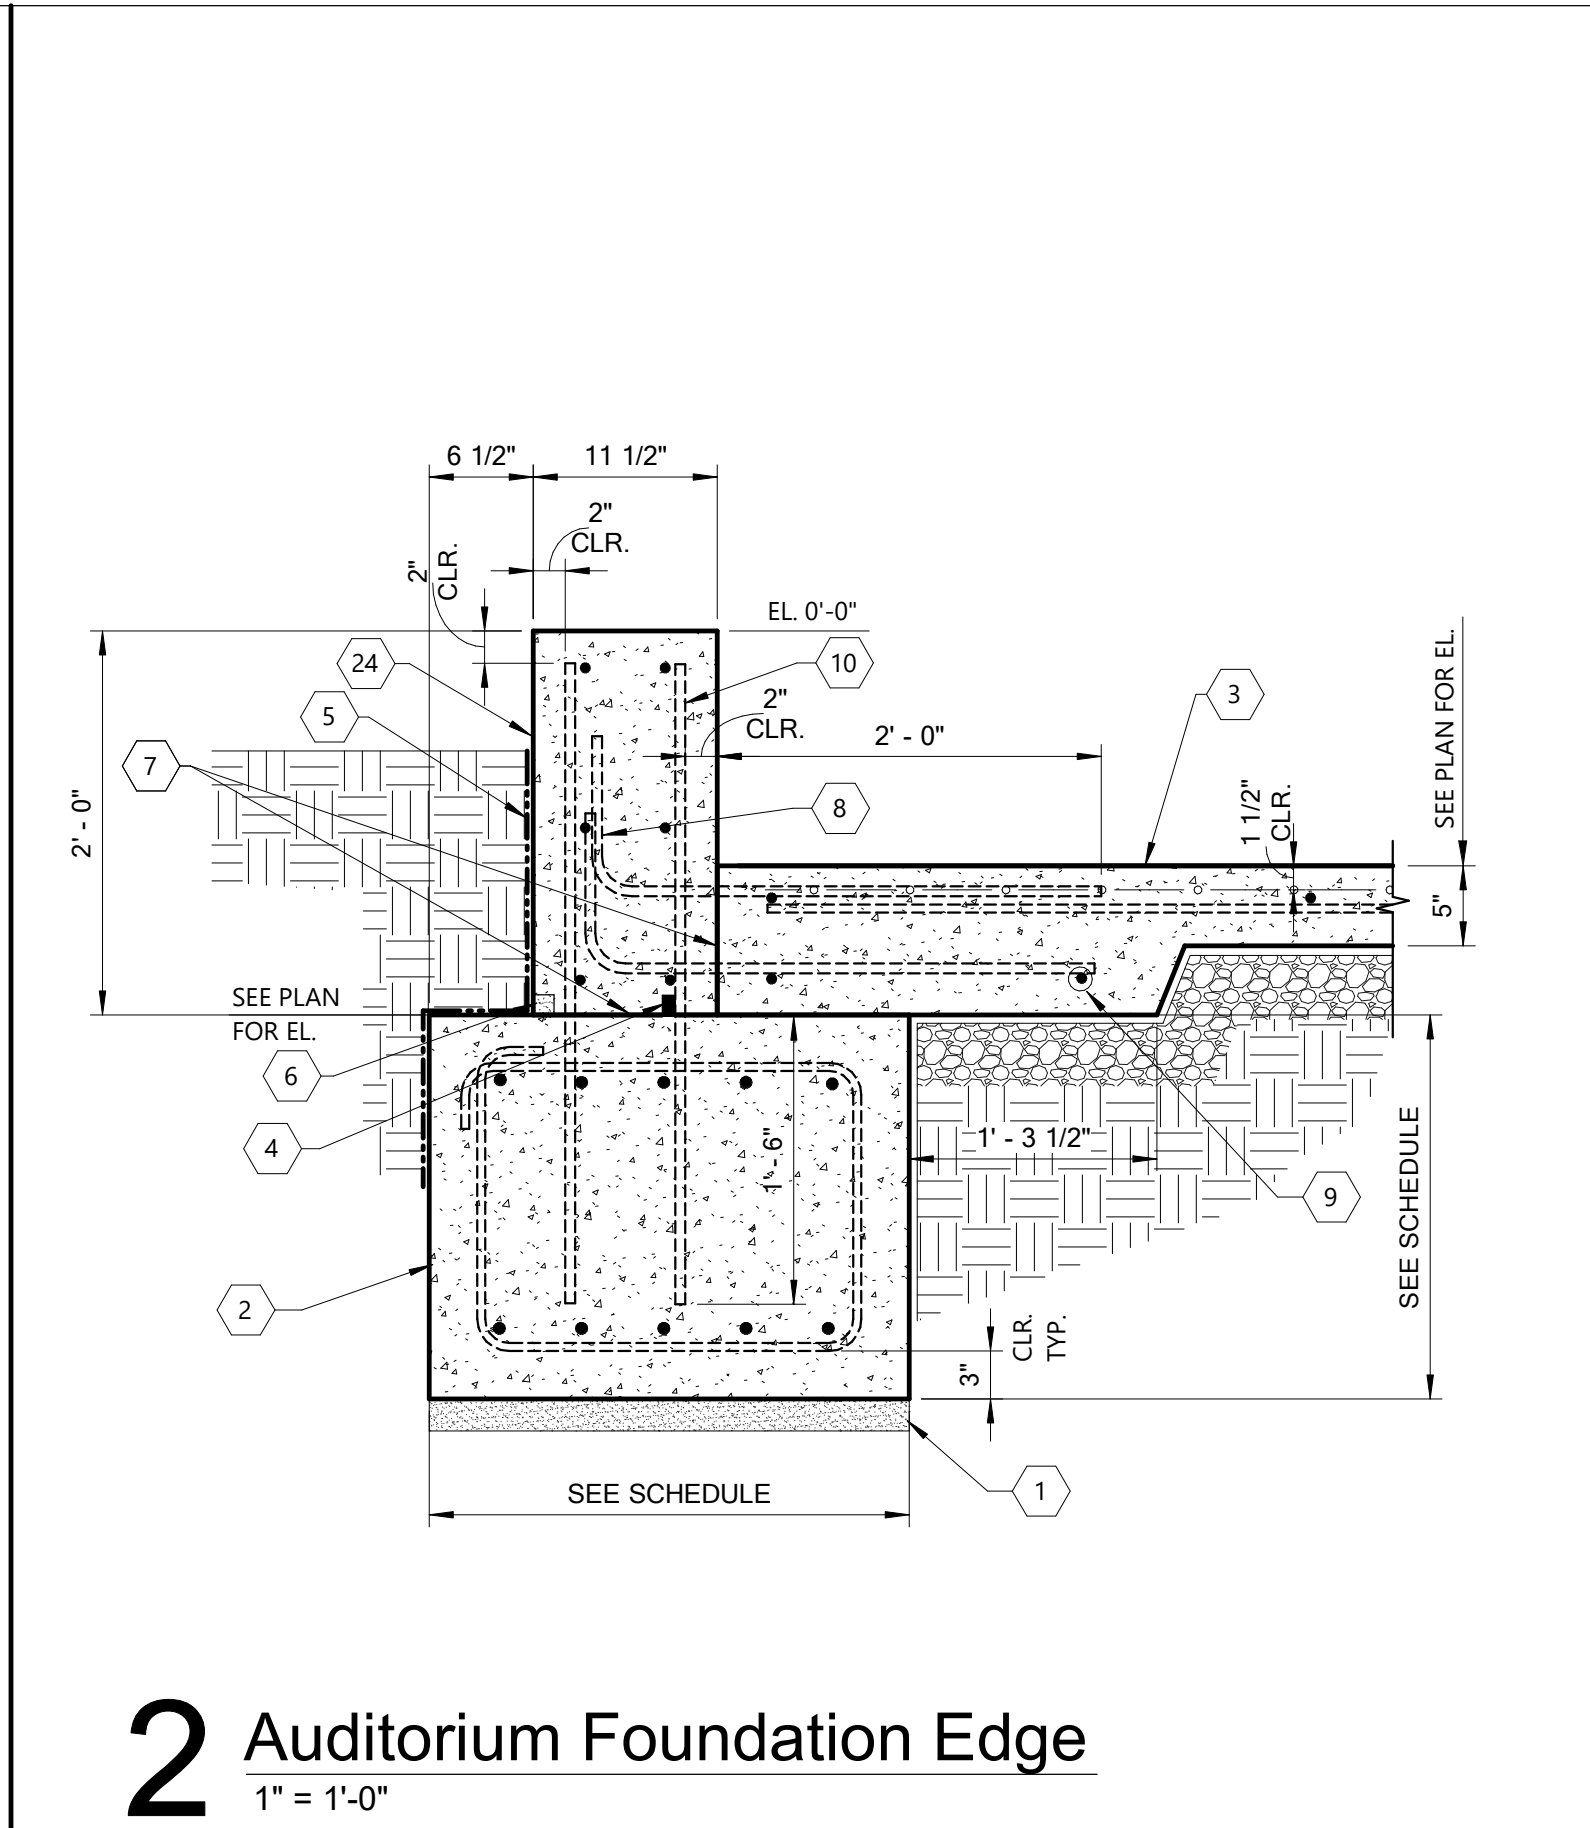


2 Auditorium Foundation Edge
1" = 1'-0"

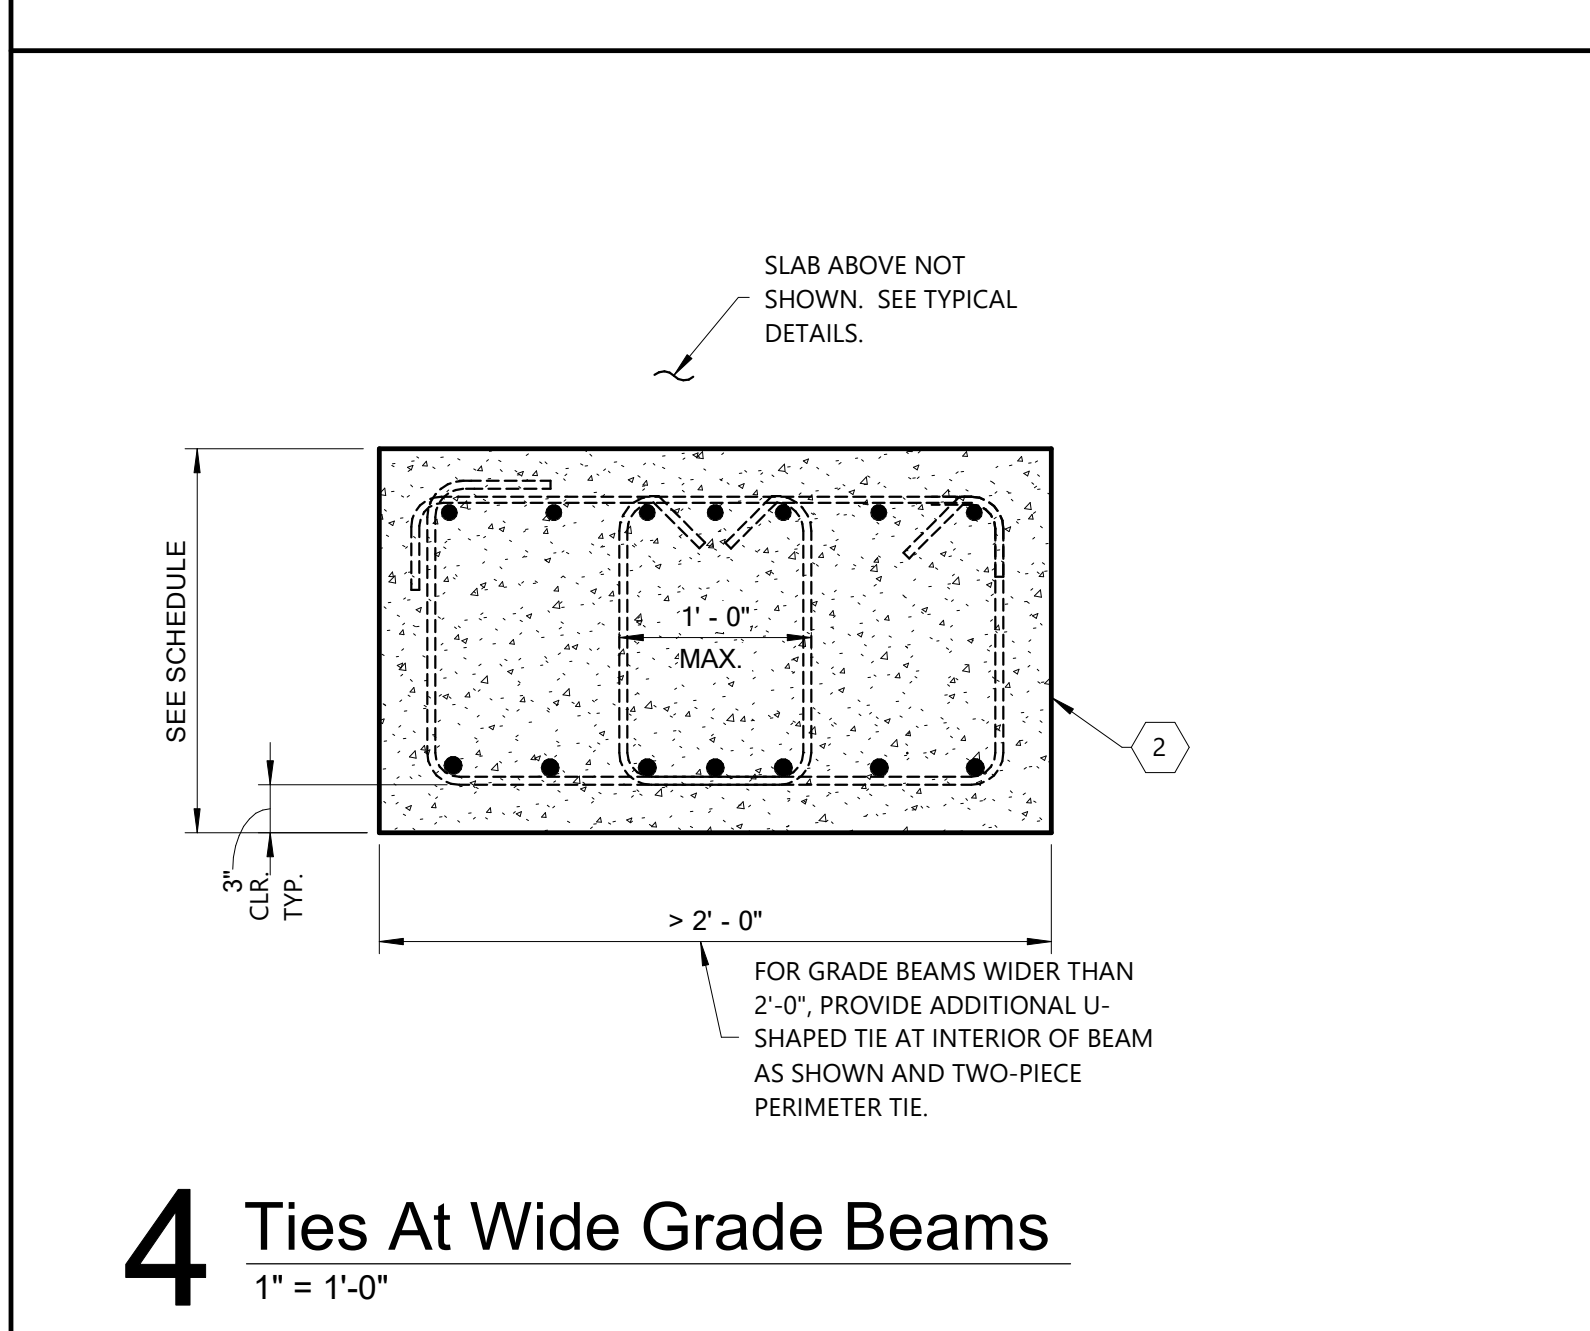


4 Ties At Wide Grade Beams
1" = 1'-0"

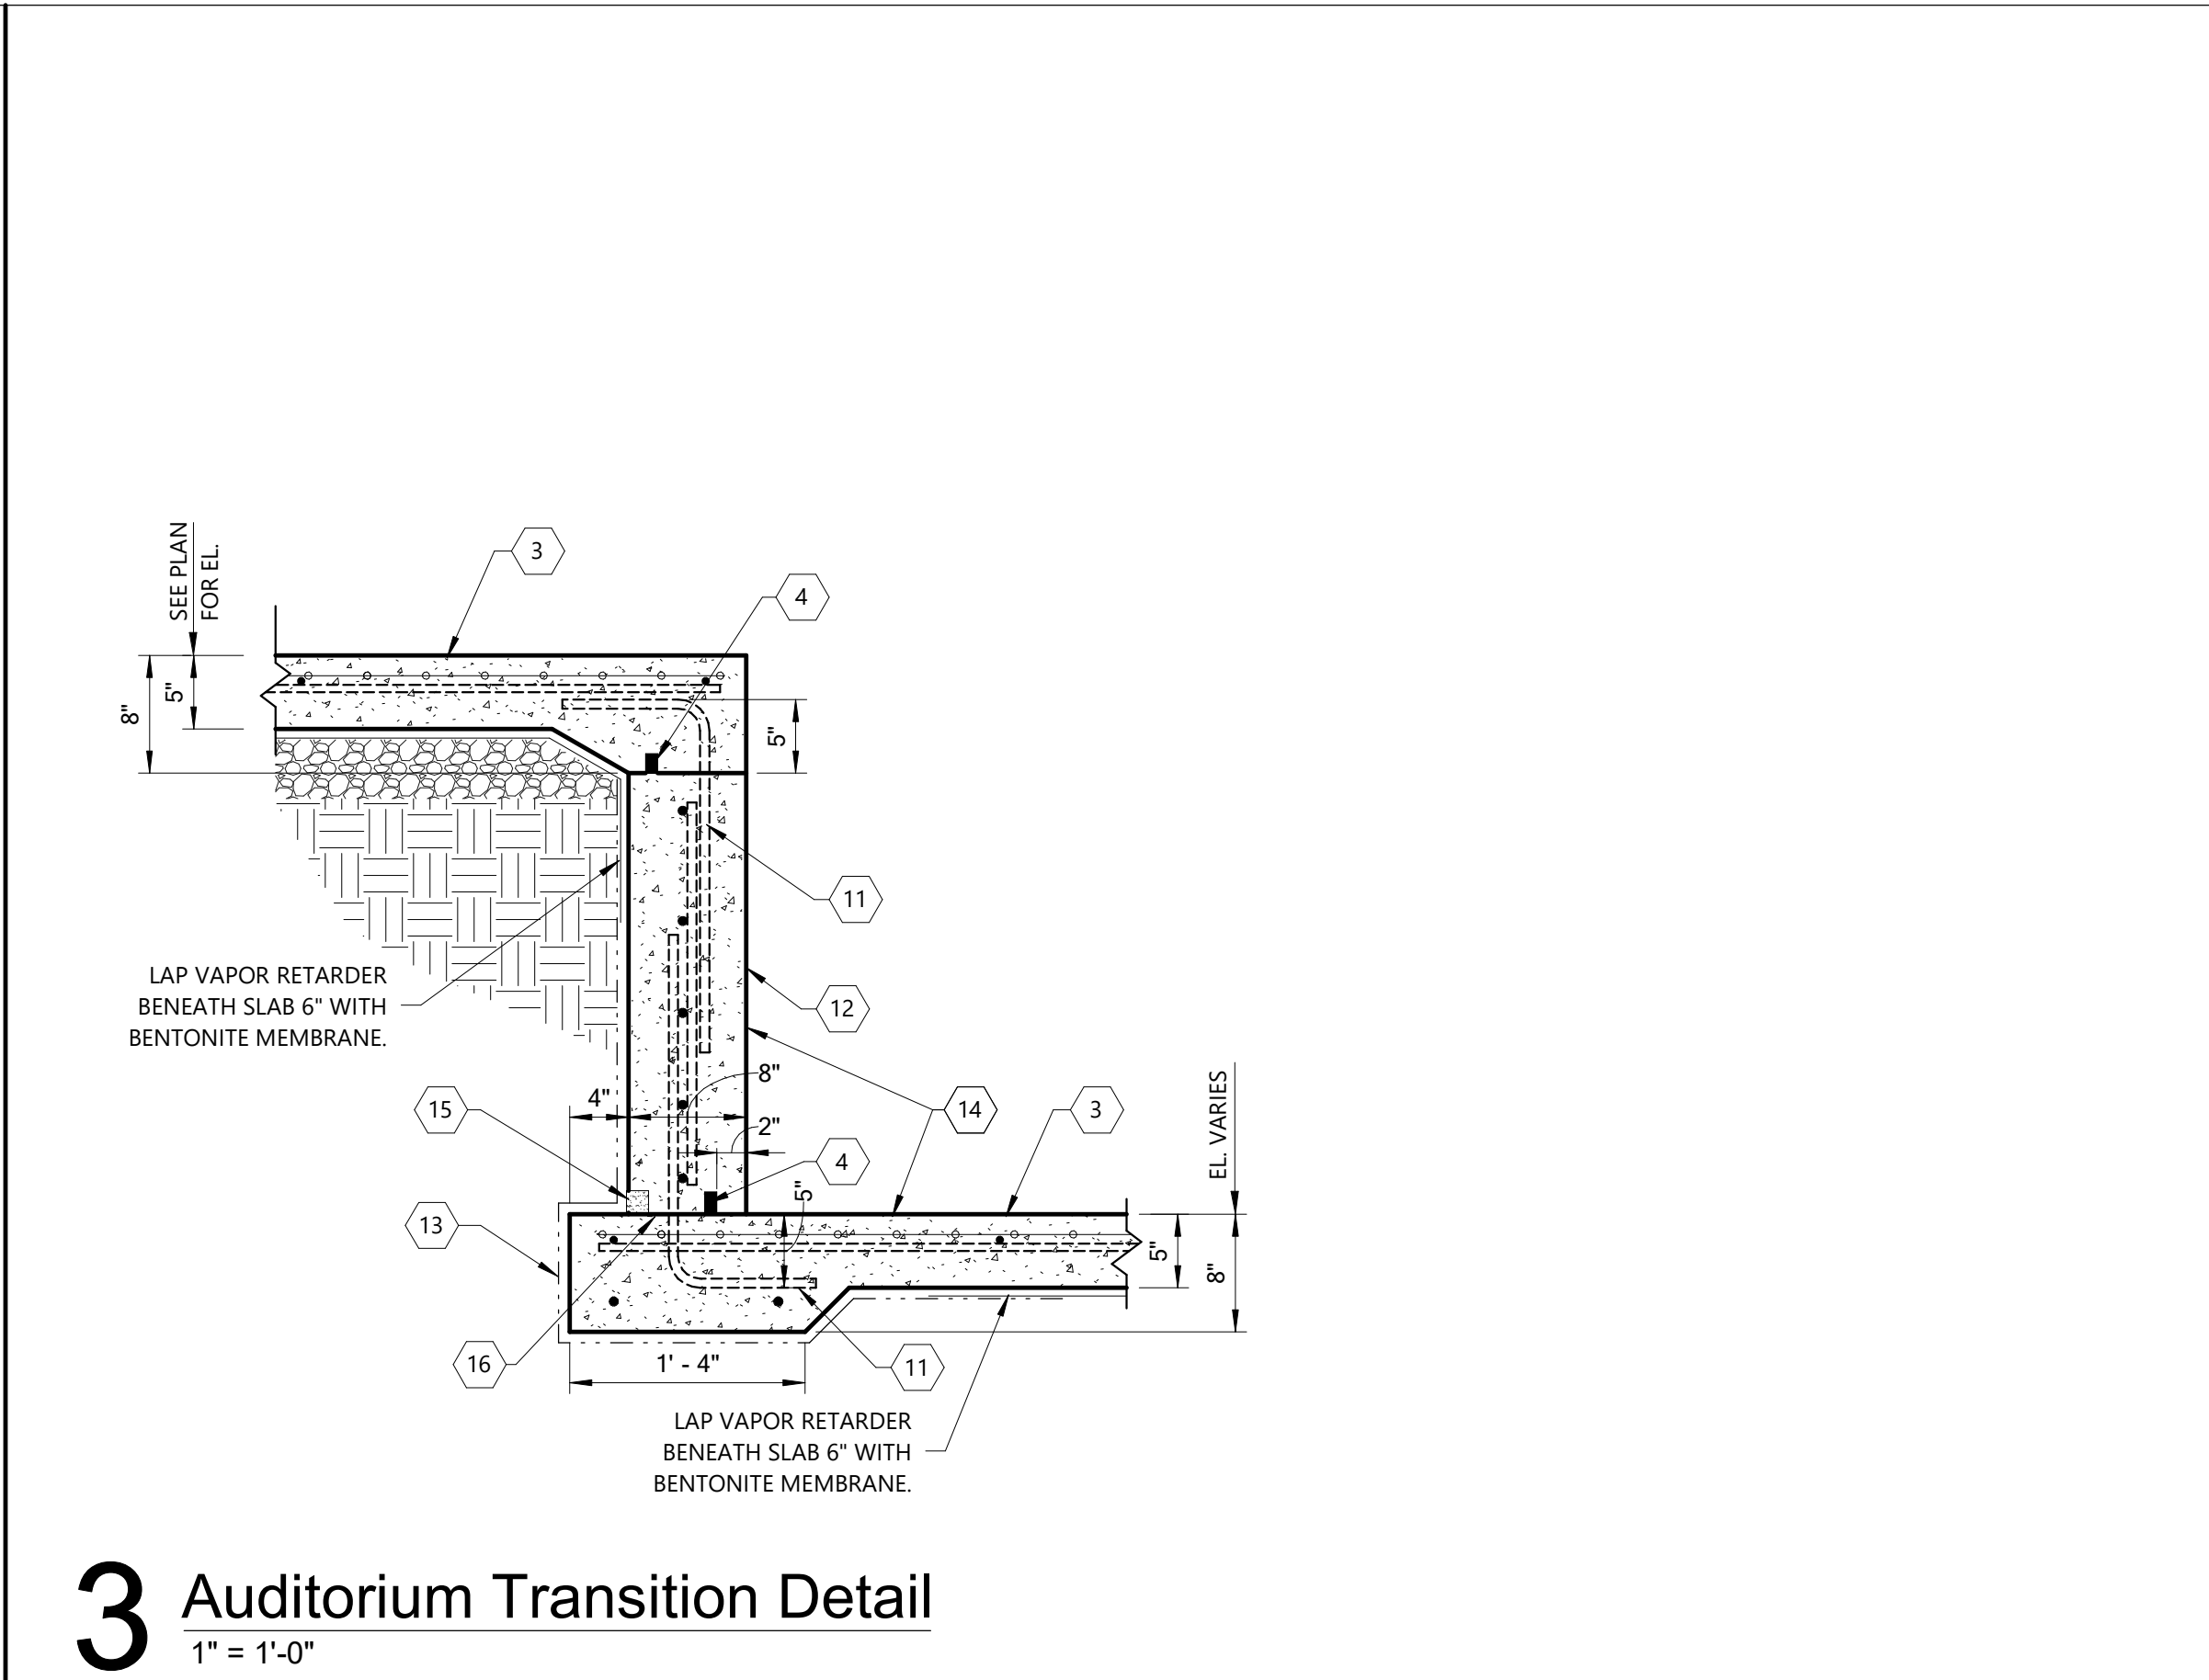


3 Auditorium Transition Detail
1" = 1'-0"

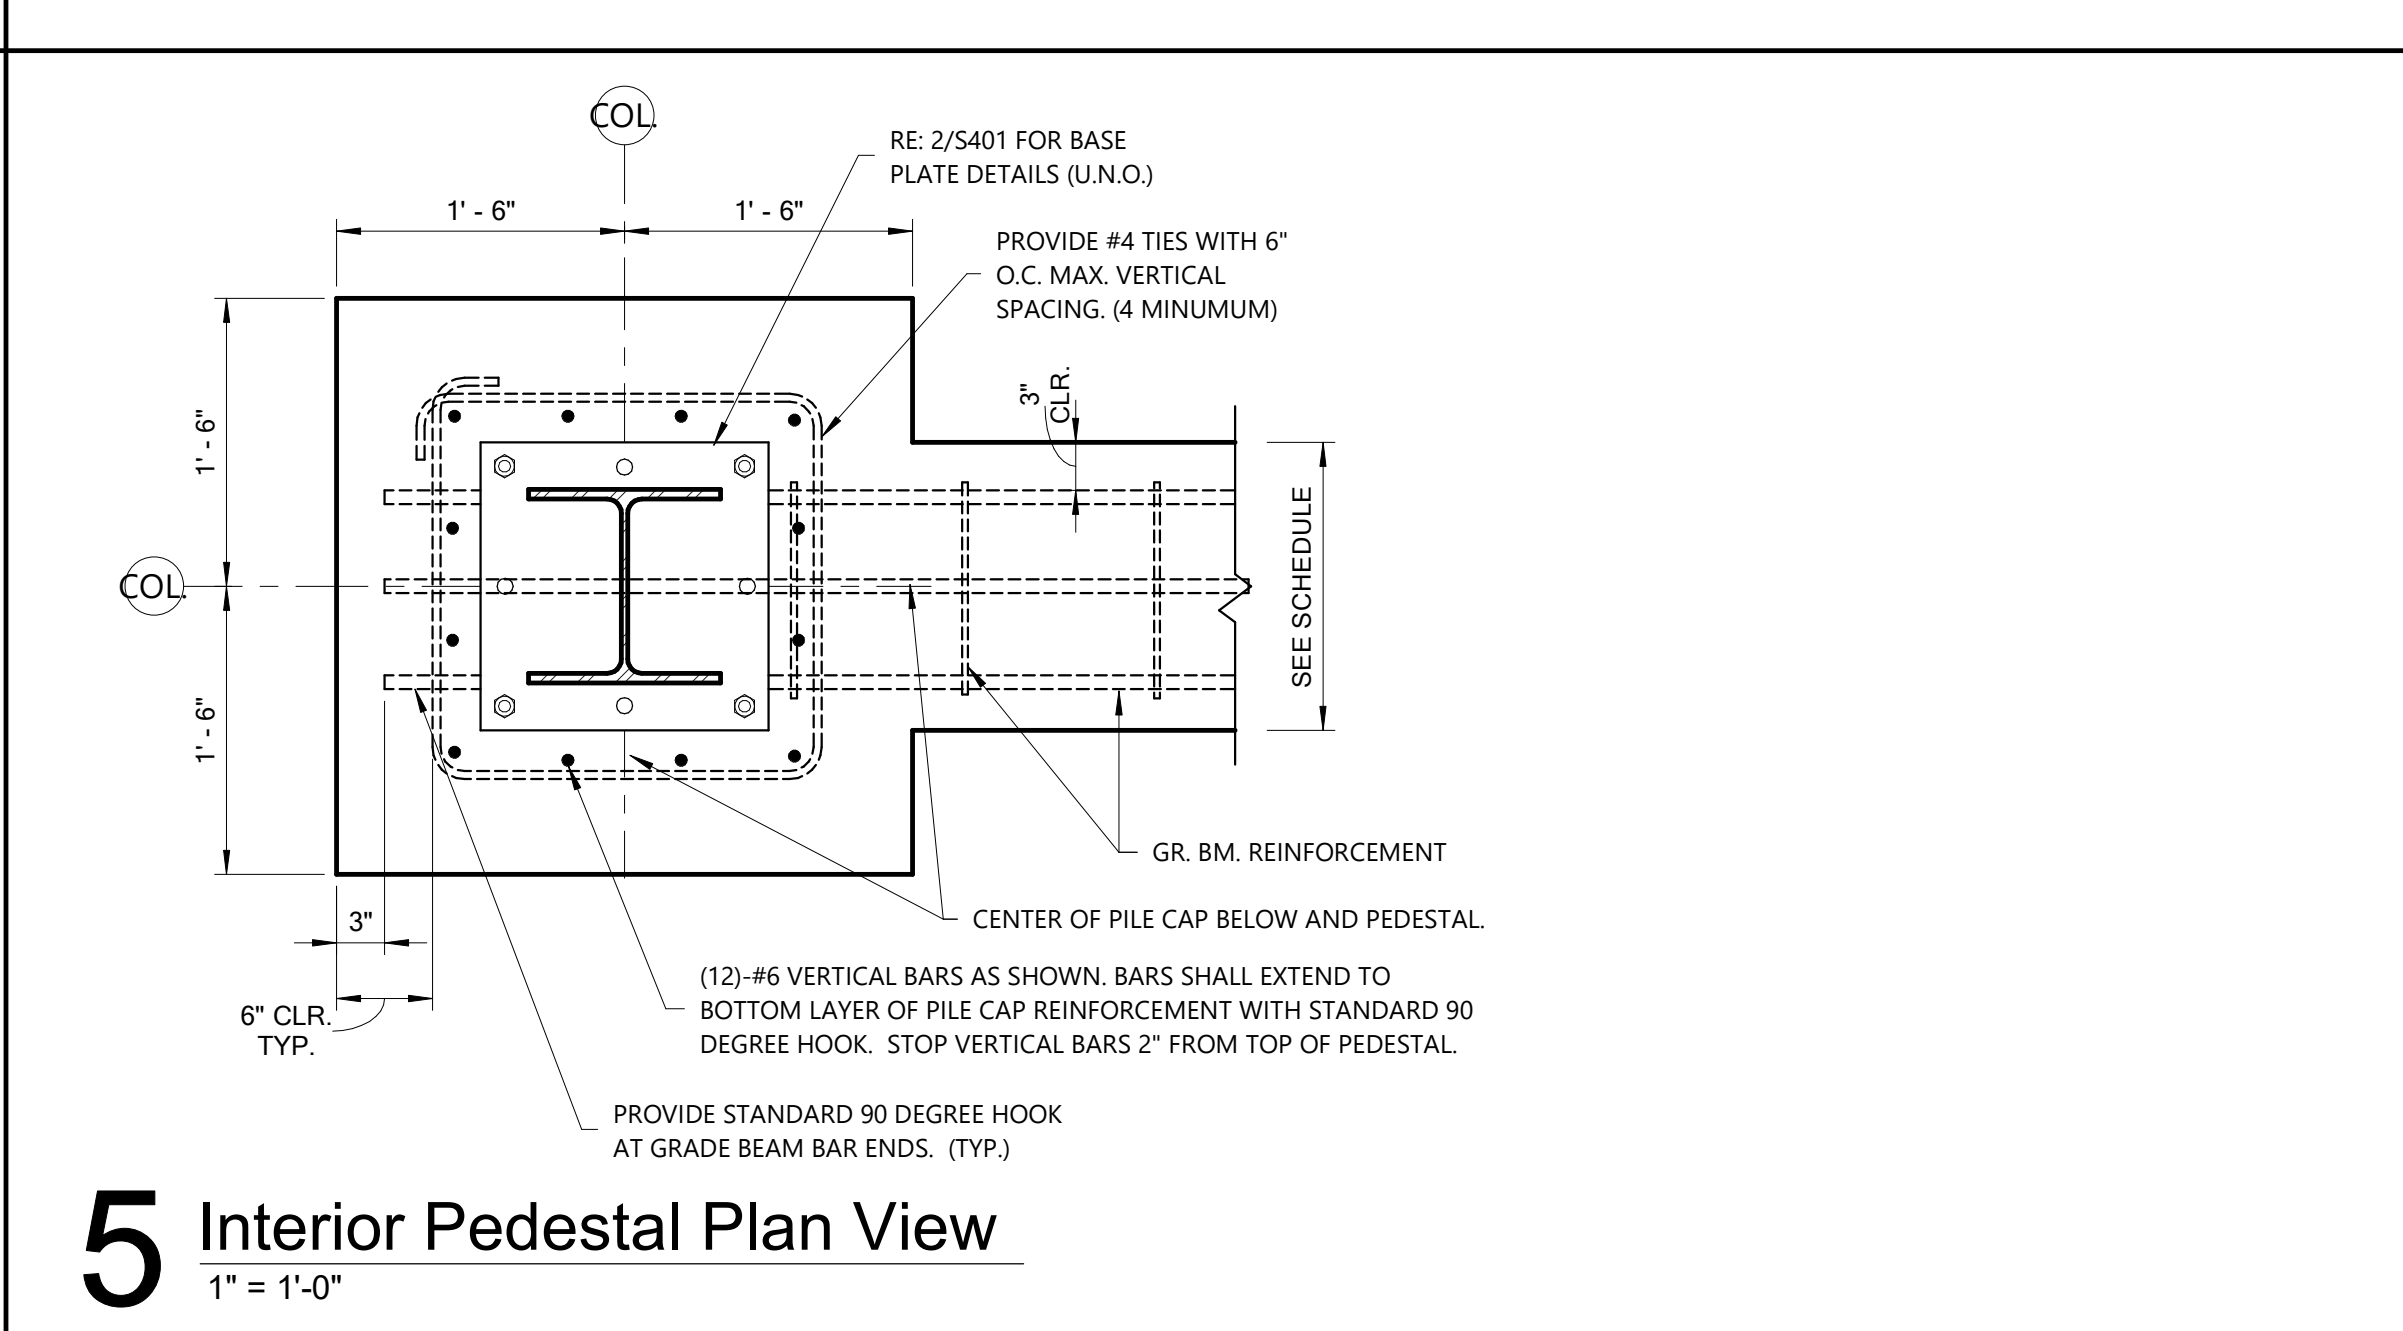

5 Interior Pedestal Plan View
1" = 1'-0"

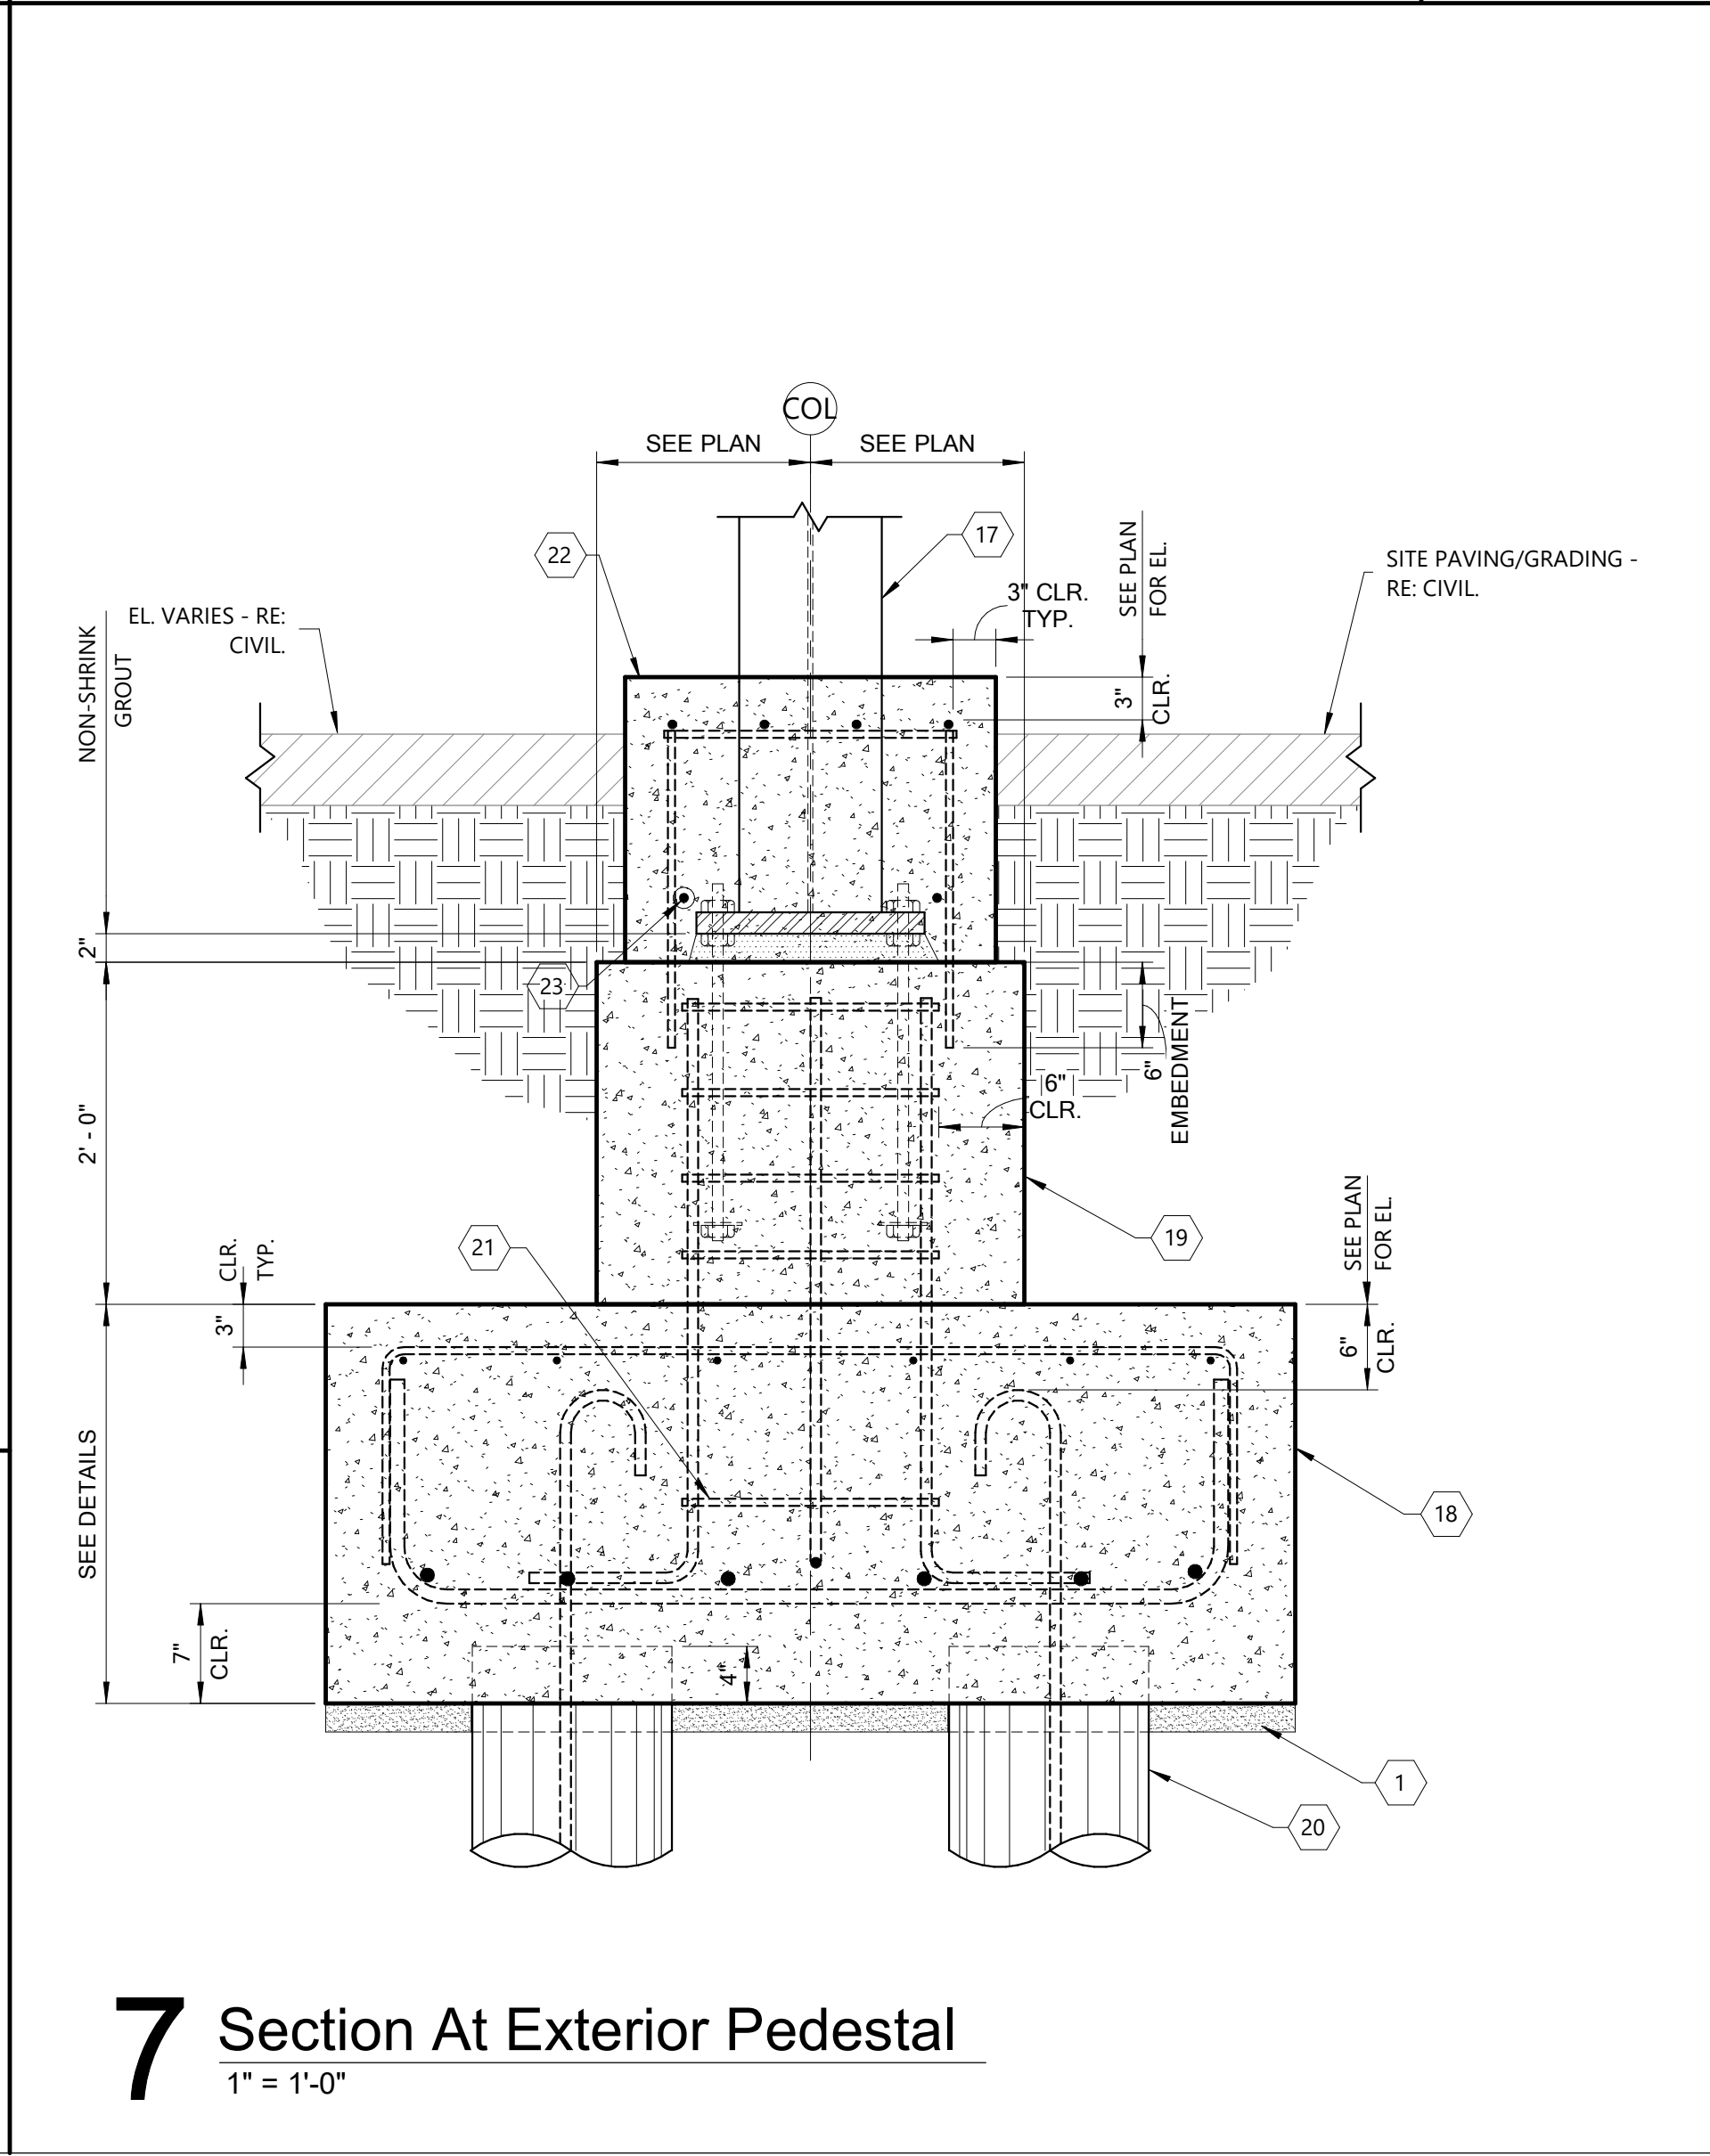

7 Section At Exterior Pedestal
1" = 1'-0"

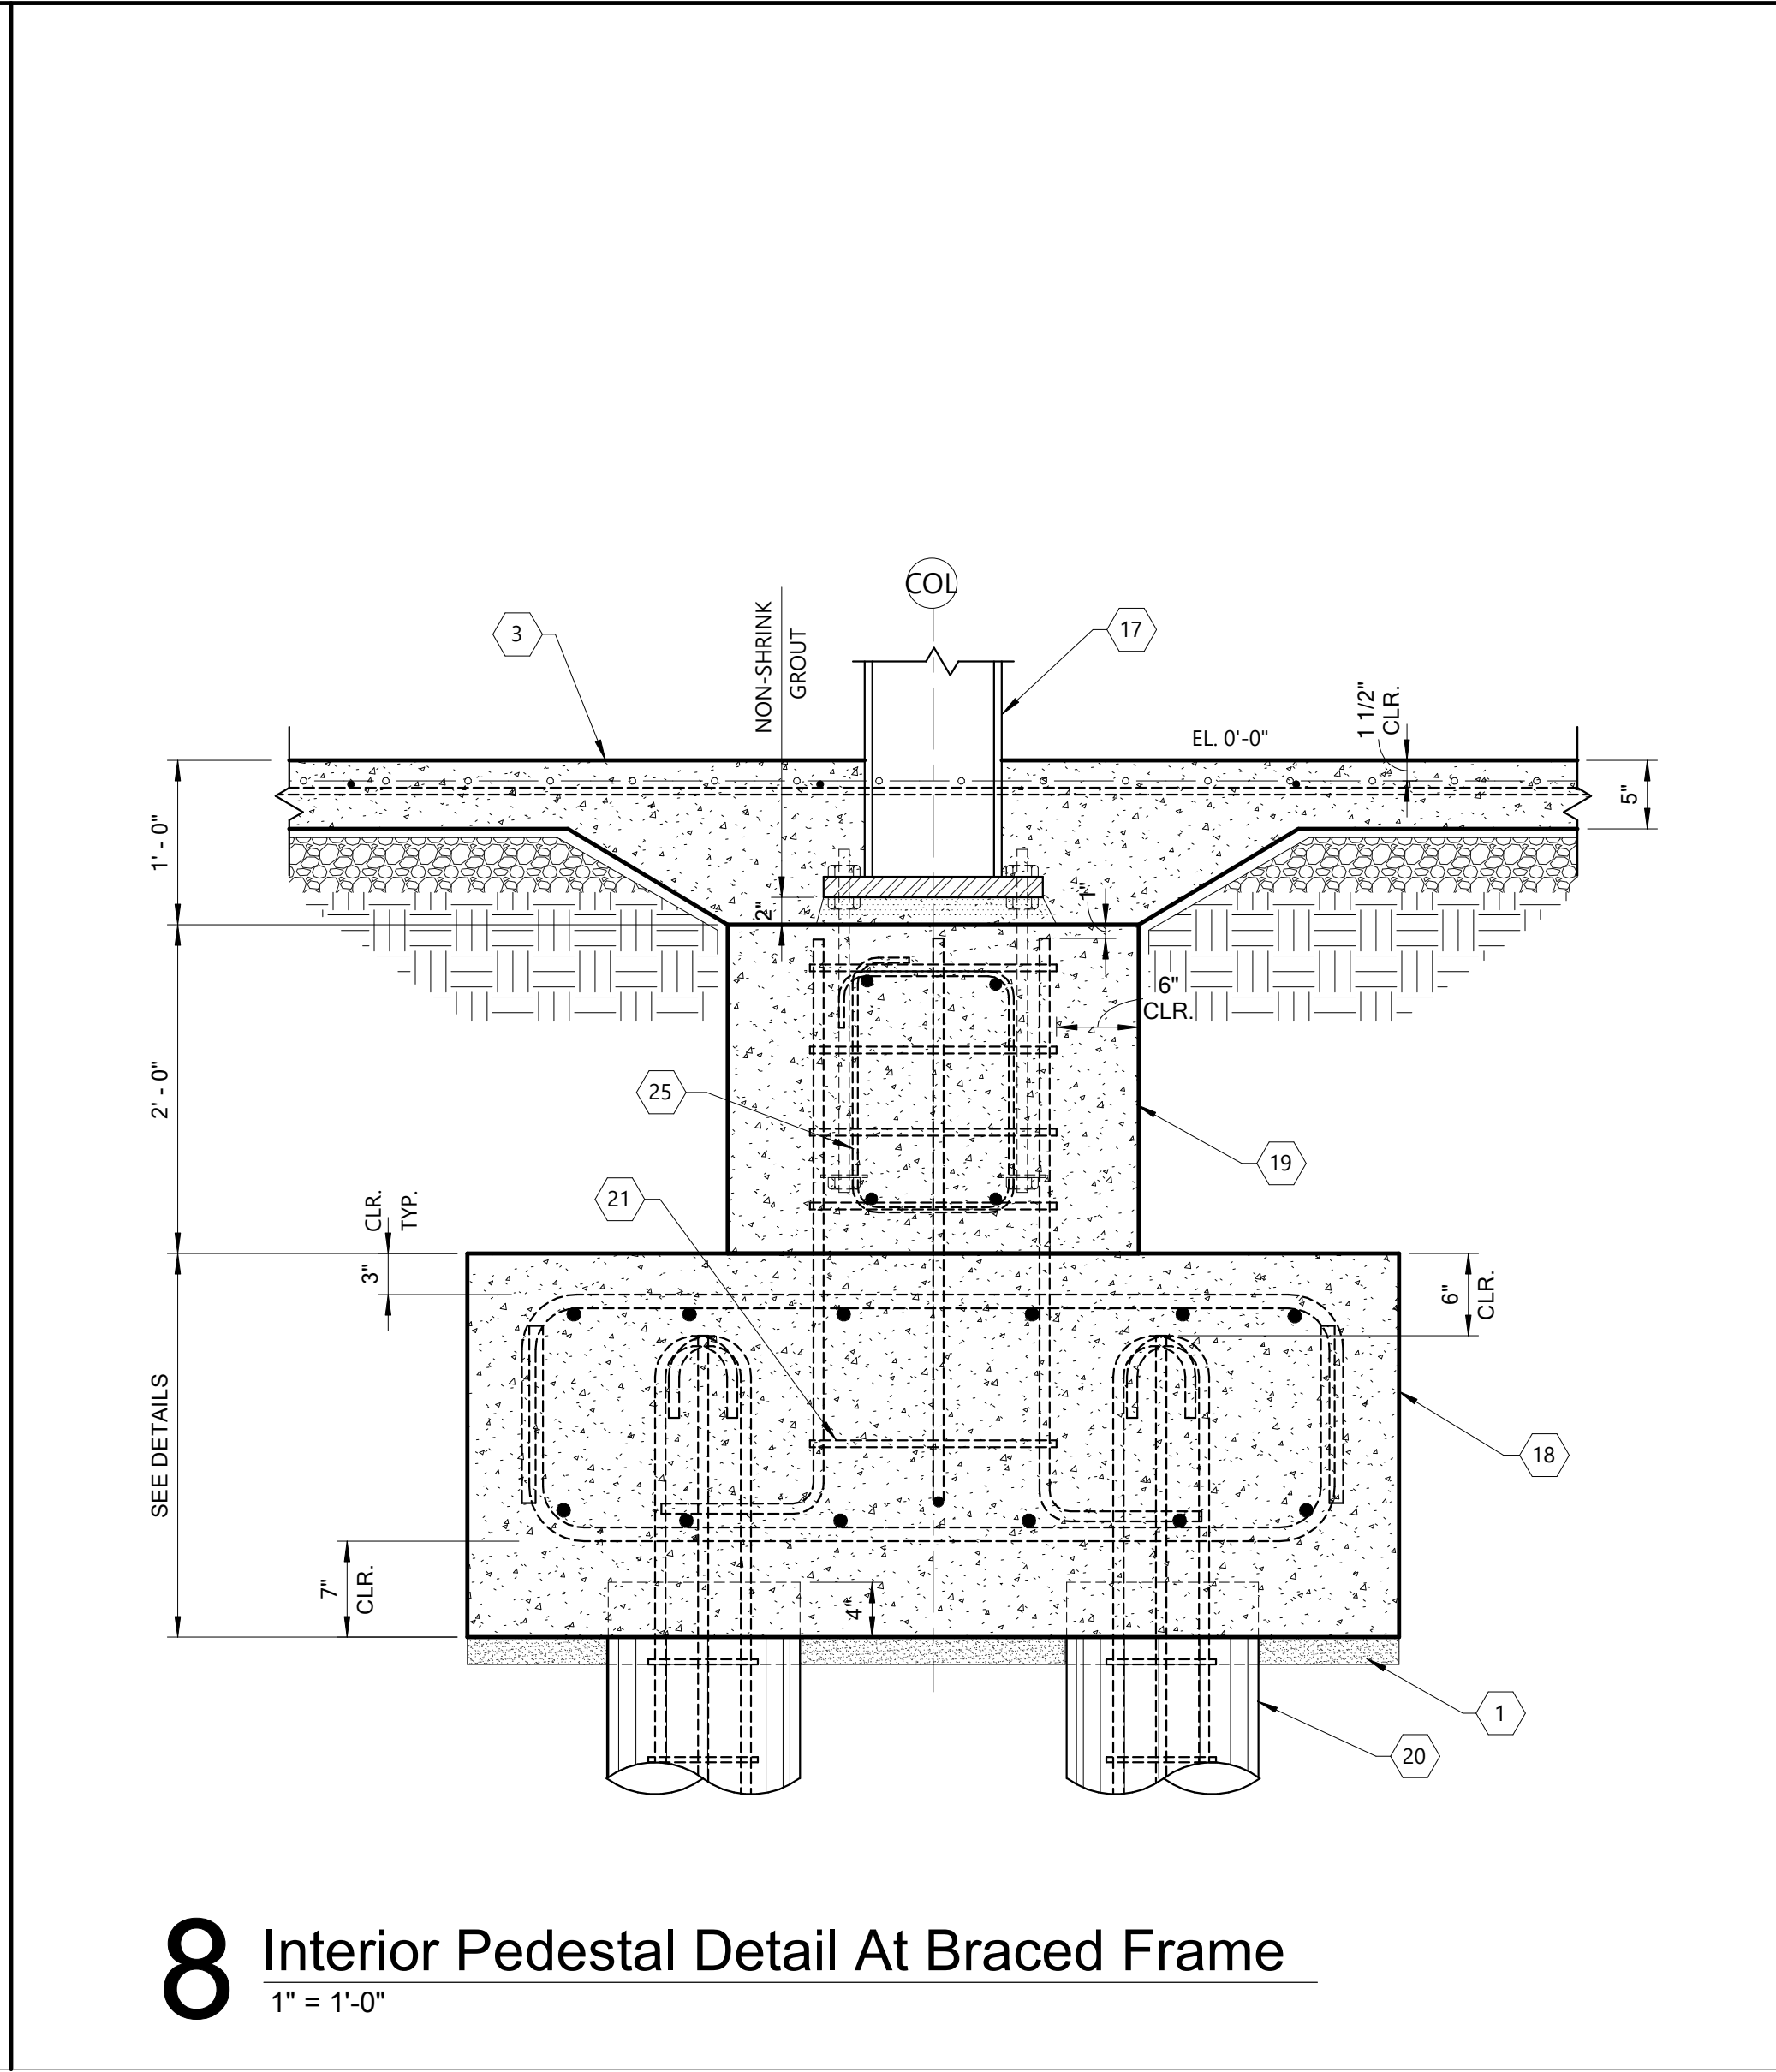

8 Interior Pedestal Detail At Braced Frame
1" = 1'-0"

- Keynote Legend**
- PROVIDE 2" DRY BOTTOM CONCRETE UNDER ALL GRADE BEAMS AND PILE CAPS. SEE FOUNDATION PLAN NOTES FOR MORE INFORMATION.
 - GRADE BEAM - SEE SCHEDULE FOR SIZE AND REINFORCEMENT.
 - CONCRETE SLAB-ON-GRADE. SEE SLAB PLAN FOR MORE INFORMATION.
 - CONTINUOUS WATERSTOP.
 - CONT. WATERPROOFING - RE ARCH.
 - PROVIDE 1 1/2" x 1 1/2" CONTINUOUS SEALING STRIP. APPLY ONE SLURRY COAT OF XYPEX CONCENTRATE AT THE RATE OF 1.5 POUNDS PER SQUARE YARD, THEN FILL SLOT TO SURFACE WITH XYPEX CONCENTRATE IN DRY-PAC FORM.
 - BETWEEN POURS, APPLY XYPEX CONCENTRATE SLURRY TO JOINT SURFACE AT RATE OF TWO POUNDS PER CUBIC YARD.
 - #5 DOWEL BARS AT 12" O.C. WITH STANDARD HOOK. LAP WITH SLAB BARS.
 - REINFORCE TURNDOWN WITH (2) #5 CONT. REINFORCE CONCRETE WALL WITH #4 BARS AT 9" O.C. EACH WAY EACH FACE OF WALL.
 - #5 L-BAR DOWELS (a=12", b=24") AT TOP AND BOTTOM OF PIT WALLS AND PIT GRADE BEAMS. SPACE DOWELS AT SAME FREQUENCY OF PIT WALL VERTICAL BARS AND LAP WITH WALL BARS.
 - 8" THICK CONCRETE WALL REINFORCED WITH #5 AT 12" O.C. EACH WAY. CENTER REINFORCEMENT IN WALL.
 - BENTONITE WATERPROOFING MEMBRANE AROUND WALLS. SUBMIT INFORMATION ON BENTONITE TO ARCHITECT FOR APPROVAL. PROVIDE LAPS AND TRANSITIONS PER MANUFACTURER'S RECOMMENDATIONS.
 - INCLUDE XYPEX ADMIX C-500 AT MANUFACTURER'S DOSAGE RATE.
 - PROVIDE 1 1/2" x 1 1/2" CONTINUOUS SEALING STRIP. APPLY ONE SLURRY COAT OF XYPEX CONCENTRATE AT THE RATE OF 1.5 POUNDS PER SQUARE YARD, THEN FILL SLOT TO SURFACE WITH XYPEX CONCENTRATE IN DRY-PAC FORM.
 - BETWEEN POURS, APPLY XYPEX CONCENTRATE SLURRY TO JOINT SURFACE AT RATE OF TWO POUNDS PER SQUARE YARD.
 - STEEL COLUMN - SEE PLAN FOR SIZE.
 - CONCRETE PILE CAP - SEE PLANS AND DETAILS FOR INFORMATION.
 - RECTANGULAR CONCRETE PEDESTAL. SEE PEDESTAL PLAN VIEW DETAILS FOR REINFORCEMENT.
 - AUGER CAST-IN-PLACE PILE - SEE PLAN AND DETAIL FOR MORE INFORMATION.
 - PROVIDE ADDITIONAL PEDESTAL TIE IN FOOTING FOR ALIGNMENT OF VERTICAL BARS.
 - CONCRETE PLINTH EXTENDING 4" ABOVE GRADE. SEE ARCH. DRAWINGS FOR EXACT SIZE. REINFORCE PLINTH WITH CONT. #4 BARS AT 6" O.C. EACH WAY AND #4 VERTICALS AT 6" O.C. WITH 6" EMBEDMENT INTO PEDESTAL AROUND PERIMETER OF PLINTH.
 - CONT. #4 EACH FACE OF PLINTH AT MID-HEIGHT.
 - CONCRETE WALL.
 - CONTINUE GRADE BEAM REINFORCEMENT THROUGH PEDESTAL.