

KEYNOTES
13.01 1/16" THICK LEAD SHIELDING TO A MINIMUM HEIGHT OF 7'-0". ALL ELECTRICAL BOXES CONDUIT ETC. SHOULD BE BACKED WITH THE SAME RECOMMENDED SHIELDING THICKNESS AS THE WALL IN WHICH THEY ARE LOCATED.

LEGEND
--- 1-HOUR RATED PARTITION (1)
--- 2-HOUR RATED BARRIER (2)
--- SMOKE PARTITION (S)



1 SECOND FLOOR PLAN
1/8" = 1'-0" RE:1A/100






CONSULTANTS
Monsieur & Associates, LLC
CABLO Landscape Architecture, LLC
Fox Nease Engineering, Inc.
Sela O'Brien
Associated Design Group, Inc.
Specialty Architect

ISSUE FOR BID
LOUISIANA STATE UNIVERSITY
ALEXANDRIA
DOWNTOWN HEALTH SERVICES CENTER
800 JACKSON ST.
ALEXANDRIA, LA 71301

PROJECT # 19-602-23-01
ARCH PROJECT # 2023.20 / 1031-00-23
SITE ID NEW SITE CODE 6-40-023
DATE OCTOBER 10, 2023

Ashe Broussard Weinzettle Architects, LLP
Tipton Associates APC, A Joint Venture
301 Jackson Street, Suite 205
Alexandria, LA 71301

NO. REVISION DATE

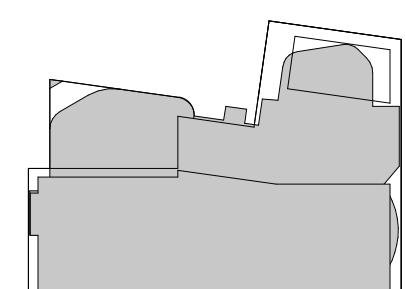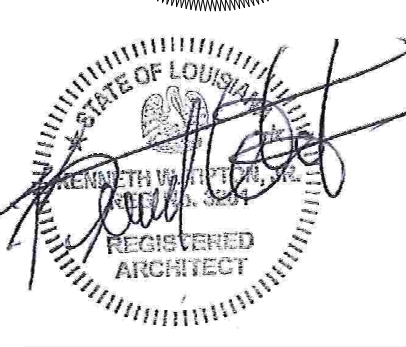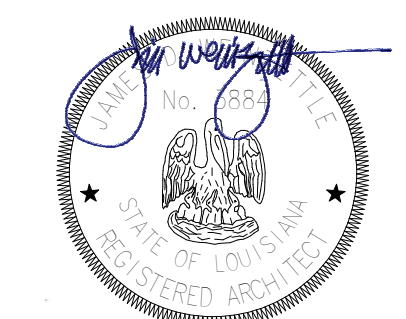

SECOND FLOOR
PLAN-DIMENSIONS

A102D