




1 **FOURTH FLOOR TOILET #408 #410 SANITARY**
Scale: 1/4" = 1'-0"

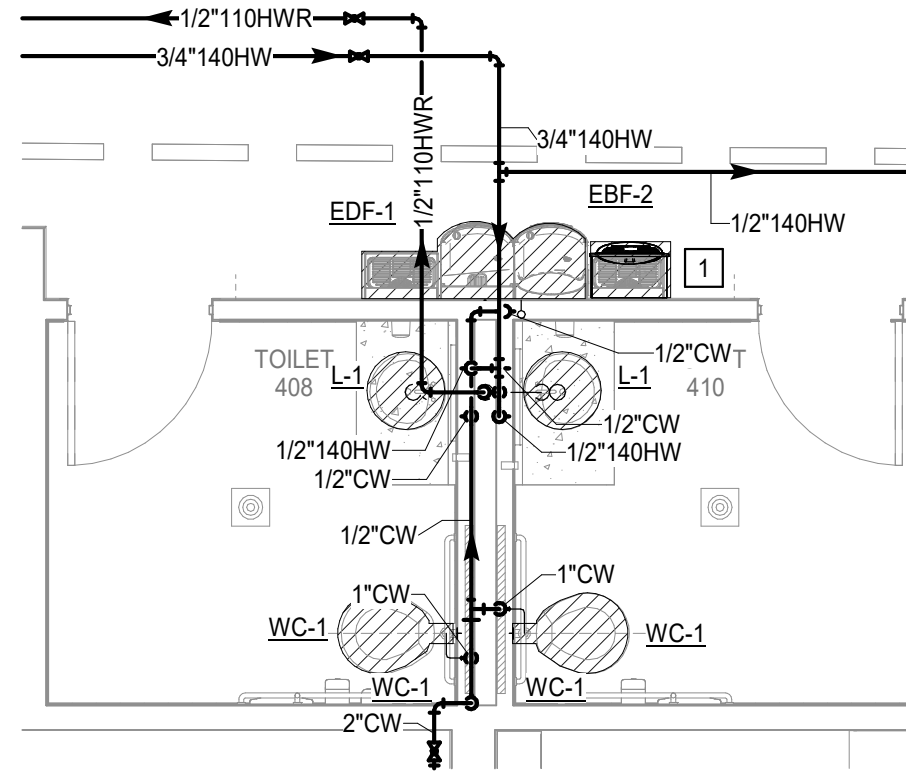

2 **FOURTH FLOOR TOILET #408 #410 WATER SUPPLY**
Scale: 1/4" = 1'-0"

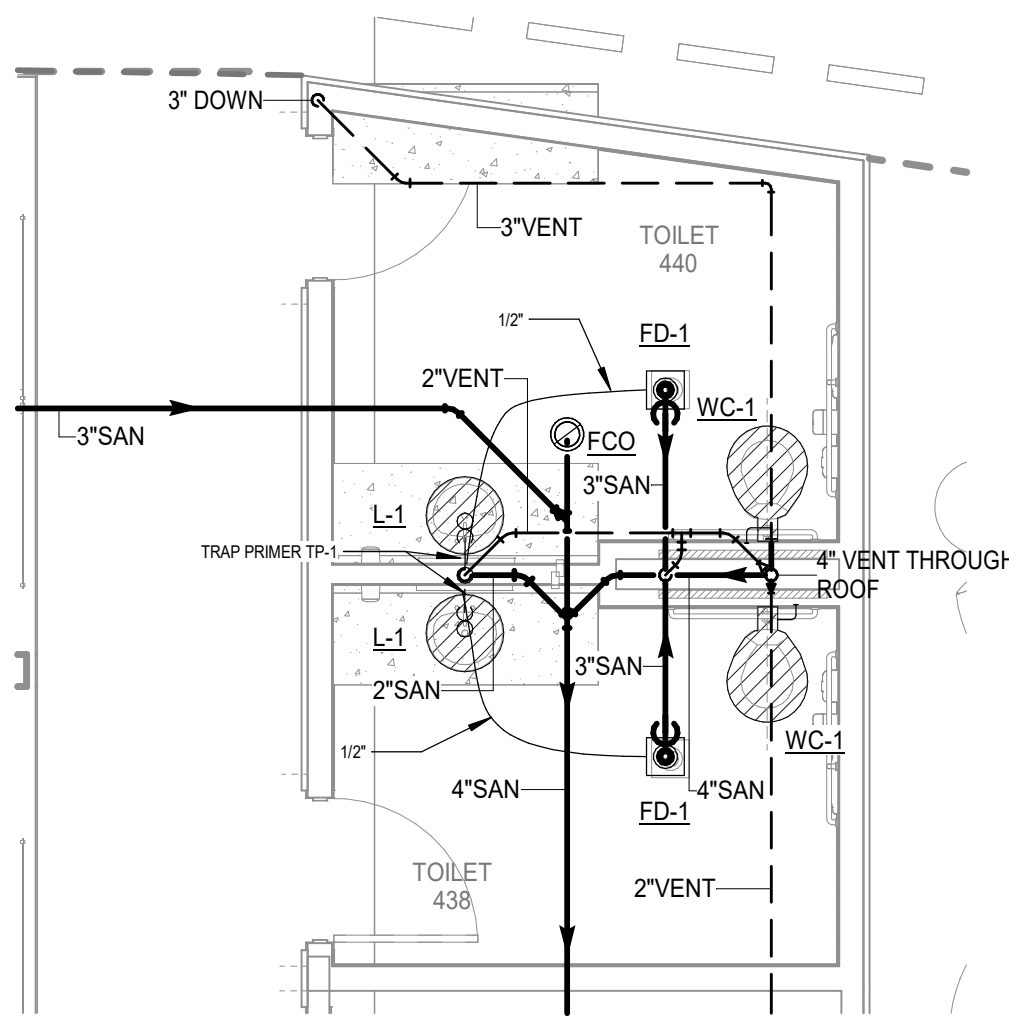

3 **FOURTH FLOOR TOILET #438 #440 SANITARY**
Scale: 1/4" = 1'-0"

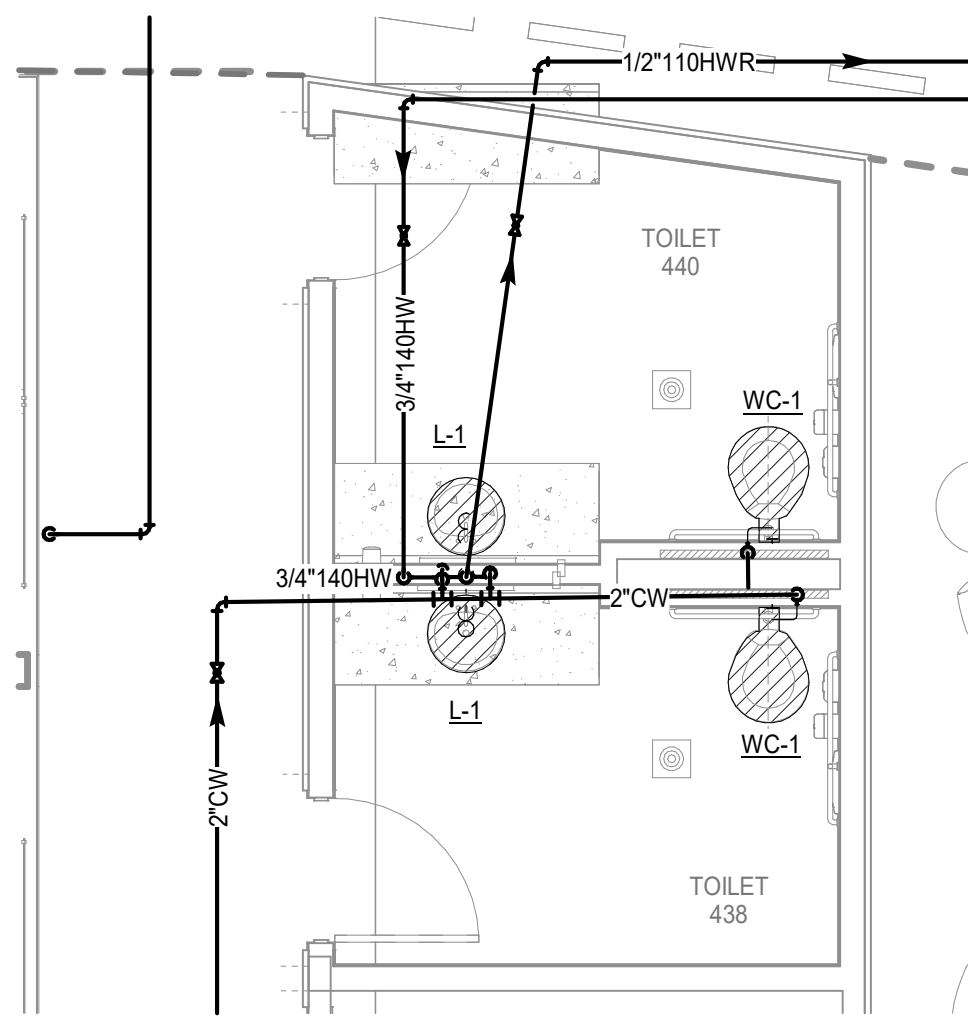

4 **FOURTH FLOOR TOILET #438 #440 WATER SUPPLY**
Scale: 1/4" = 1'-0"

PLUMBING GENERAL NOTES	
1.	HOT WATER IS PROVIDED AND CIRCULATED AT 140° F LIMITED AT THE CENTRAL PLANT VIA A MASTER MIXING VALVE IN ORDER TO HELP ELIMINATE DEVELOPMENT OF LEGIONELLA IN DOMESTIC HOT WATER SYSTEM.
2.	HOT WATER TEMPERATURE IS REDUCED FROM 140° F TO 110° F VIA INDIVIDUAL MIXING VALVES AT EACH SINK / LAVATORY, REFER TO PLUMBING FIXTURE SCHEDULE ON SHEET P401.
3.	FIXTURES USED FOR FOOD SERVICE (KITCHEN) UTILIZE 140° F.

PLUMBING KEYED NOTES	
1	PLUMBER SHALL TAP OFF EBF-2 REFRIGERATED 1/2" CW CONNECTION FROM ONE OF EDF-1 REMOTE CHILLERS ECH#