



ROOF

FOURTH FLOOR

THIRD FLOOR

SECOND FLOOR


FIRST FLOOR

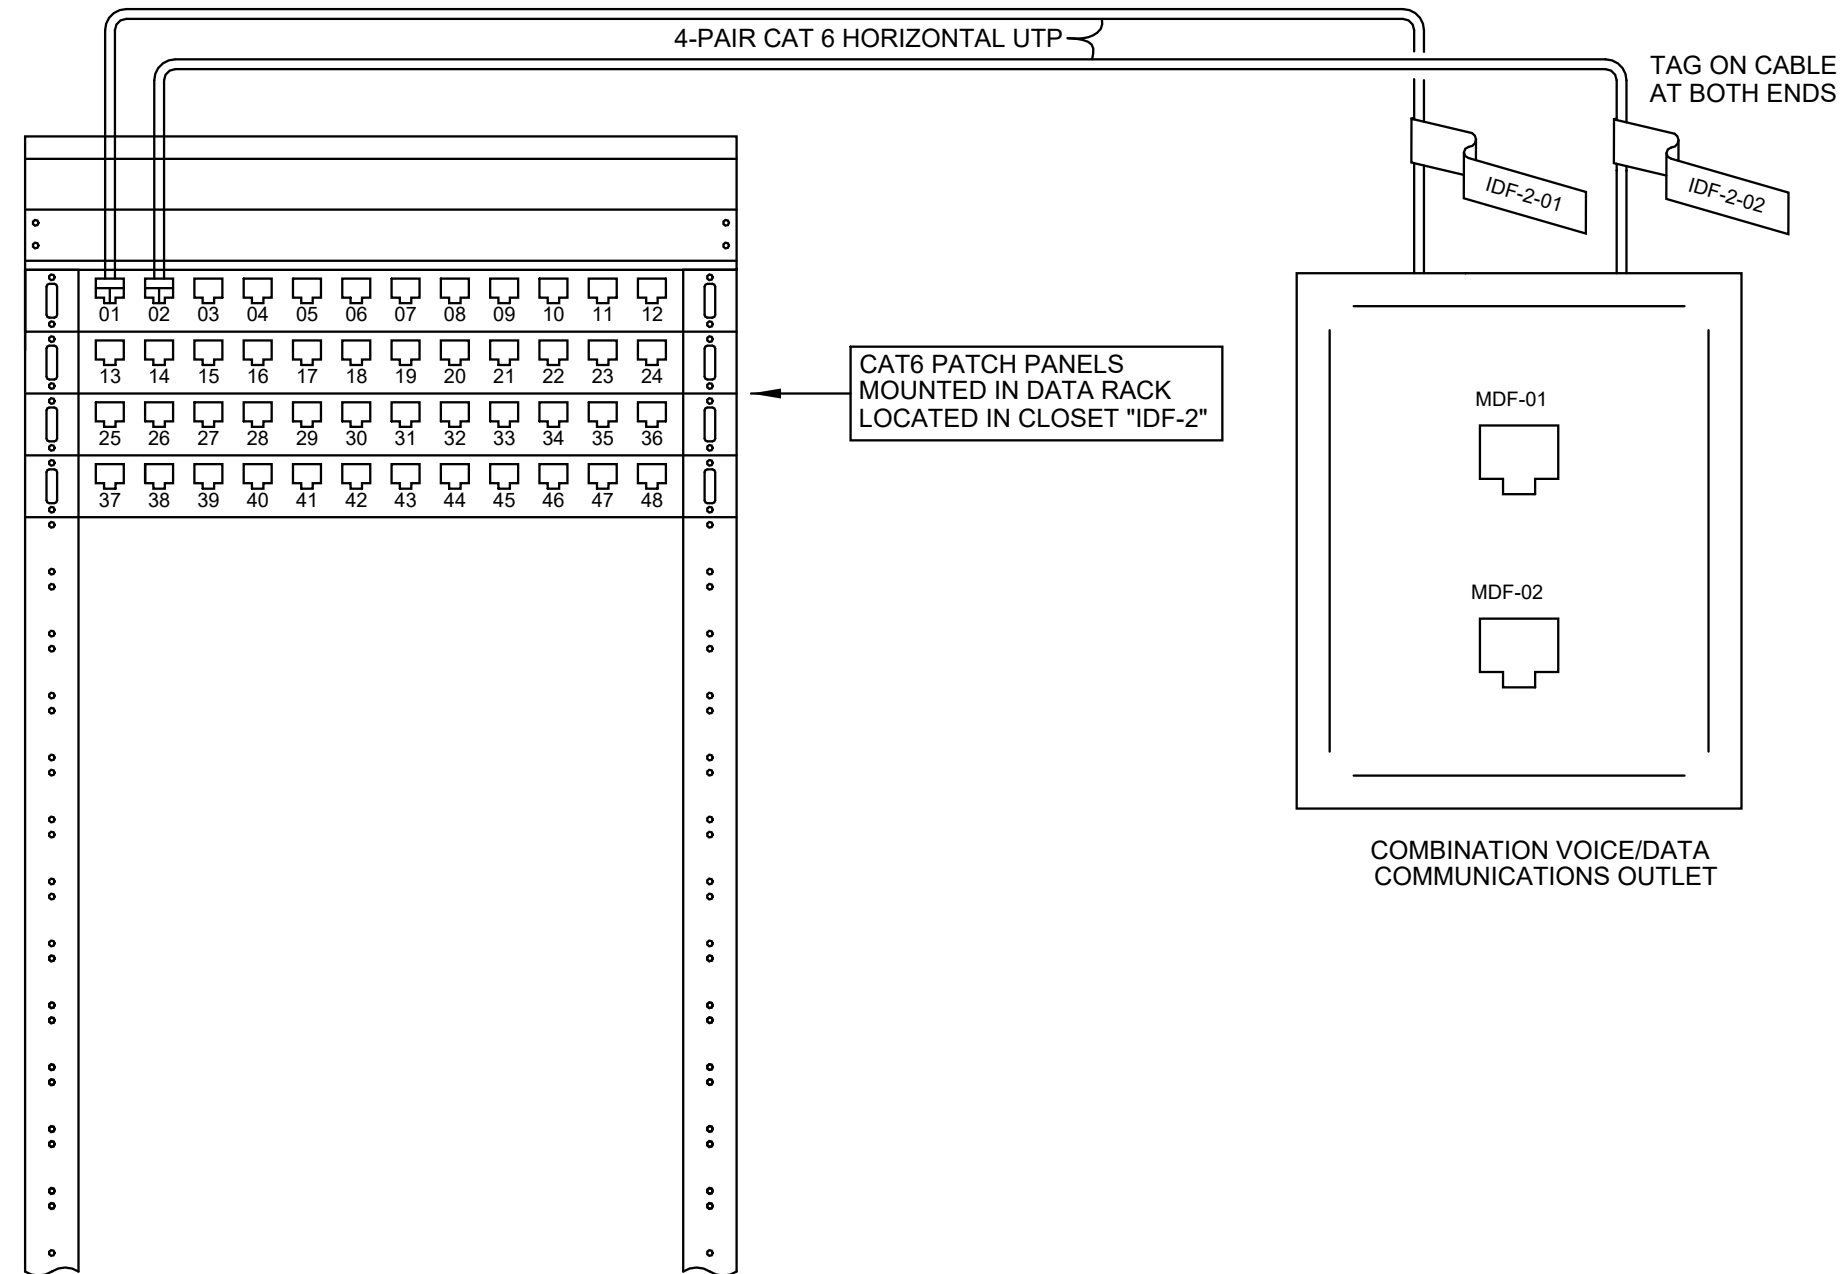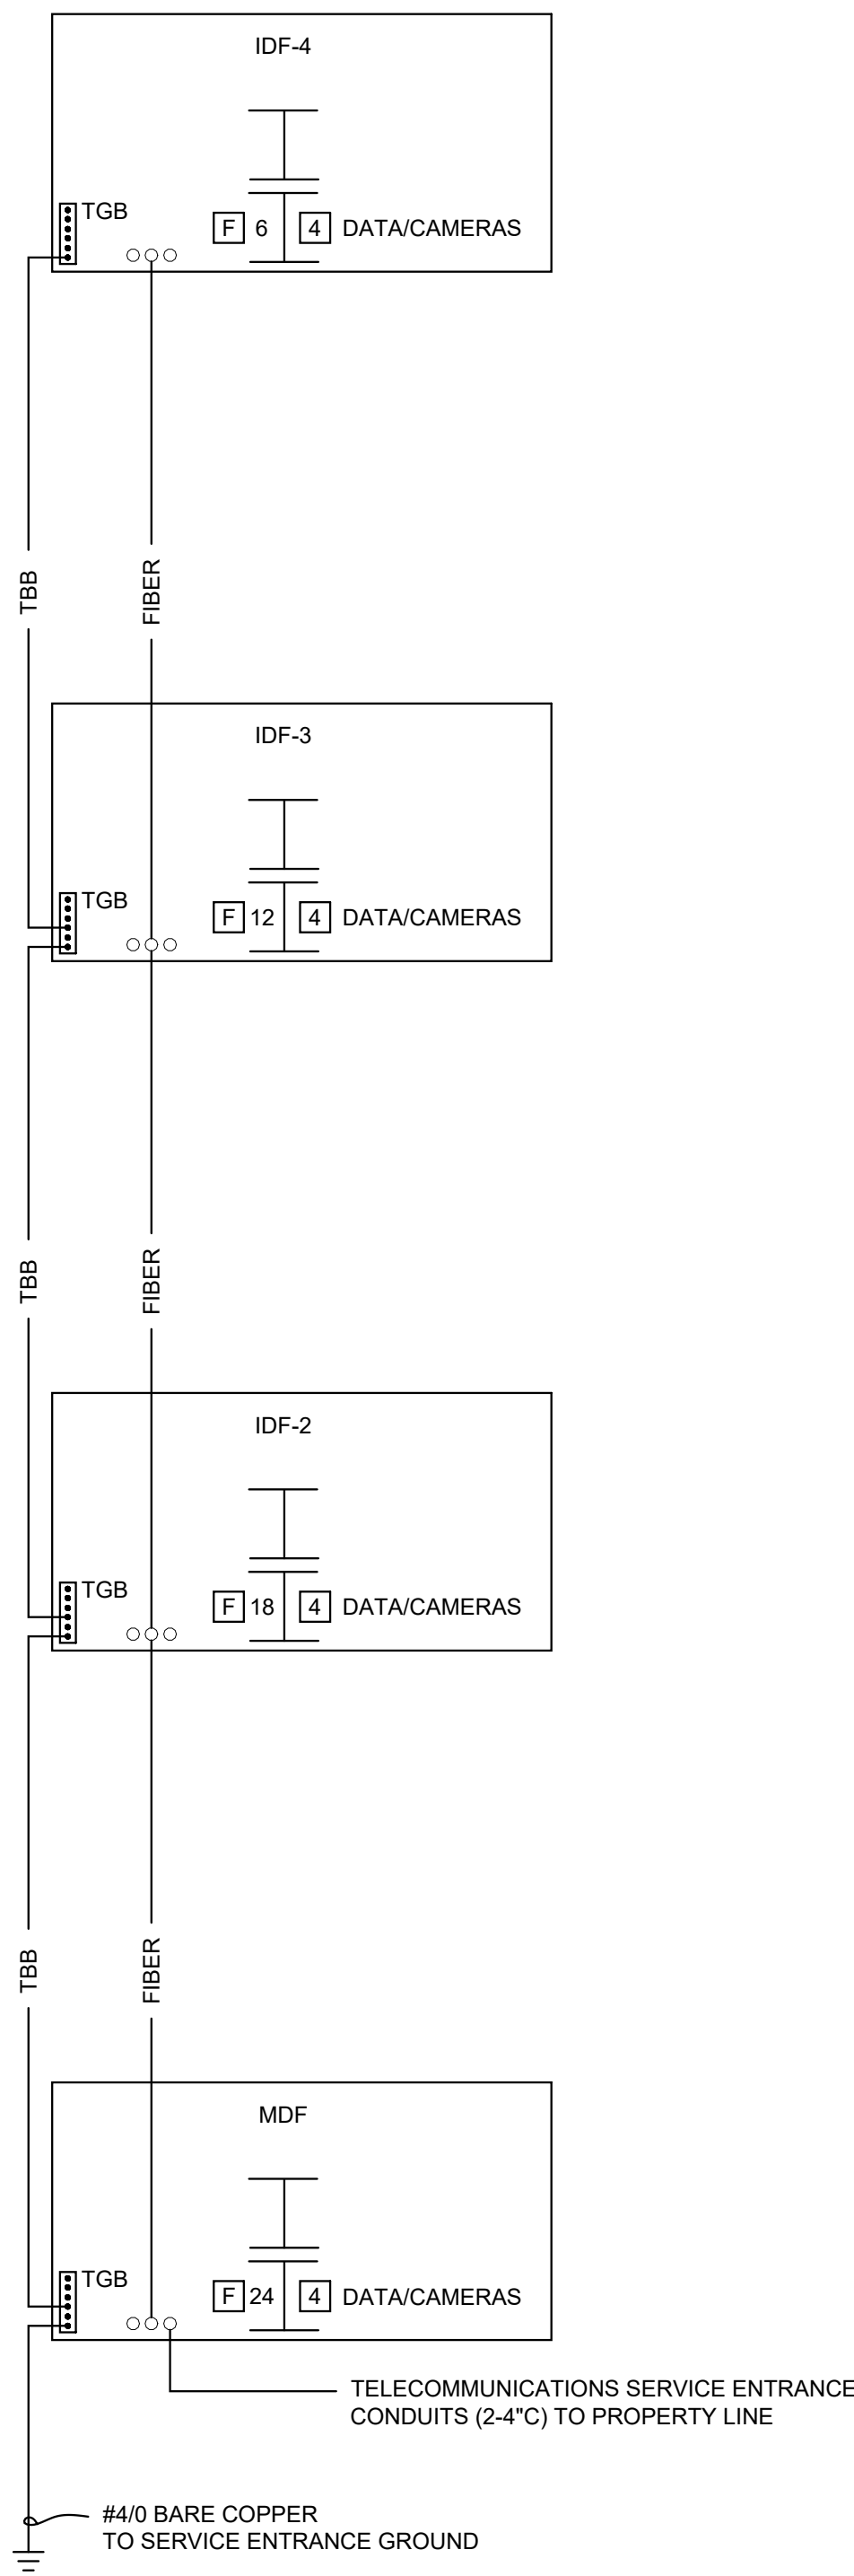

VOICE/DATA OUTLET TO DATA RACK  
TERMINATION AND LABELING DETAIL  
SCALE: NONE

VOICE/DATA LEGEND

- FIBER — ONE (12)-STRAND MULTI-MODE FIBER OPTIC CABLE (BELDEN #225715 OR BERK-TEK #OPR66012) IN 1" C WITH 25' SLACK CABLE AT EACH CLOSET AND ONE 1" SPARE CONDUIT, CAPPED WITH PULL STRING. CAPPED WITH PULL STRING. TERMINATE CABLE AT RACK MOUNTED FIBER ENCLOSURE.
- CABLE TRAY — 19" RACK WITH CAT 6 PATCH PANELS AND CABLE MANAGEMENT PANELS (NUMBER IN SQUARE REPRESENTS THE NUMBER OF 24-PORT PATCH PANELS REQUIRED WITHIN RACK).
- RACK MOUNTED FIBER OPTIC CABLE TERMINATION ENCLOSURE WITH "LC" CONNECTORS AS REQUIRED. NUMBER REPRESENTS THE NUMBER OF FIBERS TO BE TERMINATED.
- SURGE PROTECTOR
- TBB — TELECOMMUNICATIONS BONDING BACKBONE - ONE #2 COPPER CONDUCTOR IN 1/2" C BONDED TO TGB IN CLOSET AS SHOWN.
- MDF — TELECOMMUNICATIONS EQUIPMENT ROOM, MAIN DISTRIBUTION FRAME "MDF"
- IDF-2 — TELECOMMUNICATIONS EQUIPMENT ROOM, INTERMEDIATE DISTRIBUTION FRAME "IDF-2"
- TGB — TELECOMMUNICATIONS GROUNDING BUSBAR - 1/4" THICK COPPER, 2 1/2" WIDE, 12" LONG WITH PRE-DRILLED NEMA BOLT HOLES, MOUNTED ON INSULATED STAND-OFFS.

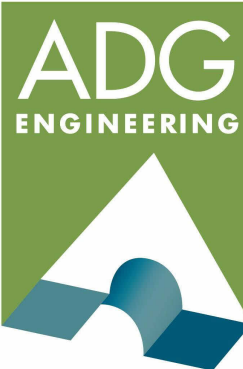

ASSOCIATED DESIGN GROUP, INC.  
3909 West Congress Street, Suite 201  
Lafayette, Louisiana 70506  
Phone: (337) 234-5710  
Email: adginc@adginc.org

Project No. 24174