




1 LIGHTNING PROTECTION ROOF PLAN
1/8" = 1'-0"

GENERAL NOTES


KEYNOTES

GENERAL NOTES

1. THE CONTRACTOR SHALL PROVIDE A COMPLETE, UL CERTIFIED, ROOF COMPATIBLE LIGHTNING PROTECTION SYSTEM FOR THE OVERALL FACILITY (EXISTING BUILDING AND WING ADDITIONS) AS APPROVED BY ARCHITECT AND/OR ENGINEER. THE SYSTEM SHALL BE INSTALLED BY A LIGHTNING PROTECTION CONTRACTOR ACTIVELY ENGAGED IN THE INSTALLATION OF UL MASTER LABEL SYSTEMS. IN ACCORDANCE WITH NFPA 780 AND THE MANUFACTURER'S RECOMMENDATIONS, THE CONTRACTOR SHALL HAVE A MINIMUM OF 5 YEARS EXPERIENCE IN LIGHTNING PROTECTION INSTALLATIONS.
2. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL LOCAL CODES AND ORDINANCES.
3. INSTALL CONDUCTORS AND COMPLEMENTARY PARTS SO COMPLETED WORK IS UNOBTUSIVE AND DOES NOT DISTRACT FROM APPEARANCE.
4. BOND FULL SIZE CONDUCTOR TO ALL METAL OBJECTS ON ROOF. BOND ROOF DRAINS AS REQUIRED, LADDER HATCHES, MECHANICAL EQUIPMENT, ETC.
5. UPON COMPLETION OF THE JOB, THE CONTRACTOR SHALL FURNISH THE OWNER WITH A UL LETTER OF CERTIFICATION.
6. PROVIDE LIGHTNING PROTECTION AT GENERATOR LOCATION AND TIE INTO SYSTEM AS REQUIRED.
7. ROOF PENETRATIONS ARE PROHIBITED.
8. LIGHTNING PROTECTION SYSTEM COMPONENTS SHALL BE ALUMINUM, UNLESS INDICATED OTHERWISE.

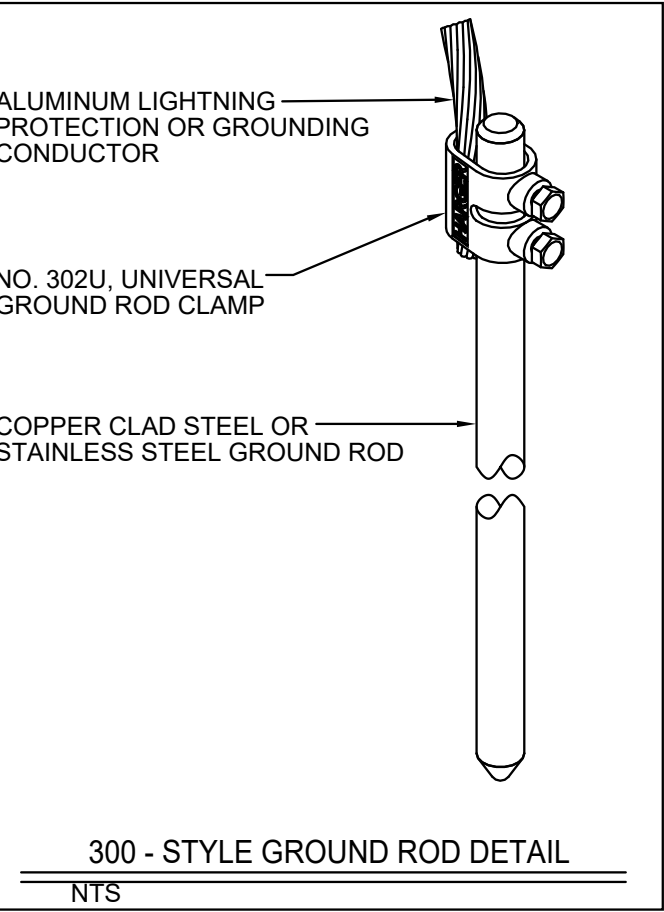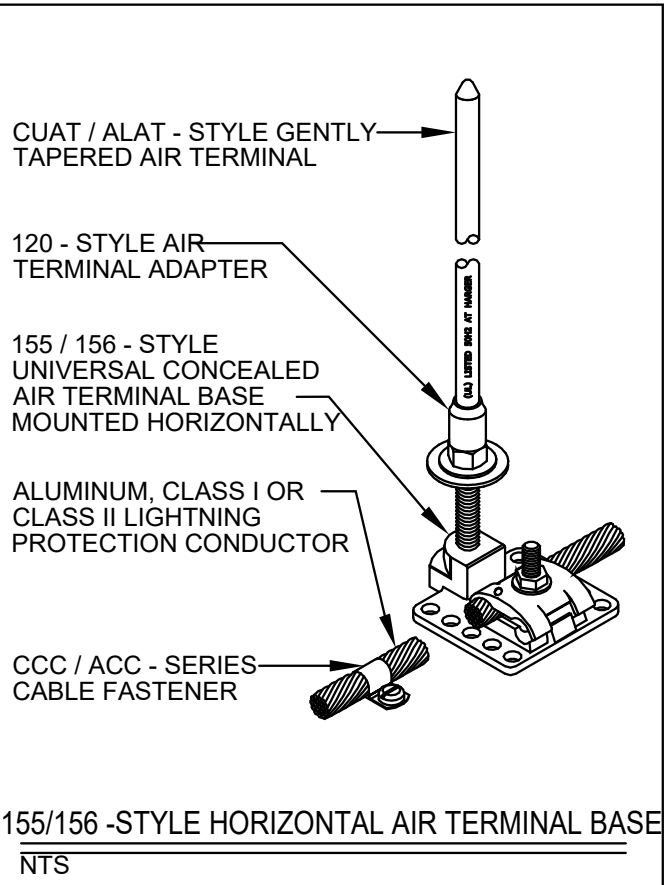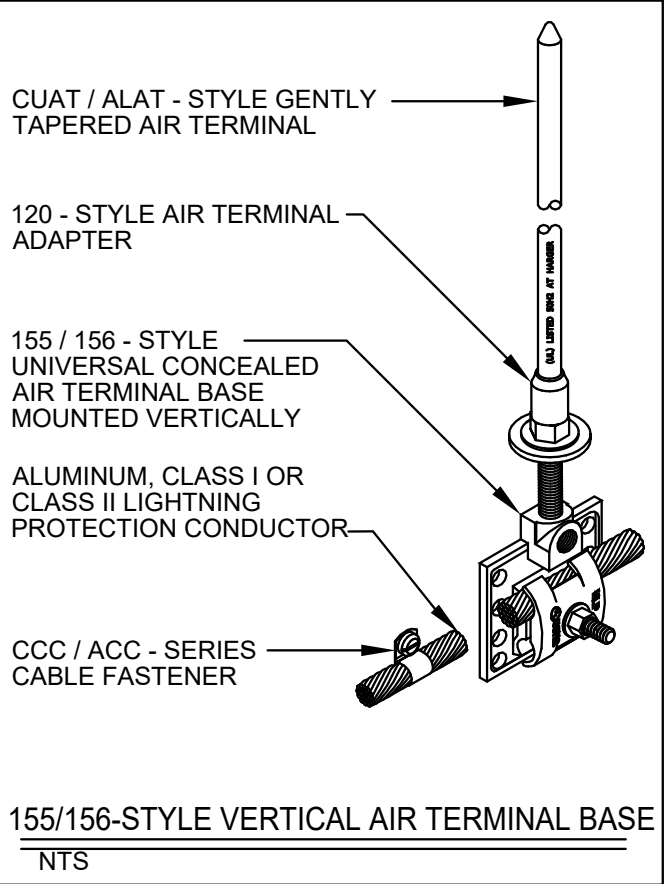

LEGEND

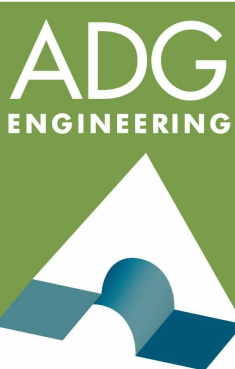

ASSOCIATED DESIGN GROUP, INC.
3909 West Congress Street, Suite 201
Lafayette, Louisiana 70506
Phone: (337) 234-5710
Email: adginc@adginc.org

Project No. 24174

KEYPLAN

