


POWER KEYNOTES:

- 1 CONCEAL RECEPTACLE INSIDE WATER COOLER FRAME. COORDINATE TERMINATION REQUIREMENTS WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH IN. PROVIDE GFI BREAKER.
- 2 INDOOR UNIT IS POWERED FROM OUTDOOR UNIT. COORDINATE WITH MECHANICAL CONTRACTOR.
- 3 PATIENT HEADWALL UNIT TO BE PROVIDED AT EACH BED LOCATION. REFER TO ARCHITECTURAL DETAILS. COORDINATE ELECTRICAL ROUGH-IN FOR HEADWALL CIRCUITS SERVING STANDARD AND RED COLORED RECEPTACLES. CIRCUITING ON PLAN IS SHOWN FOR HOMERUN DESIGNATIONS ONLY. REFER TO HEADWALL ELECTRICAL TYPICAL DETAIL ON THIS SHEET FOR ACTUAL DEVICE QUANTITIES AND CIRCUITING REQUIREMENTS.
- 4 PROVIDE 120V POWER TO SMOKE CURTAIN CEILING MOUNTED CONTROL PANEL AND CONNECT TO CONTROL SWITCHES ON WALL AT 48" A.F.F. CONFIRM INSTALLATION REQUIREMENTS WITH SMOKE CURTAIN MANUFACTURER PRIOR TO ROUGH IN. PROVIDE FIRE ALARM INTERFACE AS DIRECTED ON SPECIAL SYSTEMS PLANS.
- 5 PROVIDE POWER TO LIGHTS IN LANDSCAPE PLANTERS. CONFIRM FINAL LOCATION AND REQUIREMENTS WITH LANDSCAPE ARCHITECTS PRIOR TO INSTALL.
- 6 FOR IRRIGATION CONTROLLER, CONFIRM LOCATION WITH LANDSCAPE ARCHITECTS PRIOR TO INSTALL.

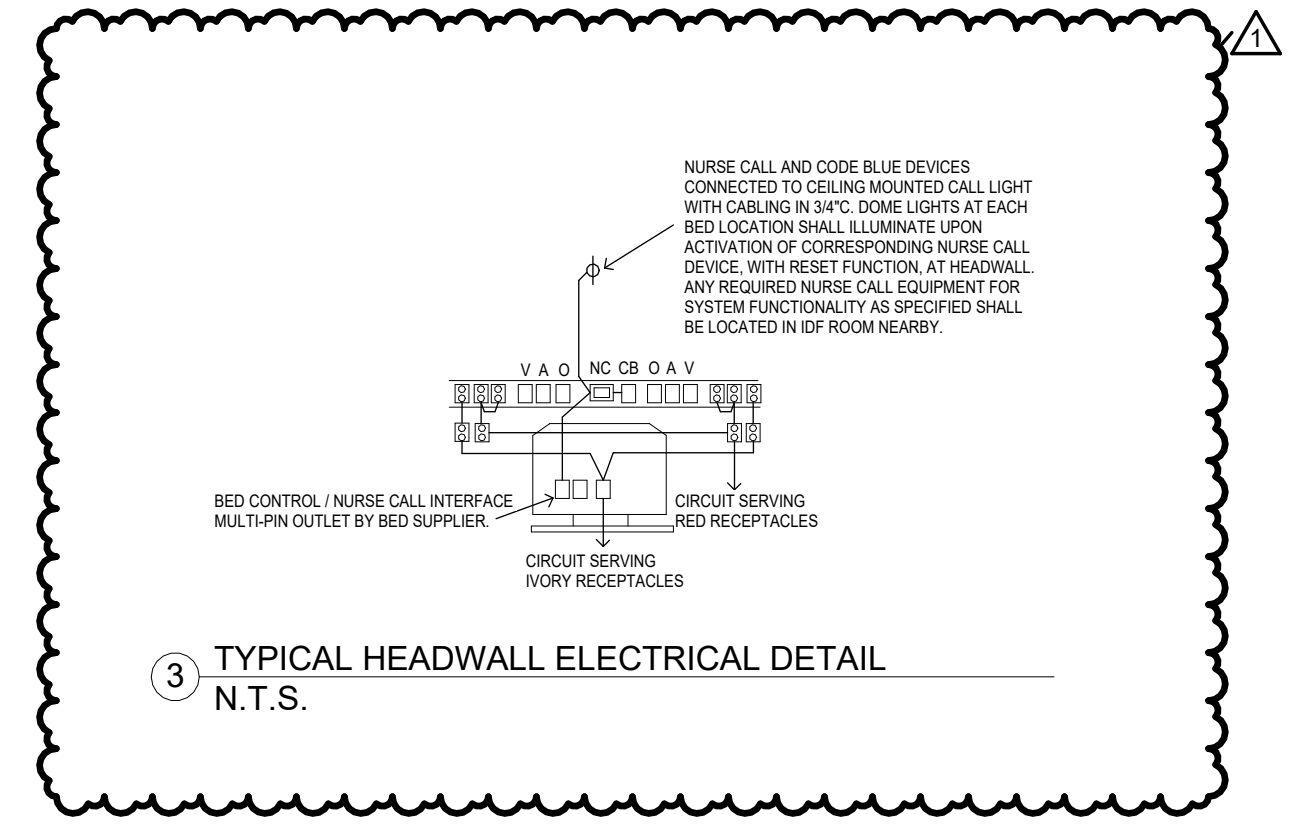

1 3RD FLOOR POWER PLAN
1/8" = 1'-0"

2 ENLARGED POWER PLAN - IDF 313A
1/4" = 1'-0"

