




THIS PLAN IS INCLUDED AS PART OF ALTERNATE NO. 3

GENERAL NOTES

KEYNOTES

GENERAL NOTES

1. THE CONTRACTOR SHALL PROVIDE A COMPLETE, UL CERTIFIED, ROOF COMPATIBLE LIGHTNING PROTECTION SYSTEM FOR THE OVERALL FACILITY AS APPROVED BY ARCHITECT AND/OR ENGINEER. THE SYSTEM SHALL BE INSTALLED BY A LIGHTNING PROTECTION CONTRACTOR ACTIVELY ENGAGED IN THE INSTALLATION OF UL MASTER LABEL SYSTEMS, IN ACCORDANCE WITH NFPA 780 AND THE MANUFACTURER'S RECOMMENDATIONS. THE CONTRACTOR SHALL HAVE A MINIMUM OF 5 YEARS EXPERIENCE IN LIGHTNING PROTECTION INSTALLATIONS.
2. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE AND ALL LOCAL CODES AND ORDINANCES.
3. INSTALL CONDUCTORS AND COMPLEMENTARY PARTS SO COMPLETED WORK IS UNOBTUSIVE AND DOES NOT DISTRACT FROM APPEARANCE.
4. BOND FULL SIZE CONDUCTOR TO ALL METAL OBJECTS ON ROOF. BOND ROOF DRAINS AS REQUIRED, LADDER HATCHES, MECHANICAL EQUIPMENT, ETC.
5. UPON COMPLETION OF THE JOB, THE CONTRACTOR SHALL FURNISH THE OWNER WITH A UL LETTER OF CERTIFICATION.
6. PROVIDE LIGHTNING PROTECTION AT GENERATOR LOCATION AND TIE INTO SYSTEM AS REQUIRED.
7. ROOF PENETRATIONS ARE PROHIBITED.
8. LIGHTNING PROTECTION SYSTEM COMPONENTS SHALL BE ALUMINUM UNLESS INDICATED OTHERWISE.
9. REFER TO ARCHITECTURAL PLANS, SECTIONS, AND ELEVATIONS TO DETERMINE EXACT LAYOUT OF LIGHTNING PROTECTION SYSTEM.

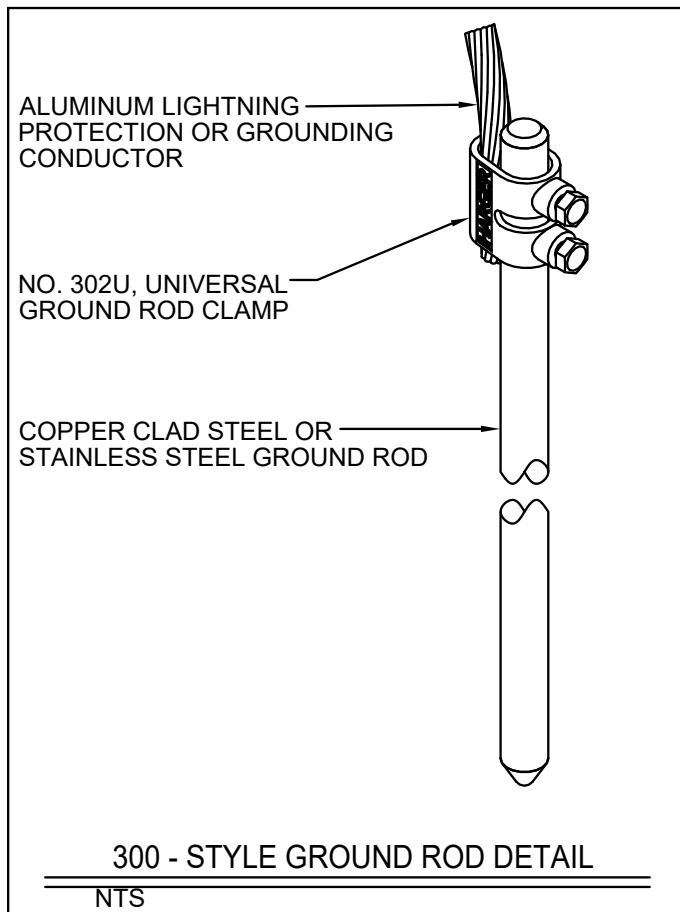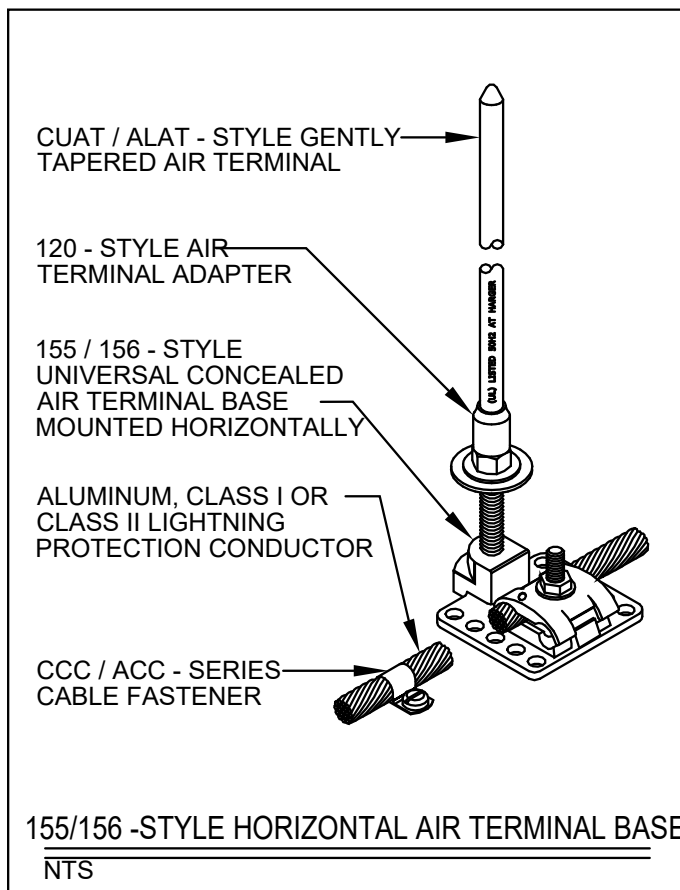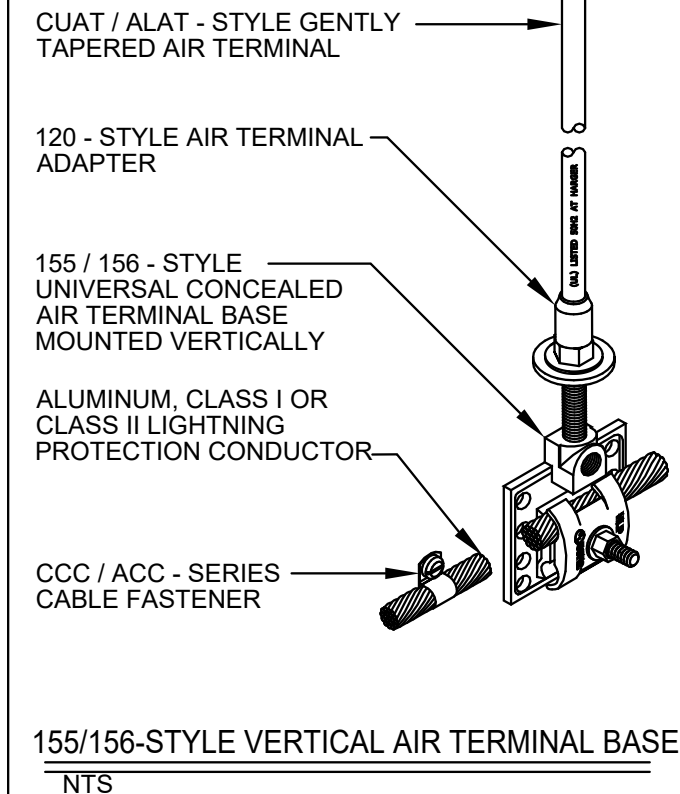

LEGEND

1 LIGHTING PROTECTION ROOF PLAN
1/8" = 1'-0"



ASSOCIATED DESIGN GROUP, INC.
3909 West Congress Street, Suite 201
Lafayette, Louisiana 70506
Phone: (337) 234-5710
Email: adginc@adginc.org

Project No. 24174

ASHE I BROUSSARD I WEINZETTLE
ARCHITECTS



CONSULTANTS
Monsieur Butler & Associates, LLC
CABO Landscape Architecture, LLC
Landscape Architecture
Fox Neale Engineering, Inc.
Structural
Sims O'Brien
Mechanical, Plumbing, Electrical
Associated Design Group, Inc.
Electrical
Specialty Architecture

ISSUE FOR BID
LOUISIANA STATE UNIVERSITY
ALEXANDRIA
DOWNTOWN HEALTH SERVICES CENTER
800 JACKSON ST.
ALEXANDRIA, LA 71301

PROJECT # 19-602-23-61 WBS: F:19002498
ARCH PROJECT # 2023.28 / 1531.00-23
SITE ID: NEW SITE CODE: 4-40-033
DATE October 10, 2025

Ashe Broussard Weinzettle Architects, LLP
Tipton Associates APAC, A Joint Venture
301 Jackson Street, Suite 205
Alexandria, LA 71301

NO. REVISION DATE
1 Addition #2 12/03/2025

KEYPLAN



LIGHTNING
PROTECTION PLAN -
ALTERNATE NO.3

E701R1