



EXISTING FLOOR PLAN
1/A1


DEMOLITION LEGEND:
--- WALLS AND DOORS TO BE REMOVED

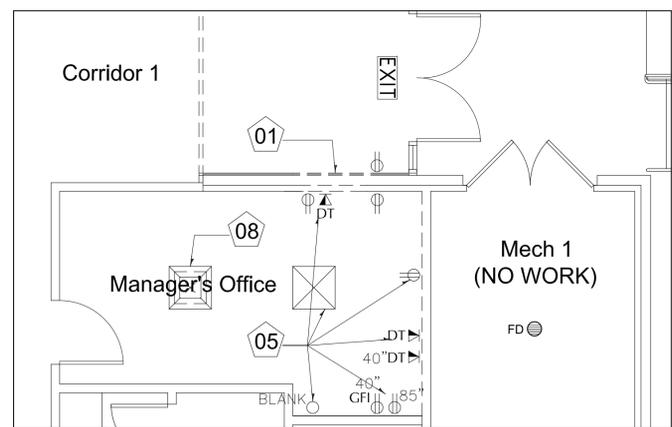

PARTIAL DEMOLITION PLAN
3/A1

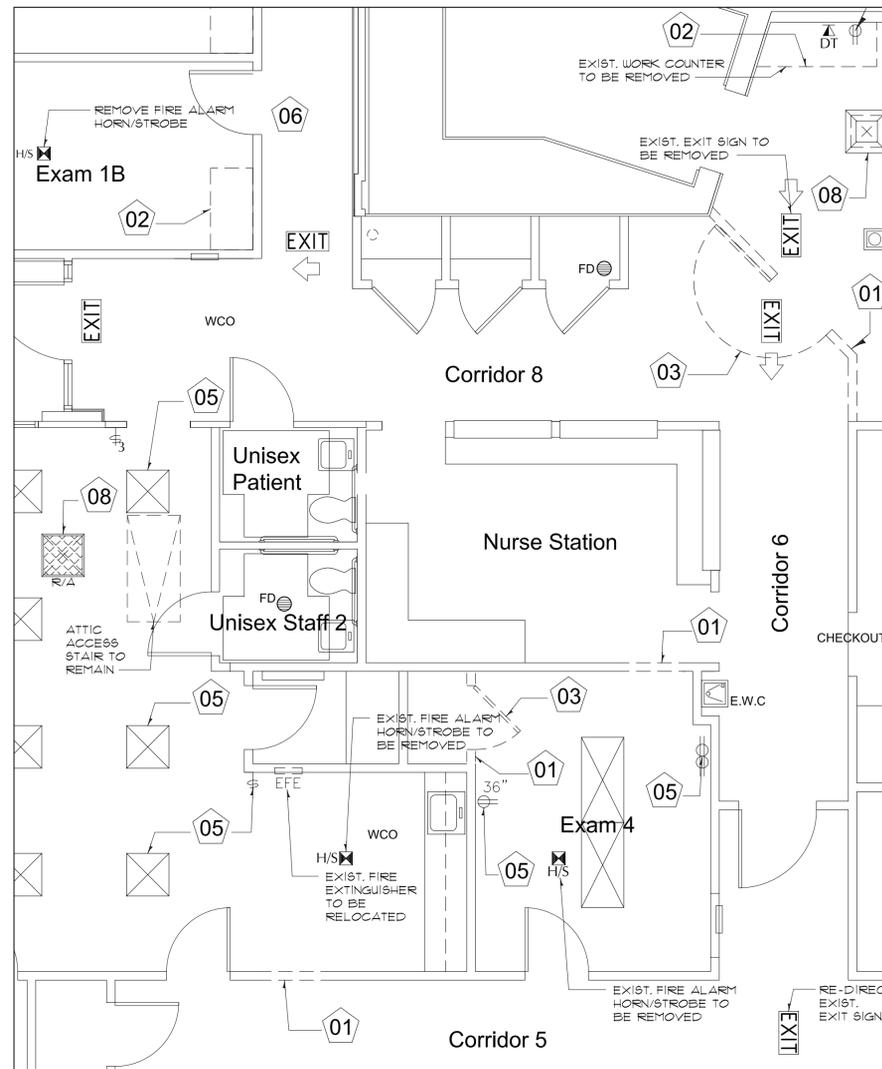


PARTIAL DEMOLITION PLAN
2/A1

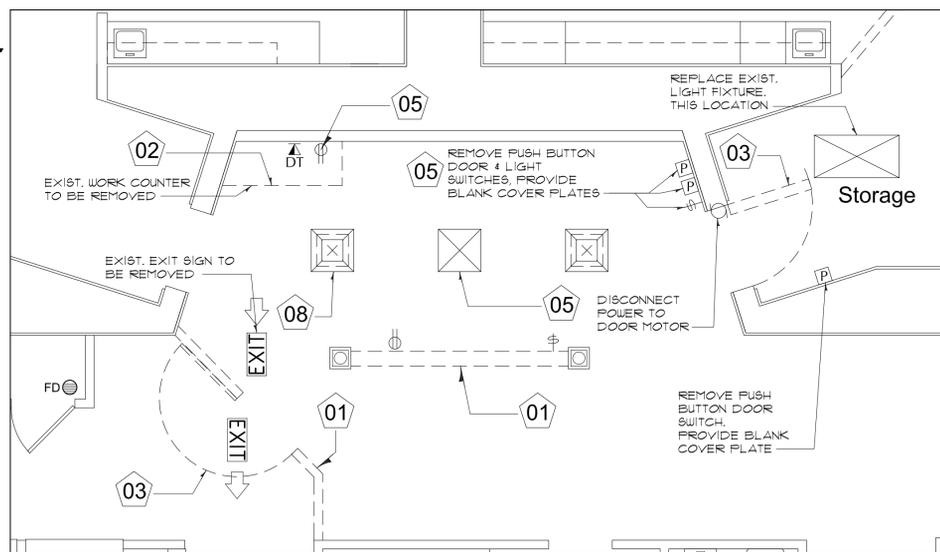

PARTIAL DEMOLITION PLAN
4/A1

ITEM CODE	Scope of Work
01	Remove existing wall for new construction.
02	Remove existing millwork.
03	Remove existing door.
04	Remove existing flooring at new construction. Prep surface for new finish (any new flooring).
05	Remove and or relocate existing light fixtures and devices where indicated. See electrical plan.
06	Trench concrete slab for new sewer lines
07	Refer to Renovation Work Notes on Sheet A2 for related work.
08	Remove or relocate existing A/C Supply / Return Air Grille - see Mechanical

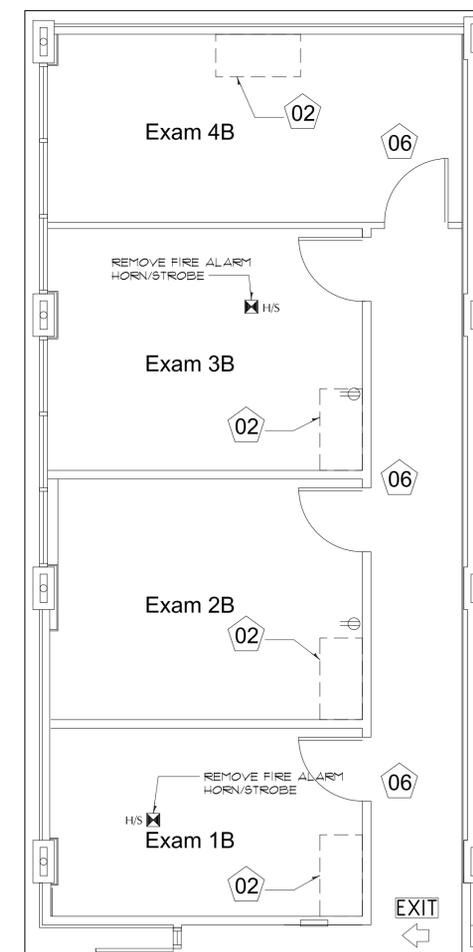

PARTIAL DEMOLITION PLAN
5/A1



Architects Alliance
of Acadiana (APAC)
1006 Creswell Ln., Opelousas, LA 70570
337-942-2678


RELOCATION OF:
WELLSMART HEALTH OF OPELOUSAS - RHC
627 E. PRUDHOMME STREET
OPELOUSAS, LOUISIANA 70570

DRAWINGS & SPECIFICATIONS AS SHOWN SHALL REMAIN THE PROPERTY OF THE ARCHITECT. ANY CHANGES OR MODIFICATIONS MADE TO THESE DRAWINGS SHALL BE THE RESPONSIBILITY OF THE ARCHITECT. NO PART OF THESE DRAWINGS SHALL BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT.

No.	Date	Revision	Remarks

Date: **12/18/25**
Job No.: **A25-08**

Sheet Number:
A1
1 of 5

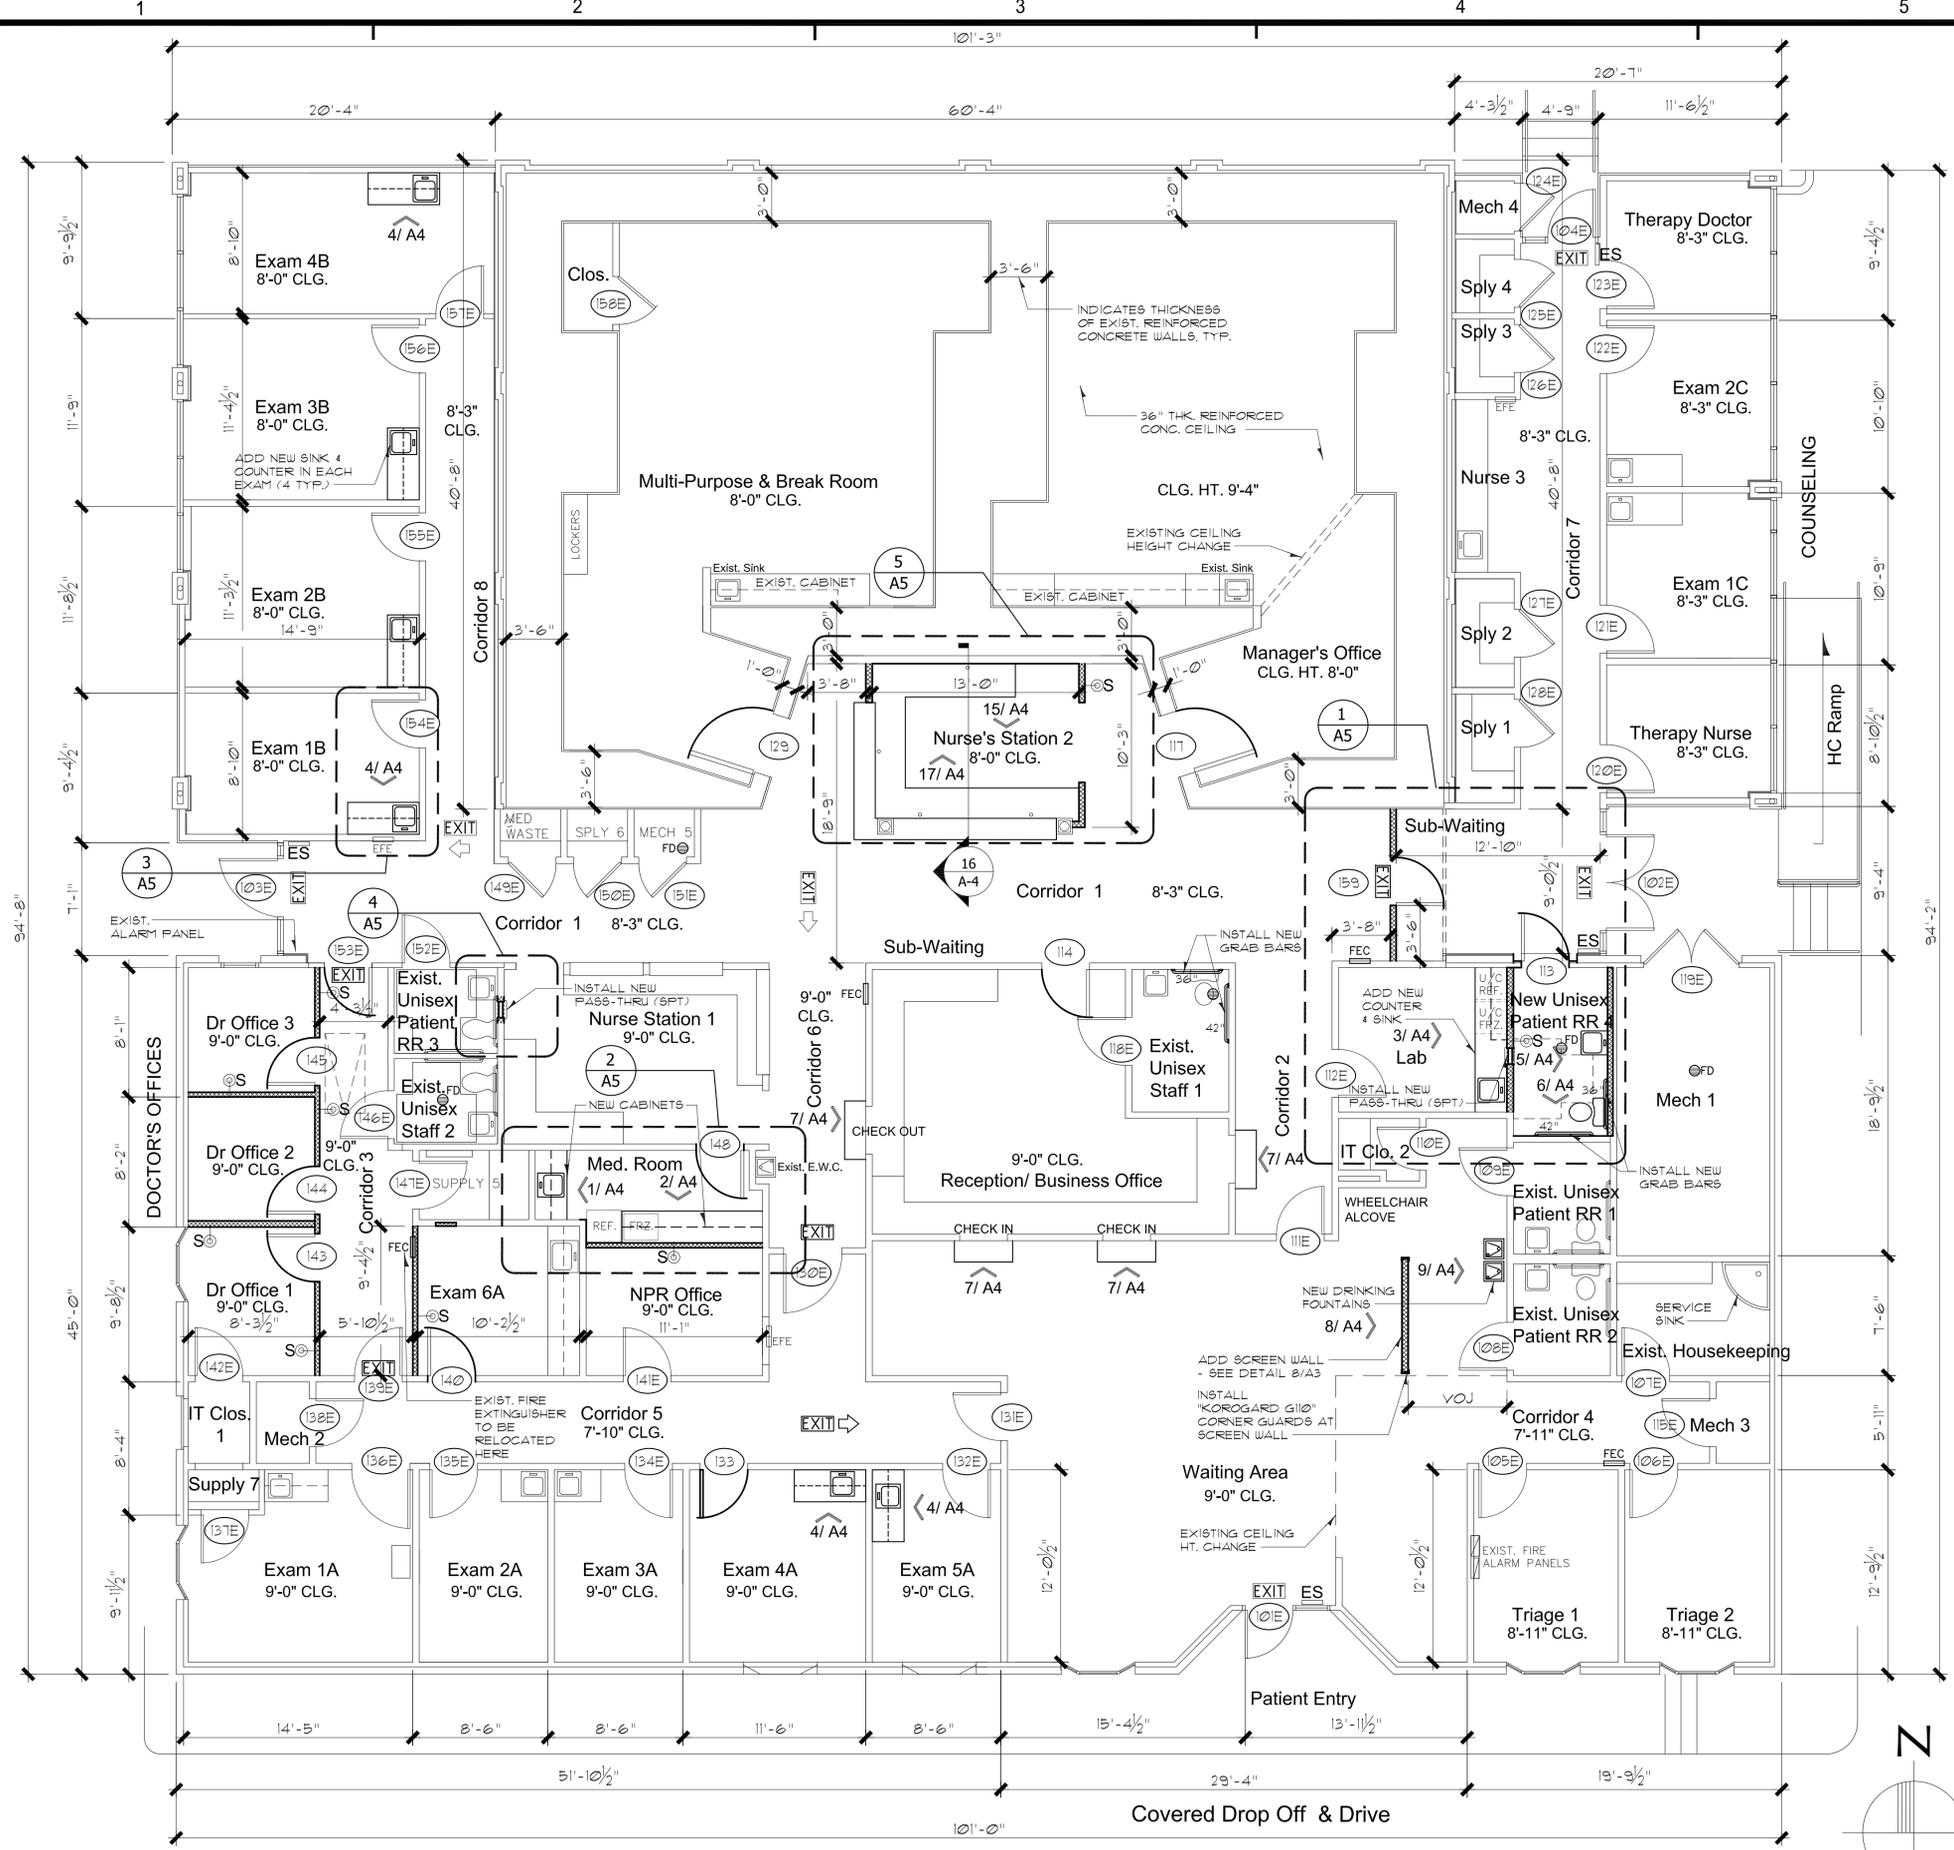

PLAN LEGEND:

- FIRE EXTINGUISHER**
- EFF EXISTING FIRE EXTINGUISHER IN CABINET TO REMAIN
 - FEC NEW 2A 10BC FIRE EXTINGUISHER IN SEMI-RECESSED METAL CABINET. MATCH EXISTING. INSTALL AT 48" ABOVE FINISH FLOOR IN CABINET- SEE SPECIFICATIONS.
- FLOOR DRAIN**
- FDO FLOOR DRAIN TO MEET CODE. PROVIDE 1/2" PRIMER TUBE TO FLOOR DRAIN FROM LAVATORY WASTE DRAIN PIPE.
- INSULATION:**
- S@ INSTALL SOUND INSULATION AS SPECIFIED AT NEW PARTITION
- SIGNAGE:**
- ROOM SIGNAGE - AS SELECTED AND PURCHASED BY OWNER - SEE DETAILS. ES PROVIDE LOW EXIT SIGN AT ALL EXTERIOR DOORS.
- RESTROOM ACCESSORIES**
- SD SOAP DISPENSER - (S.D.) - AS PROVIDED BY OWNER, INSTALLED BY CONTRACTOR.
 - PD PAPER TOWEL DISPENSER- (P.D.) - AS PROVIDED BY OWNER, INSTALLED BY CONTRACTOR.
 - TP TOILET PAPER DISPENSER- (T.P.) - AS PROVIDED BY OWNER, INSTALLED BY CONTRACTOR.
 - HD CHEMICAL HAND SANITIZER DISPENSER- (H.D.) - LOCATIONS AS REQUIRED BY INFECTION CONTROL RISK ASSESSMENT AND FUNCTIONAL PROGRAM. - PROVIDED BY OWNER, INSTALLED BY CONTRACTOR.
 - EC EMERGENCY CALL SWITCH (E.C.)
 - SPT SPECIMEN PASS-THRU- (S.P.T.) - FURNISHED AND INSTALLED BY CONTRACTOR.
- (FOR LOCATIONS - SEE ENLARGED PLANS ON PAGE A5)

RENOVATION WORK NOTES:

- DEMOLITION: REMOVE WALLS, DOORS & FRAMES, COUNTERS, AND ASSOCIATED ELECTRICAL DEVICES, WHERE INDICATED ON DRAWINGS. CUT AND TRENCH CONCRETE SLAB FOR NEW SANITARY SEWER LINES. REMOVE SIGNAGE THAT IS TO BE REPLACED. REMOVE AND CAP DUCTWORK THAT IS BEING RE-ROUTED TO RENOVATED ROOMS. REMOVE LIGHT FIXTURES AND OTHER CEILING MOUNTED DEVICES; RE-USE WHERE SHOWN IF SERVICEABLE AND APPROPRIATE.
- CONSTRUCT NEW INTERIOR DRYWALL PARTITIONS WHERE SHOWN ON FLOOR PLAN. SEE PARTITION SCHEDULE AND DETAILS.
- INSTALL NEW DOORS, FRAMES, AND HARDWARE WHERE INDICATED ON FLOOR PLAN AND IN DOOR SCHEDULE. SEE DOOR FRAME DETAILS. REPLACE EXISTING DOOR HARDWARE AS INDICATED IN DOOR SCHEDULE.
- PROVIDE AND INSTALL NEW MILLWORK AS SHOWN ON DRAWINGS.
- INSTALL NEW PLUMBING FIXTURES AS SHOWN ON DRAWINGS, INCLUDING EXTENDING HOT & COLD WATER LINES, SANITARY SEWER LINES, AND VENTING IN ACCORDANCE WITH THE INTERNATIONAL PLUMBING CODE. SEE PLUMBING SHEETS P1 & P2.
- INSTALL NEW & RE-LOCATE EXISTING LAY-IN LED LIGHT FIXTURES IN CEILING GRID WHERE SHOWN ON ELECTRICAL PLAN. ADD AND/OR RE-LOCATE SWITCHES. COORDINATE WITH HVAC AND OTHER TRADES. REPLACE/ADJUST CEILING GRID & CEILING TILE AS NECESSARY FOR LIGHT FIXTURES & A/C GRILLES.
- ARRANGE FOR INSTALLATION OF A NEW COMMUNICATION SYSTEM TO SERVE THE RENOVATED FACILITY WILL BE SELECTED AND PAID FOR BY OWNER UNDER SEPARATE CONTRACT.
- PROVIDE WALL BOXES AND EMPTY CONDUIT WITH PULL STRING TO ABOVE ACCESSIBLE CEILING FOR NEW DATA OUTLETS SHOWN ON ELECTRICAL PLANS. WIRING & DEVICES WILL BE FURNISHED AND INSTALLED BY OWNER.
- MODIFY EXISTING CHAIR RAILS AT CORRIDOR & SUB WAITING WHERE AFFECTED BY RENOVATION WORK.
- INSTALL/RE-LOCATE 120V CONVENIENCE OUTLETS AS SHOWN ON ELECTRICAL PLANS. VERIFY LOAD TO BE SERVED. WIRING TO BE IN ACCORDANCE WITH THE NEC. PROVIDE GFCI DEVICES AND BREAKERS WHERE REQUIRED BY THE NEC.
- RE-LOCATE AND/OR ADD FIRE ALARM SMOKE DETECTORS AND STROBES/HORN-STROBES AS NECESSARY TO COVER AREAS AFFECTED BY RENOVATION WORK. SUBMIT EXEMPTION REQUEST OR SHOP DRAWINGS TO FIRE MARSHAL FOR APPROVAL PRIOR TO MODIFYING THE FIRE-ALARM SYSTEM.
- REMOVE AND REPLACE EXISTING, NO LONGER APPLICABLE, INTERIOR & EXTERIOR SIGNAGE. NEW SIGNAGE TO MEET ADA-AG REQUIREMENTS. OWNER WILL SELECT NEW SIGNAGE. SEE DRAWINGS.
- PATCH FLOORING WHERE DAMAGED BY PLUMBING, TRENCHING, OR OTHER RENOVATION WORK. IF MATCHING FLOORING IS NOT AVAILABLE, REPLACE FLOORS THROUGHOUT ROOM.
- PAINT NEW WALLS, NEW DOORS, AND FRAMES. PAINT EXISTING WALLS IF DAMAGED AND IF NEW WALLS ARE WITHIN SAME SPACE. SEE PAINT SCHEDULE ON SHEET A3.
- AT MANAGER'S OFFICE- REMOVE CARPET & VINYL WALL COVERING. INSTALL NEW VCT FLOORING. PREP AND PAINT WALLS - SEE ELECTRICAL.

INTERIOR FINISHES

EXISTING & NEW TO MATCH EXISTING	
FLOORS	RESILIENT TILE & RESILIENT SHEET FLOORING
BASES	4" VINYL
WALLS	PAINTED GYPSUM BOARD
CEILINGS	2'x2' & 2'x4' SUSPENDED ACOUSTICAL TILE

PARTITION LEGEND:

(Solid line)	EXISTING TO REMAIN
(Dashed line)	NEW WALLS & PARTITION - SEE DETAIL 6/A5

RENOVATION FLOOR PLAN

1/A2



Architects Alliance
of Acadiana (APAC)
1006 Creswell Ln., Opelousas, LA 70570
337-942-2678 fax 337-942-2679

RELOCATION OF:
WELLSMART HEALTH OF OPELOUSAS - RHC
627 E. PRUDHOMME STREET
OPELOUSAS, LOUISIANA 70570

DATE: 12/18/25
JOB NO.: A25-08
SHEET NUMBER: A2

2 OF 5

DOOR & OPENING SCHEDULE


DOORS * DENOTES EXISTING DOORS TO RECEIVE NEW LEVER HANDLE OR ACCESSIBLE HARDWARE NEEDED, EXCEPT WHERE NOTED OTHERWISE											
NO.	SIZES	DOOR	FRAME	HARDWARE	DESCRIPTION	NO.	SIZES	DOOR	FRAME	HARDWARE	DESCRIPTION
100	3'-0" X 1'-0" PAIR 3'-0" X 1'-0" PAIR 3'-0" X 6'-8" 4'-0" X 1'-0" 3'-0" X 6'-8" 3'-0" X 6'-8" X 1-3/4" 3'-0" X 5'-8" 2'-8" X 6'-8"	ALUMINUM 4 GLASS W/ SIDELITE SC WD. FLUSH - 90 MIN. W/ 10X10 LIGHT SC WOOD FLUSH SC WOOD FLUSH W/ VERTLITE METAL RADIATION PROTECTED SC WOOD FLUSH IN IFT FRAME SC WOOD FLUSH - DUTCH DOOR EXTERIOR WOOD FLUSH	HOLLOW METAL ALUMINUM STOREFRONT LOUVERS	FLUSH / FULL LEVER KEY-LOCK PRIVACY LOCK KNOB CLOSER THUMB TURN ELECTRIC STRIKE FLUSH PAD DEADBOLT FLUSH BOLTS LATCH KEY PANIC HARDWARE PASSAGE HARDWARE		100	3'-0" X 1'-0" PAIR 3'-0" X 1'-0" PAIR 3'-0" X 6'-8" 4'-0" X 1'-0" 3'-0" X 1'-0" 3'-0" X 6'-8" 2'-8" X 5'-8" 2'-8" X 6'-8"	ALUMINUM 4 GLASS W/ SIDELITE SC WD. FLUSH - 90 MIN. W/ 10X10 LIGHT SC WOOD FLUSH SC WOOD FLUSH W/ VERTLITE METAL RADIATION PROTECTED SC WOOD FLUSH IN IFT FRAME SC WOOD FLUSH - DUTCH DOOR EXTERIOR WOOD FLUSH SC WD. FLUSH 45 MIN. "B" LABEL	HOLLOW METAL ALUMINUM STOREFRONT LOUVERS 45 MIN. "B" LABEL HOLLOW METAL FLUSH / FULL LEVER KEY-LOCK PRIVACY LOCK KNOB CLOSER THUMB TURN ELECTRIC STRIKE FLUSH PAD DEADBOLT FLUSH BOLTS LATCH KEY PANIC HARDWARE PASSAGE HARDWARE		
101E						131E					
102E						132E					
103E						133					REPLACE DUTCH DOOR WITH NEW SC FLUSH
104E						* 134E					REPLACE LOCKSET WITH LEVER TYPE
105E						* 135E					REPLACE LOCKSET WITH LEVER TYPE
106E						136E					
107E						137E					
108E						138E					
109E						* 139E					REPLACE LOCKSET WITH LEVER TYPE
110E						140					NEW DOOR
111E						141E					
112E						142E					
113					NEW DOOR	143					NEW DOOR
114					NEW DOOR	144					NEW DOOR
115E						145					NEW DOOR
116					NEW DOOR	* 146E					REPLACE LOCKSET WITH LEVER TYPE
117					(11) - REMOVE EXIST. ELEC. RADIATION PROTECTION OPERATED DOOR - INSTALL NEW DOOR 4 HARDWARE AS SCHEDULED	* 147E					REPLACE LOCKSET WITH LEVER TYPE
118E						148					NEW DOOR
119E						149E					
120E						150E					
121E						151E					
122E						152E					
123E						153E					
124E						154E					
125E						155E					
126E						156E					
127E						157E					
128E						158E					
129					NEW DOOR	159					NEW DOOR W/ 5'X24" GLASS LITE 4 ELECTRIC STRIKE W/ BADGE SWIPE ACTIVATOR.
130E											

DOOR 4 HARDWARE NOTES:
 1. ALL NEW DOOR HARDWARE TO MEET ADA ACCESSIBILITY STANDARDS.
 2. NOT USED
 3. NEW HARDWARE TO MATCH STYLE AND FINISH OF EXISTING HARDWARE.
 4. KEYING SHALL BE AS DIRECTED BY OWNER.

5. ADJUST, REPAIR, AND REPLACE EXISTING HARDWARE THAT FAILS TO FUNCTION PROPERLY.
 6. BEFORE ORDERING NEW DOORS AND FRAMES, VERIFY EXISTING OPENING SIZES 4 CONDITIONS, AND ADJUST SCHEDULED DOORS AS NECESSARY.
 7. ALL NEW WOOD DOORS ARE TO BE SOLID CORE, 1-3/4" THK, FLUSH, VENEER 4 FINISH TO MATCH EXISTING.

8. EVERY LOCK SHALL BE OPERABLE FROM INSIDE THE ROOM OR AREA.
 9. ELECTRIC STRIKE, ACTIVATOR, AND COMPONENTS FOR DOOR #59 TO BE COMPATIBLE WITH OWNERS SECURITY SYSTEM. DOOR SHALL ALWAYS BE OPERABLE FROM EGRESS SIDE. INSTALLER SHALL BE LICENSED BY THE LOUISIANA STATE FIRE MARSHALL, AND SHALL BE RESPONSIBLE FOR SUBMITTALS 4 APPROVALS FROM THE STATE FIRE MARSHALL.

PAINING SCHEDULE:
 (NEW UN-PAINTED SURFACES)
 GYPSUM BOARD WALLS: 1 COAT SW MULTI-PURPOSE INTERIOR/EXTERIOR LATEX PRIMER; 2 COATS SW SUPER PAINT INTERIOR ACRYLIC LATEX, EGGSHELL.
 FERROUS METAL (DOOR FRAMES, ETC.): 1 COAT SW KEM KROMIK METAL PRIMER; 2 COATS SW PRO MAR 200 ALKYD, SEMI-GLOSS.
 WOOD DOORS: 1 COAT SW OIL STAIN (TO MATCH EXISTING DOORS); 2 COATS SW SATIN POLYURETHANE VARNISH.
 (EXISTING PAINTED SURFACES REQUIRING NEW PAINT FOR COLOR MATCH: 1 OR 2 TOP COATS OF ABOVE SPECIFIED PAINT AS REQUIRED FOR COMPLETE HING.)

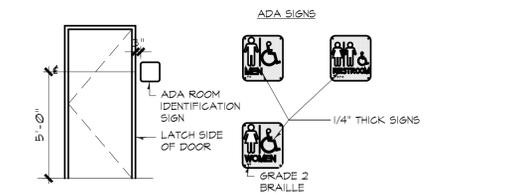

- NOTES**
- CHARACTERS AND SYMBOLS SHALL CONTRAST WITH THEIR BACKGROUND.
 - PROVIDE ROOM IDENTIFICATION SIGN ON LATCH SIDE OF DOOR.
 - LETTERS 4 NUMBERS ON SIGNS SHALL BE RAISED 1/32" MIN. SHALL BE A MIN. OF 5/8" HIGH 4 SHALL BE SANS-SERIF UPPERCASE CHARACTERS ACCOMPANIED BY GRADE 2 BRAILLE.

TYPICAL ADA SIGNAGE DETAIL

NTS



Architects Alliance
 of Acadiana (APAC)
 1006 Creswell Ln., Opelousas, LA 70570
 337-942-2678 fax 337-942-2679

RELOCATION OF:
WELLSMART HEALTH OF OPELOUSAS - RHC
 627 E. PRUDHOMME STREET
 OPELOUSAS, LOUISIANA 70570

DRAWINGS & SPECIFICATIONS AS SHOWN SHALL REMAIN THE PROPERTY OF THE ARCHITECT. ANY REVISIONS OR NOTICES ARE NOT TO BE USED BY THE ARCHITECT WITHOUT THE APPROPRIATE COMPENSATION TO THE ARCHITECT.

No.	Date	Revision/Remarks

Date: **12/18/25**
 Job No.: **A25-08**
 Sheet Number:
A3
 3 of 5

A

B

C

D

E


A

B

C

D

E

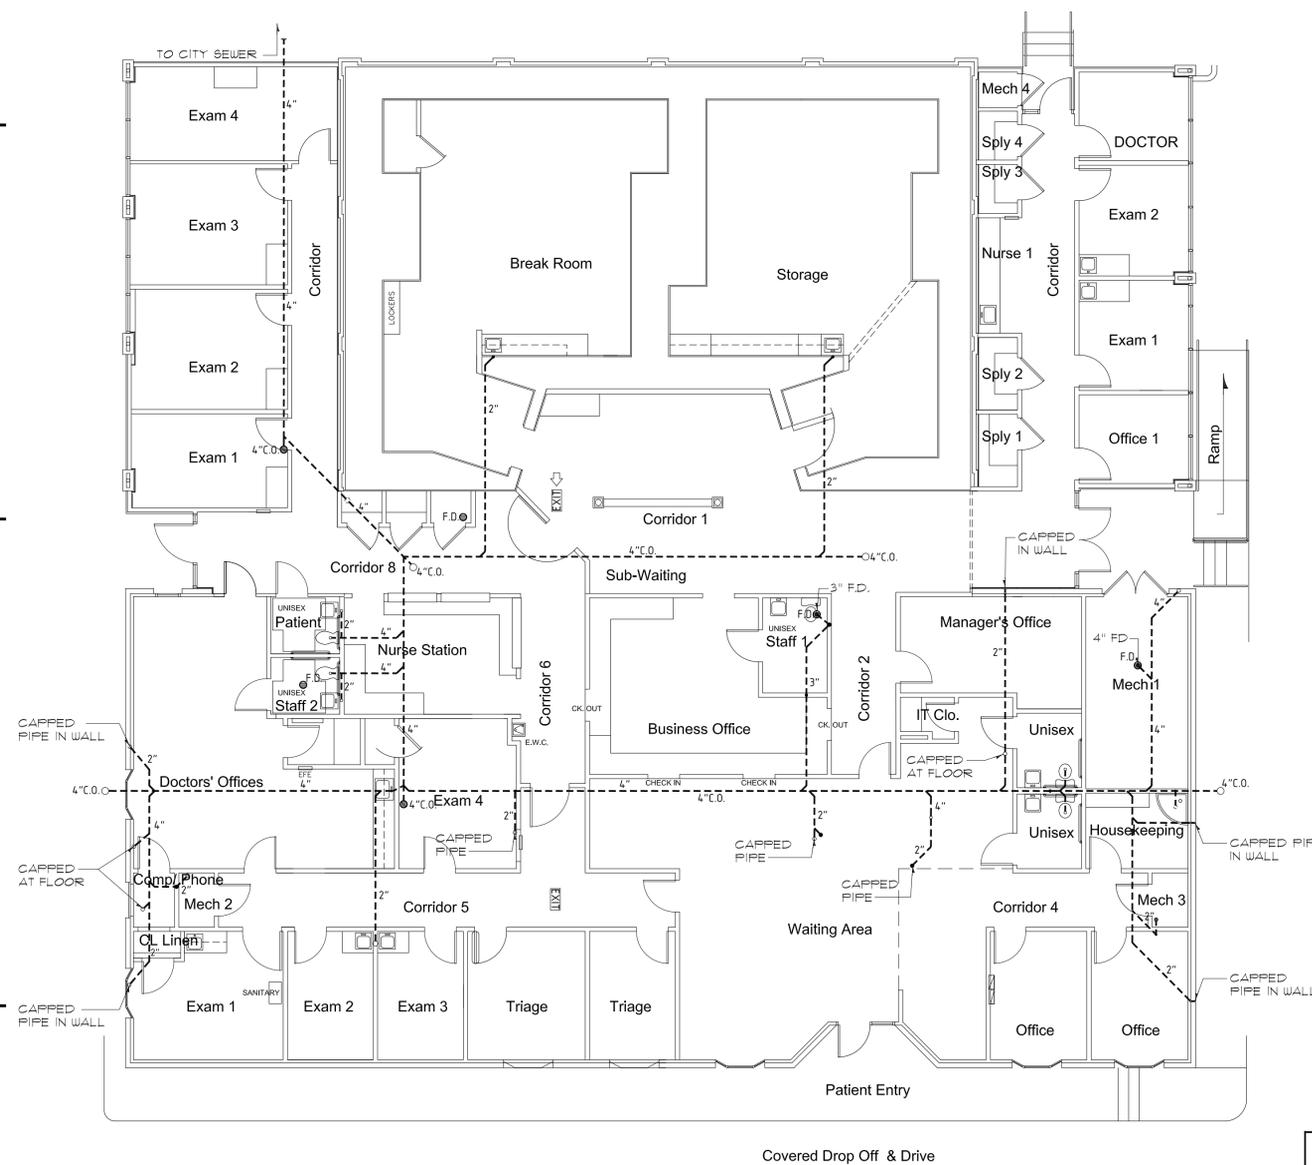

EXISTING PLUMBING PLAN
1 / P1

1/8"

PLUMBING LEGEND:

- EXISTING SANITARY SEWER LINE
- NEW SANITARY SEWER LINE
- #" SIZE OF PIPE

NEW PLUMBING PLAN
2 / P1 - SEE ENLARGED PLANS SHEET P2

1/8"



Architects Alliance
of Acadiana (APAC)
1006 Creswell Ln., Opelousas, LA 70570
337-942-2678 fax 337-942-2679

RELOCATION OF:
WELLSMART HEALTH OF OPELOUSAS - RHC
627 E. PRUDHOMME STREET
OPELOUSAS, LOUISIANA 70570


DRAWINGS & SPECIFICATIONS AS SHOWN SHALL REMAIN THE PROPERTY OF THE ARCHITECT. NO PART OF THESE DRAWINGS OR NOTICES ARE TO BE REPRODUCED OR EXTENDED TO THIS PROJECT EXCEPT BY THE ARCHITECT'S WRITTEN PERMISSION TO THE ARCHITECT.

No.	Date	Revision	Remarks

Date: **12/18/25**
Job No.: **A25-08**
Sheet Number: **P1**
1 of 2


PLUMBING NOTES

1. PROVIDE COMPLETE AND OPERATING DRAIN, VENT AND WATER (HOT AND COLD) SYSTEMS FOR NEW WORK IN PROJECT.
2. MATERIALS AND WORKMANSHIP TO CONFORM TO THE INTERNATIONAL PLUMBING CODE, LOUISIANA SANITARY CODE, AND THOSE AUTHORITIES HAVING JURISDICTION.
3. ARRANGE AND PAY ALL PERMITS, DEPOSITS, CONNECTIONS, EXTENSIONS, FEES AND INSPECTIONS AS REQUIRED BY AUTHORITIES HAVING JURISDICTION.
4. SEWER AND DRAIN LINES ABOVE GRADE AND BELOW SLAB TO BE SCHEDULE 40. ALL SLOPES CONTINUOUS, 1/8" PER FOOT 4" AND LARGER, 1/4" PER FOOT 3" AND SMALLER, PVC SCHEDULE 40 FOR VENTS.
5. WATER LINES, TYPE L HARD OR SOFT DRAIN COPPER. ALL JOINTS SILVER SOLDERED, OR AT PLUMBER'S OPTION, PEX TUBING WHERE PERMITTED BY CODE, 200 P.S.I. TEST, NO JOINTS UNDER SLAB PERMITTED.
6. INSULATE EXPOSED SINK AND LAVATORY P-TRAPS AND H.W. LINES WITH TRUEBRO KIT, INSULATE ALL OTHER HOT WATER LINES WITH 1/2" TH. ARMAFLEX. INSULATE COLD WATER LINES IN ATTIC WITH 1/2" TH. ARMAFLEX.
7. PROVIDE SLEEVES FOR ALL PIPES PASSING THROUGH WALLS AND FLOORS.
8. INSTALL 12" H. AIR CHAMBER AT EACH FIXTURE OR GROUP OF FIXTURES; 3/4" PIPE.
9. CONNECT VENTS (V) TO NEAREST VENT THROUGH ROOF, IF AVAILABLE (VTR). NEW VENT THAT PENETRATE ROOF SHALL BE FLASHED WITH LEAD OR OTHER CODE APPROVED MATERIAL BY A QUALIFIED ROOFER.
10. NOT USED.
11. FLOOR DRAINS SHALL INCLUDE A P-TRAP PRIMER LINE CONNECTED TO LAVATORY P-TRAP AND ROUTE 3/8" WATER LINE FROM LAVATORY P-TRAP DOWN INSIDE WALL AND UNDER SLAB TO FLOOR DRAIN.
12. CUT OFF VALVES TO BE INSTALLED AT ALL SINKS, TOILETS, LAVATORIES, AND ELECTRIC WATER COOLER.
13. VENT PIPING SHALL TERMINATE VERTICALLY NOT LESS THAN 6" ABOVE THE ROOF SURFACE AND NOT LESS THAN 1' FROM ANY VERTICAL SURFACE, 10' FROM AND 3' ABOVE A WINDOW DOOR OR AIR INTAKE OR LESS THAN 10' FROM A HOT LINE, CONFORM TO THE STATE AND LOCAL PLUMBING AND BUILDING CODE.
14. ALL PLUMBING LINES SHALL BE RUN CONCEALED.
15. TEST ALL NEW PLUMBING WORK PER LOCAL CODE REQUIREMENTS.

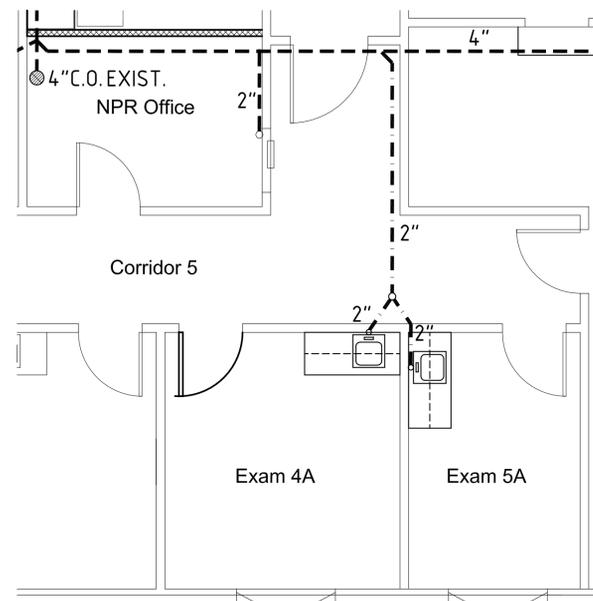


**PARTIAL PLUMBING PLAN
- EXAM 4A & EXAM 5A**

1 / P2

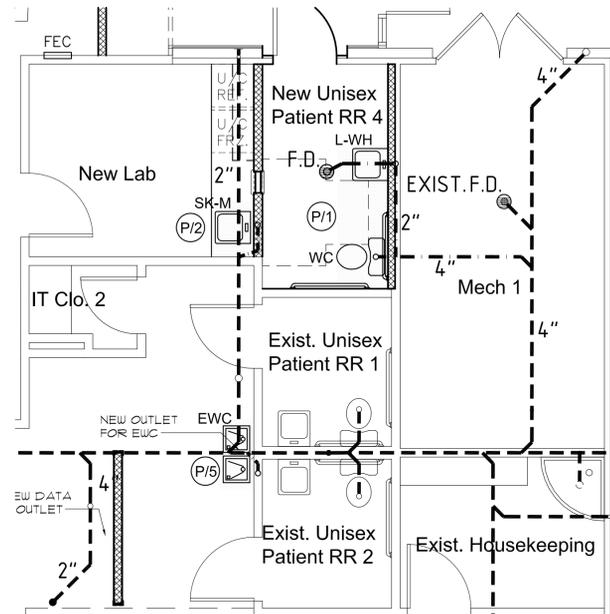


**PARTIAL PLUMBING PLAN
- NEW RSTRM**

2 / P2

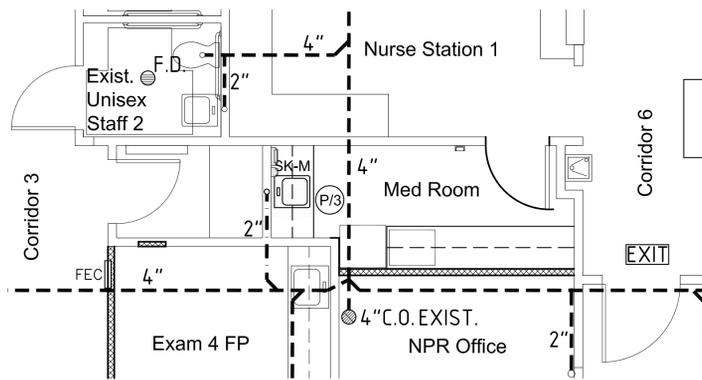


**PARTIAL PLUMBING PLAN
- NEW MEDICAL ROOM**

3 / P2

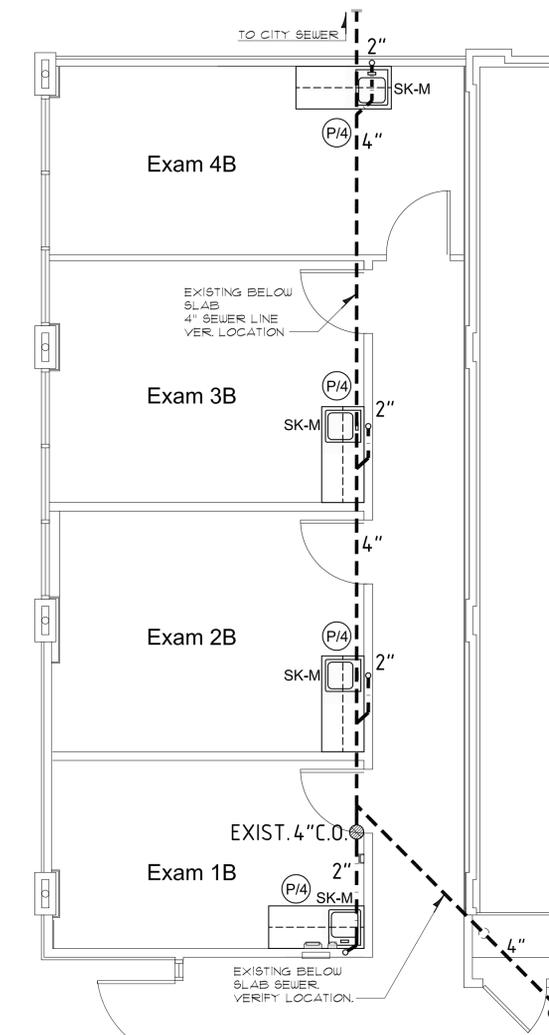

**PARTIAL PLUMBING PLAN
- NEW EXAM ROOMS**

4 / P2

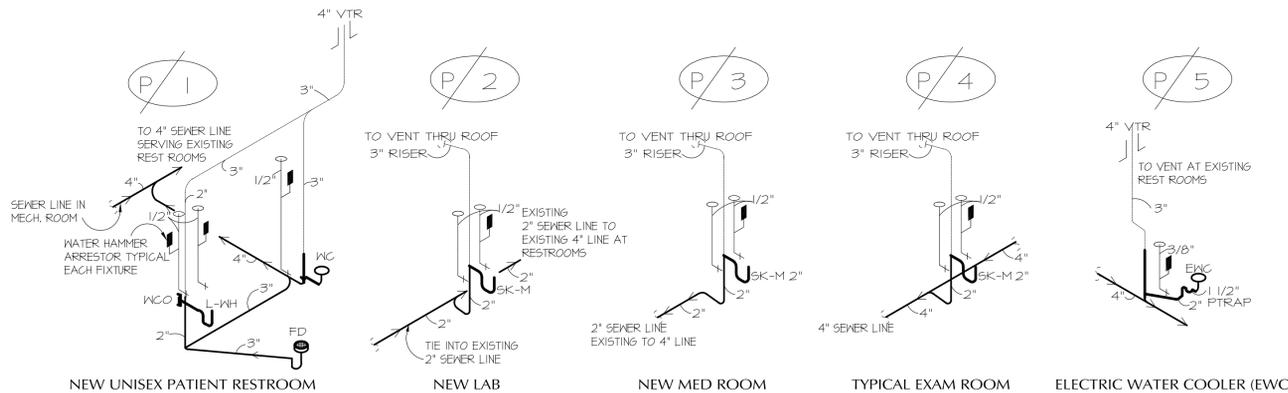

PLUMBING RISER DIAGRAM

4 / P2

NEW PLUMBING FIXTURE SCHEDULE							
LABEL	FIXTURE TYPE	MANUFACTURER	PIPE CONNECTION				SPECIFICATION
			C.W.	H.W.	WASTE	VENT	
FD	FLOOR DRAIN	WADE			3"	2"	WADE 1100STD: CAST IRON FLOOR DRAIN W/ FLANGE, INTEGRAL CLAMPING COLLAR, SEEPAGE OPENING, ADJUSTABLE 6" DIA. NICKEL BRONZE STRAINER W/ SQUARE PERFORATIONS, P-TRAP.
HD	HUB DRAIN	PROVIDE SURESEAL MODEL SS2009V			2"	2"	DRAIN TRAP SEALER FOR 2" DIAMETER CONDENSATE HUB DRAIN.
L-WH	LAVATORY	KOHLER K-1729, AMERICAN STANDARD 0124.131	1/2"	1/2"	2"	2"	KOHLER K-2030: WHITE VITREOUS CHINA WALL HUNG LAVATORY WITH 8" CENTERS. T&S B-2867-04FC WIDESPREAD GOOSENECK FAUCET WITH QUARTER-TURN CERAMIC DISC VALVES, 4" WRIST BLADE HANDLES, K-7715 GRID DRAIN W/ PERFORATED STRAINER & TAILPIECE, 1-1/4" 17 GA. P-TRAP WITH CLEANOUT AND 3/8" ANGLE SUPPLIES WITH STOPS, PROVIDE CONCEALED ARM FLOOR MOUNTED CARRIER, INSULATE P-TRAP, HOT AND COLD WATER SUPPLIES WITH TRUEBRO 102 LAVGUARD, MOUNT AT ADA HEIGHT, PROVIDE WATTS LFUSG-B-M2 THERMOSTATIC MIXING VALVE UNDER SINK.
SK-M	SINK	ELKAY - CELEBRITY STAINLESS STL. - 15 X 15 X 6-1/8	1/2"	1/2"	2"	2"	DECK MOUNTED, CHROME, 15" X 15" X 6.125", SINGLE COMPARTMENT, 20 GAUGE, TYPE 304 STAINLESS STEEL, SELF RIMMING SINK WITH 8" FAUCET CENTERS, ZURN Z831B4-XL-18F (T & S BRASS B-2867-04 WITH B-0199-21, A.S. 6530.170.LV15.002) 5-3/8" REACH RIGID GOOSENECK FAUCET WITH LAMINAR FLOW AND 4" WRIST BLADE HANDLES, LK-18B PERFORATED 3" GRID STRAINER, MCGUIRE 8912 1-1/2" CAST BRASS P-TRAP WITH CLEANOUT PLUG AND 3/8" ANGLE SUPPLIES WITH STOPS, CAULK AROUND PERIMETER OF FIXTURE.
WC	WATER CLOSET	KOHLER OR AMERICAN STANDARD	1/2"		4"	3"	KOHLER K-25077-RA-0: 16-1/2" HIGH, WHITE, VITREOUS CHINA TWO-PIECE ELONGATED TOILET, 1.28 GAL FLUSH TOILET TANK, LEVER HANDLE AND BOLT CAPS, CENTOCO 500CCSS WHITE OPEN FRONT SEAT LESS COVER WITH STAINLESS STEEL CHECK HINGES. INSTALL AS PER ADA REQUIREMENTS. INSTALL FLUSH HANDLE ON WIDE SIDE OF ROOM. INSTALL WAX SEAL BELOW FIXTURE. CAULK AROUND PERIMETER OF FIXTURE.
EWC	ELECTRIC WATER COOLER	ELKAY	1/2"		2"	2"	ELKAY VRCTL8SC: TWO-STATION, FLUSHED WALL-MOUNT WATER COOLER WITH BOTTLE FILLER, VANDAL-RESISTANT, BARRIER-FREE ACCESS. SELF-CONTAINED, DOUBLE WALL HUNG ELECTRIC REFRIGERATED, WATER COOLER. STAINLESS STEEL CONSTRUCTION WITH BUILT-IN FLOW REGULATOR, TOUCHLESS, SENSOR ACTIVATION BOTTLE FILLER WITH EASY-TO-OPERATE PUSH-BAR ACTIVATION, HEAVY DUTY PUSH BUTTON CONTROL, ADA COMPLIANT, CERTIFIED LEAD-FREE. STRAINER WITH AN EASILY CLEANABLE SCREEN, VISUAL FILTER WITH LED FILTER STATUS INDICATOR, 120 VOLT, 575 RATED WATTS, GPH OF 50°F, ROOM TEMPERATURE OF 70°F MOTOR COMPRESSOR: HERMETICALLY SEALED, RECIPROCATING TYPE. CONDENSER: FAN COOLED, COPPER TUBE WITH ALUMINUM FINS. ENCLOSED ADJUSTABLE THERMOSTAT. LAMINATED FLOW PROVIDES CLEAN FILL WITH MINIMAL SPLASH. 5 YEAR LIMITED WARRANTY, LISTED BY UNDERWRITERS LABORATORIES INC.



Architects Alliance
of Acadiana (APAC)
1006 Creswell Ln., Opelousas, LA 70570
337-942-2678 fax 337-942-2679


RELOCATION OF:
WELLSMART HEALTH OF OPELOUSAS - RHC
627 E. PRUDHOMME STREET
OPELOUSAS, LOUISIANA 70570

Drawings & Specifications as shown shall remain the property of the Architect. No part of these drawings or specifications shall be used for any other project without the written consent of the Architect.

No.	Date	Revision	Remarks

Date: **12/18/25**
Job No.: **A25-08**


Sheet Number:
P2
2 of 2

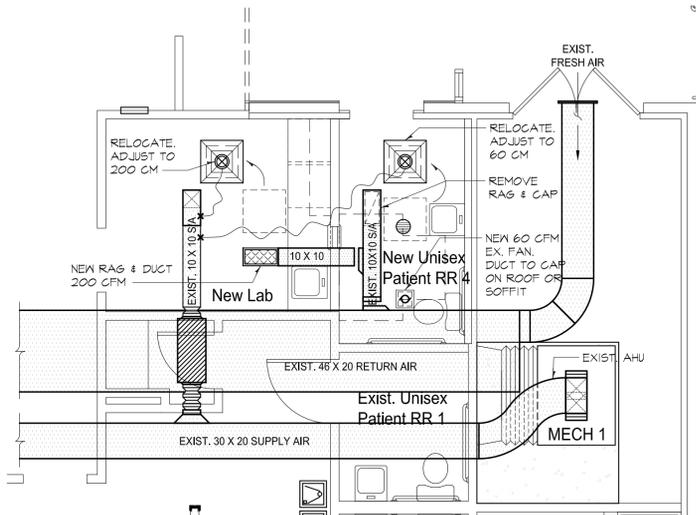

**PARTIAL MECHANICAL PLAN
- NEW RESTROOM & LAB**

1 / M1


1/4"

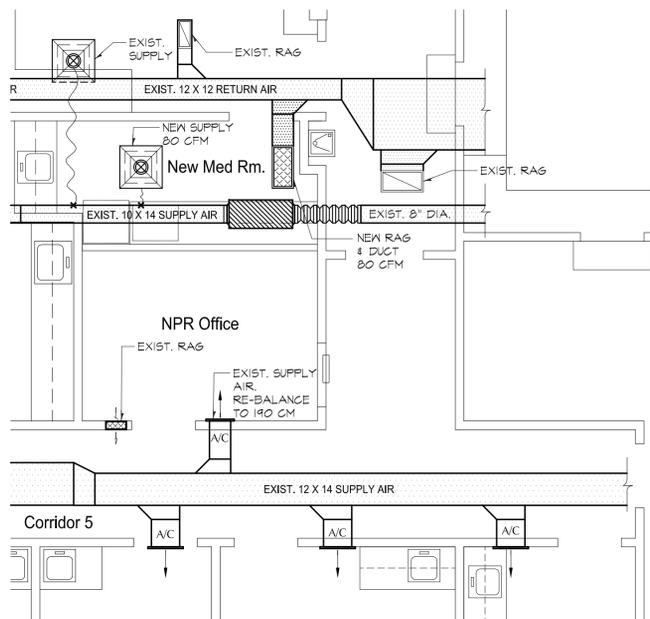

**PARTIAL MECHANICAL PLAN
- MED ROOM & NPR OFFICE**

2 / M1


1/4"

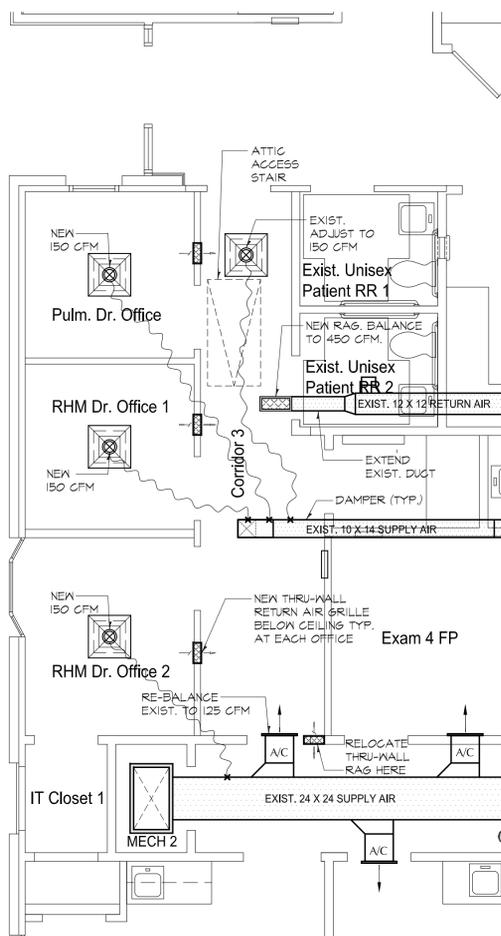

**PARTIAL MECHANICAL PLAN
- DOCTORS OFFICES**

3 / M1

1/4"

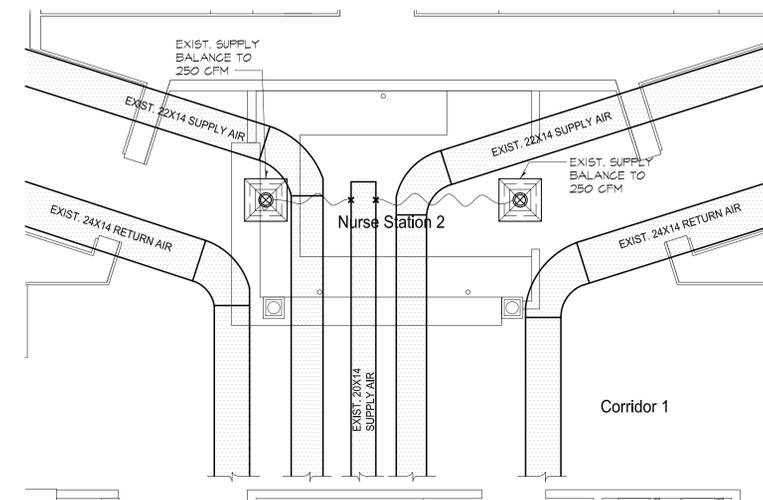

**PARTIAL MECHANICAL PLAN
- NURSE STATION 2**

4 / M1

1/4"

MECHANICAL NOTES:


- HEATING & COOLING:**
1. PROVIDE ALL HVAC MATERIALS & LABOR TO COMPLETE THE WORK SHOWN ON THE PARTIAL MECHANICAL PLANS FOR THIS RENOVATION PROJECT. VERIFY ALL EXISTING CONDITIONS PRIOR TO BIDDING & COMMENCING WORK.
 2. ALL NEW MECHANICAL WORK SHALL BE IN ACCORDANCE WITH THE INTERNATIONAL MECHANICAL CODE, NFPA 90A, NFPA 101, AND LOCAL CODE REQUIREMENTS.
 3. DUCTS IN UNCONDITIONED SPACES SHALL BE INSULATED TO R-8.
 4. SEAL AND MECHANICALLY FASTEN DUCT CONNECTIONS TO FLANGES OF AIR DISTRIBUTION SYSTEM EQUIPMENT OR SHEET METAL FITTINGS.
 5. ALL JOINTS, SEAMS, AND CONNECTIONS SHALL BE MADE SUBSTANTIALLY AIRTIGHT WITH TAPES, GASKETING, MASTICS (ADHESIVES) OR OTHER APPROVED CLOSURE SYSTEMS. TAPES & MASTICS RATED UL 181A OR UL 181B.
 6. BUILDING FRAMING CAVITIES SHALL NOT BE USED AS SUPPLY DUCTS.
 7. INSTALL AUTOMATIC GRAVITY DAMPERS ON ALL EXHAUST DUCT TERMINATIONS.
 8. TAPE SEALING AND METAL DUCT CRIMPING SHALL COMPLY WITH THE INTERNATIONAL MECHANICAL CODE.
 9. EXHAUST VENTS SHALL BE A MINIMUM OF 10 FEET FROM FRESH AIR INTAKES.
 10. WHERE SIZES ARE NOT INDICATED, A/C CONTRACTOR TO SIZE THE DUCT, REGISTER OR AIR DIFFUSER FOR THE CFM INDICATED IN ACCORDANCE WITH THE LATEST SMACNA DESIGN MANUAL.
 11. DIFFUSERS, GRILLES, ETC. SHALL MATCH STYLE & COLOR OF EXISTING.
 12. UPON COMPLETION OF INSTALLING THE DUCTS AND AIR DISTRIBUTION DEVICES, TEST AND BALANCE THE NEW & EXISTING SYSTEM INCLUDING THE PNEUMATIC CONTROL SYSTEM. PROVIDE A WRITTEN REPORT OF THE TAB RESULTS.



Architects Alliance
of Acadiana (APAC)
1006 Creswell Ln., Opelousas, LA 70570
337-942-2678 fax 337-942-2679

RELOCATION OF:
WELLSMART HEALTH OF OPELOUSAS - RHC
627 E. PRUDHOMME STREET
OPELOUSAS, LOUISIANA 70570


DATE: **12/18/25**
JOB NO.: **A25-08**
SHEET NUMBER: **M1**
1 OF 1

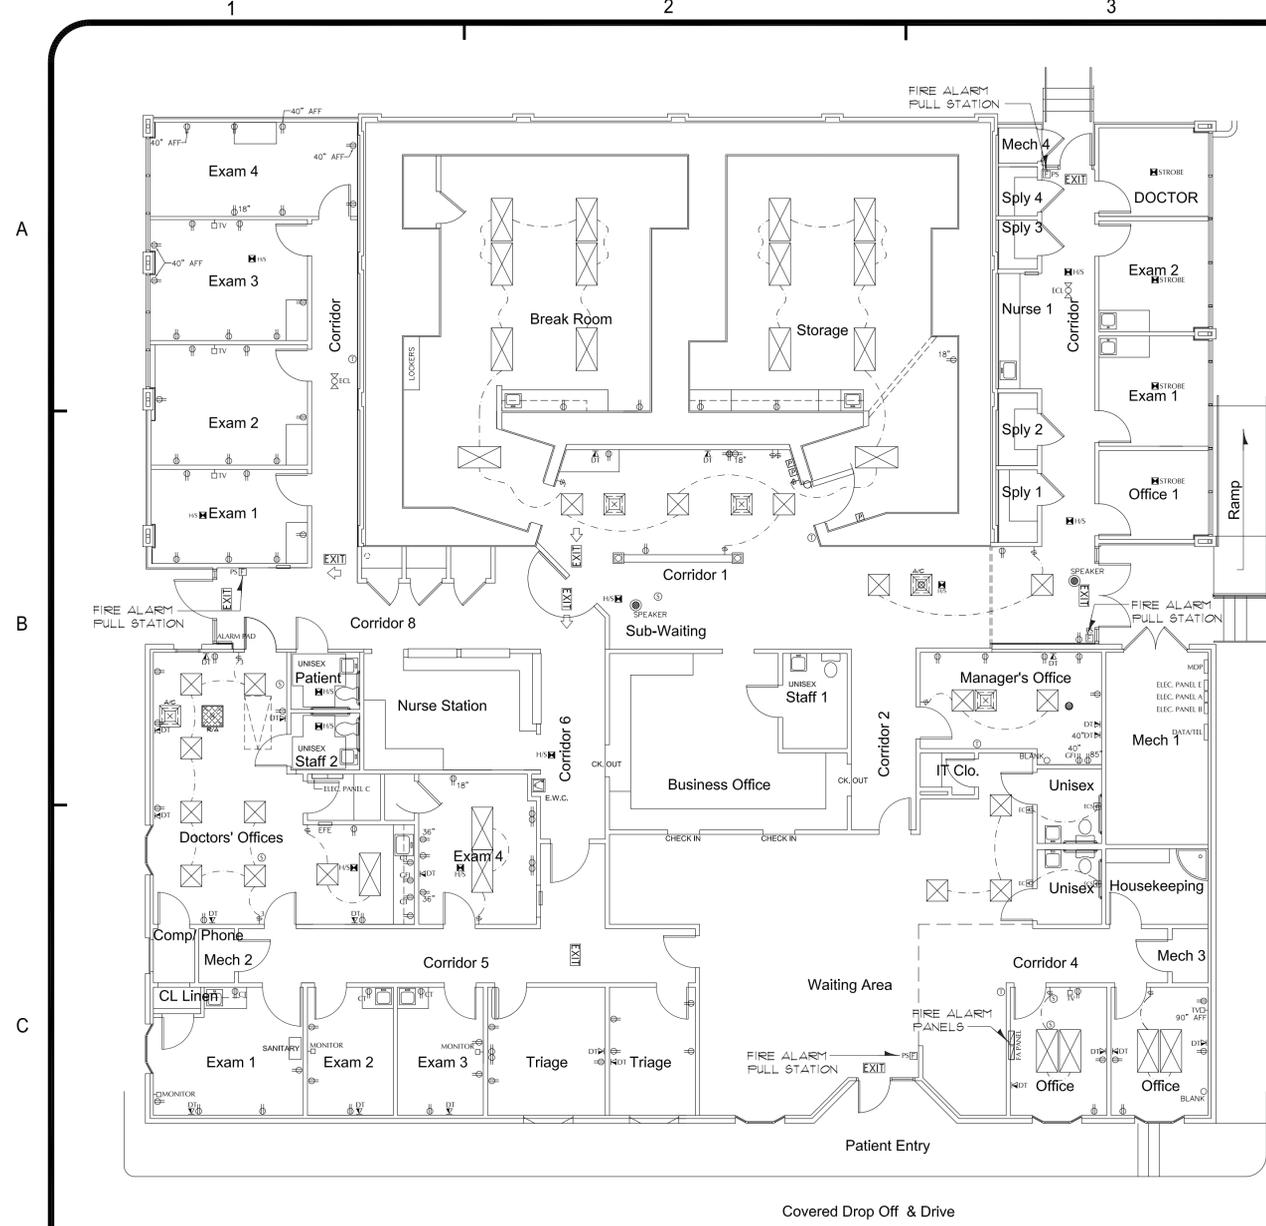

EXISTING ELECTRICAL PLAN - (RENOVATED AREAS)

1/ E1

1/8"

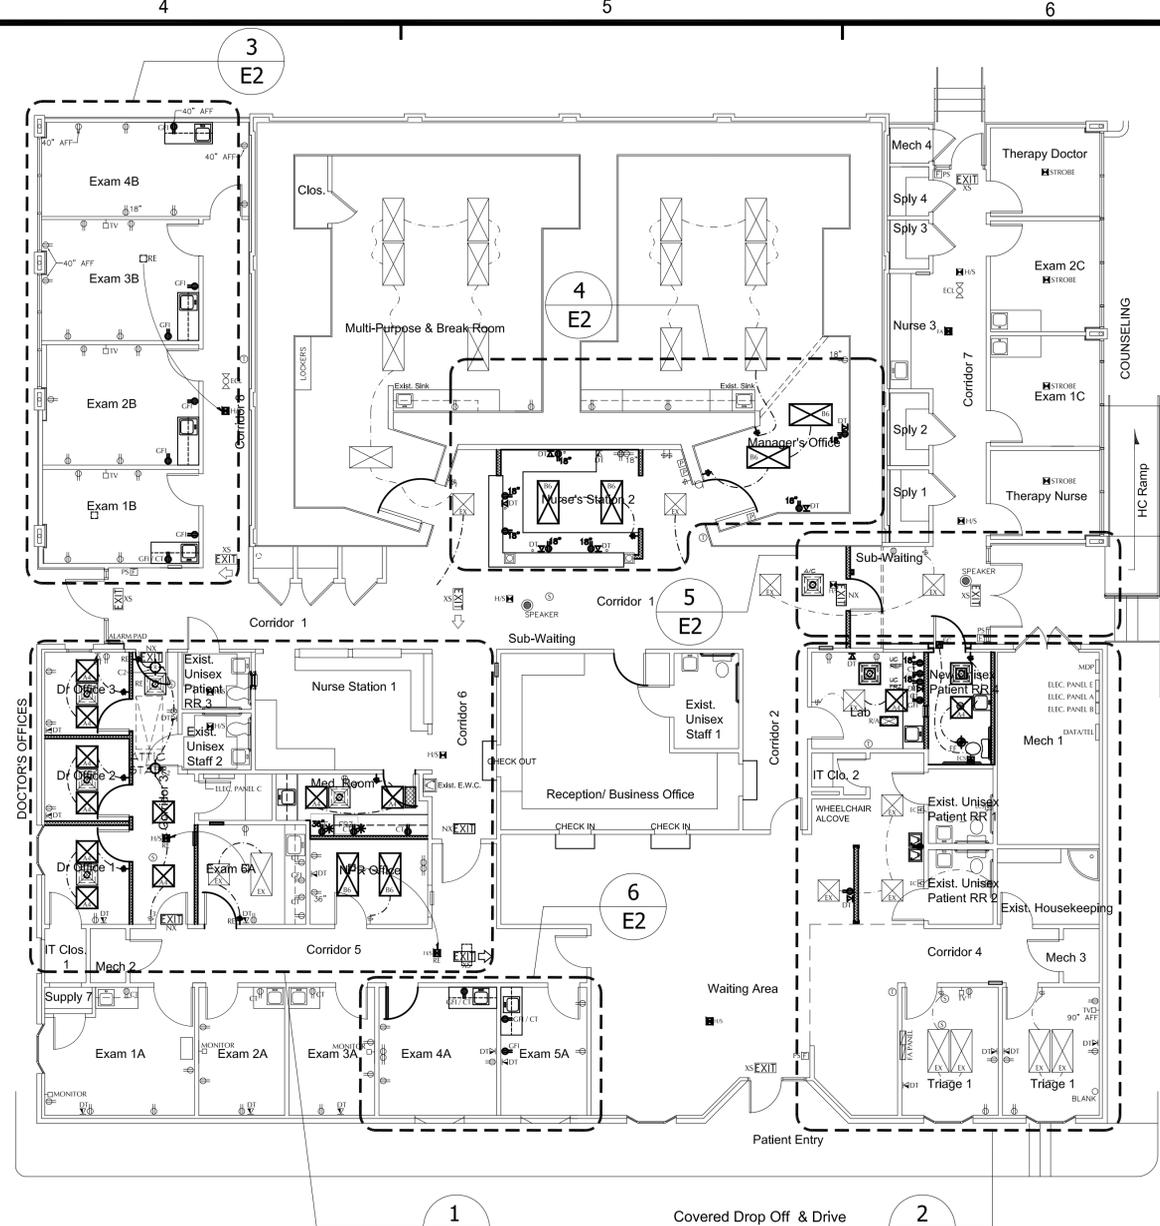

NEW ELECTRICAL PLAN - (RENOVATED AREAS)

2/ E1

1/8"

ELECTRICAL & MECHANICAL SYMBOLS			
	120V DUPLEX RECEPTACLE		24x48 LED LIGHT FIXTURE
	GROUND FAULT INTERRUPT RECEPT.		RECESSED LED LIGHT FIXTURE
	120V DUPLEX RECEPTACLE COUNTER TOP HEIGHT		24x24 LED LIGHT FIXTURE
	120V DOUBLE DUPLEX RECEPTACLE		A/C WALL REGISTER
	BLANK RECEPTACLE COVER		TELEVISION OUTLET
	SINGLE-POLE SWITCH		DATA OUTLET
	THREWAY SWITCH		BADGE SWIPE / ELEC. STRIKE CTRL.
	THERMOSTAT		RETURN AIR GRILLE
	SMOKE DETECTOR		SUPPLY AIR GRILLE
	LIGHTED EXIT LIGHT		NEW FIXTURE TO BE INSTALLED
	EMERGENCY CEILING LIGHTS		RELOCATED FIXTURE
	FIRE ALARM HORN / STROBE		
	FIRE ALARM PULL STATION		
	EXHAUST FAN		
	EMERGENCY CALL SWITCH		
	EMERGENCY CALL LIGHT/BUZZER		
	PUSH-BUTTON DOOR SWITCH		
	MOTOR		

NEW LIGHT FIXTURE SCHEDULE (LITHONIA OR EQUAL)				
MARK	DESCRIPTION	LUMENS	MOUNTING	WATTAGE
A4	2x2 FLAT PANEL	4400 LM - 40K	LAY-IN	33W
B6	2x4 FLAT PANEL	6000 LM - 40K	LAY-IN	56W
C2	6" RECESSED DOWN LIGHT	1000 LM - 40K	RECESSED	15W
EC	EMERGENCY CALL LIGHT/BUZZER - EK 117B	----	ABOVE NEW RESTROOM DOOR - WALL MT.	----
EX	EXISTING	EXISTING	EXISTING	EXISTING
XS	EXISTING EXIT SIGN	EXISTING	EXISTING	EXISTING
NX	NEW LIGHTED EXIT SIGN	MATCH EXISTING	CEILING MOUNTED (MATCH EXISTING)	5W
ALL OTHER EXISTING FIXTURES TO REMAIN.				






NOTE: BOLD SYMBOLS ON PLANS INDICATE NEW OR RELOCATED DEVICES OR FIXTURES.



Architects Alliance
of Acadiana (APAC)
1006 Creswell Ln., Opelousas, LA 70570
337-942-2678 fax 337-942-2679

RELOCATION OF:
WELLSMART HEALTH OF OPELOUSAS - RHC
627 E. PRUDHOMME STREET
OPELOUSAS, LOUISIANA 70570

DATE: **12/18/25**
JOB NO.: **A25-08**
SHEET NUMBER: **E1**
1 OF 2

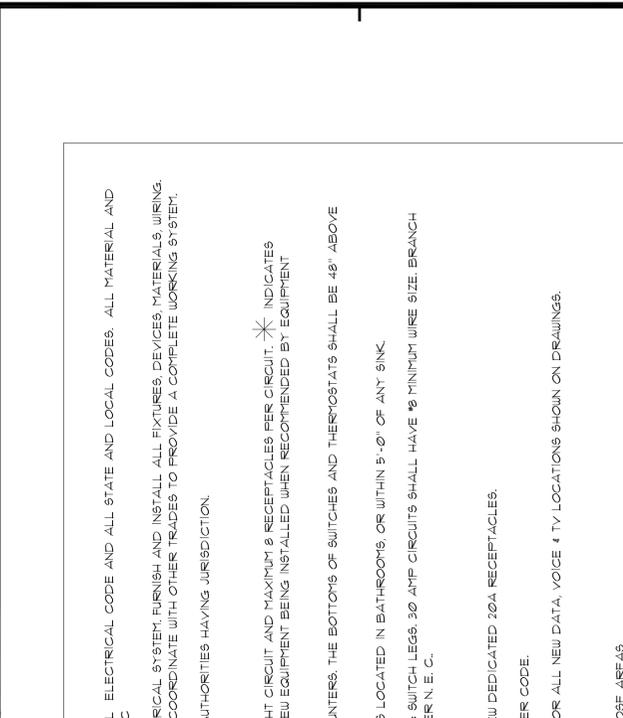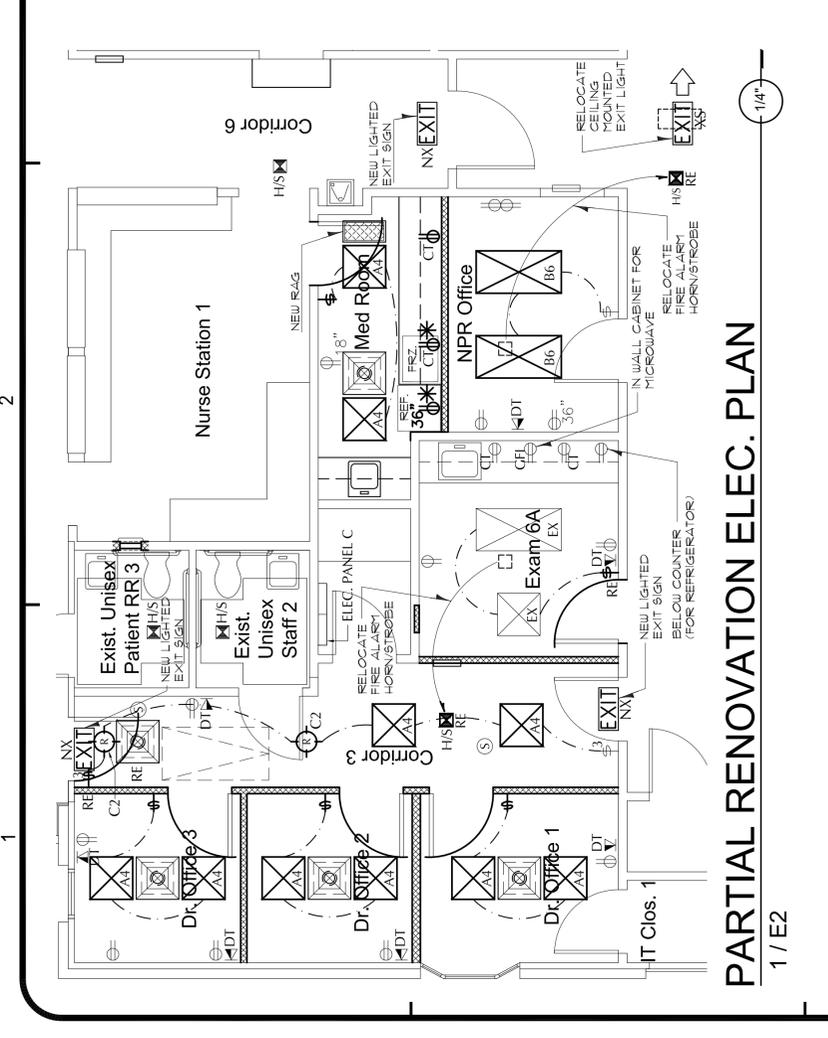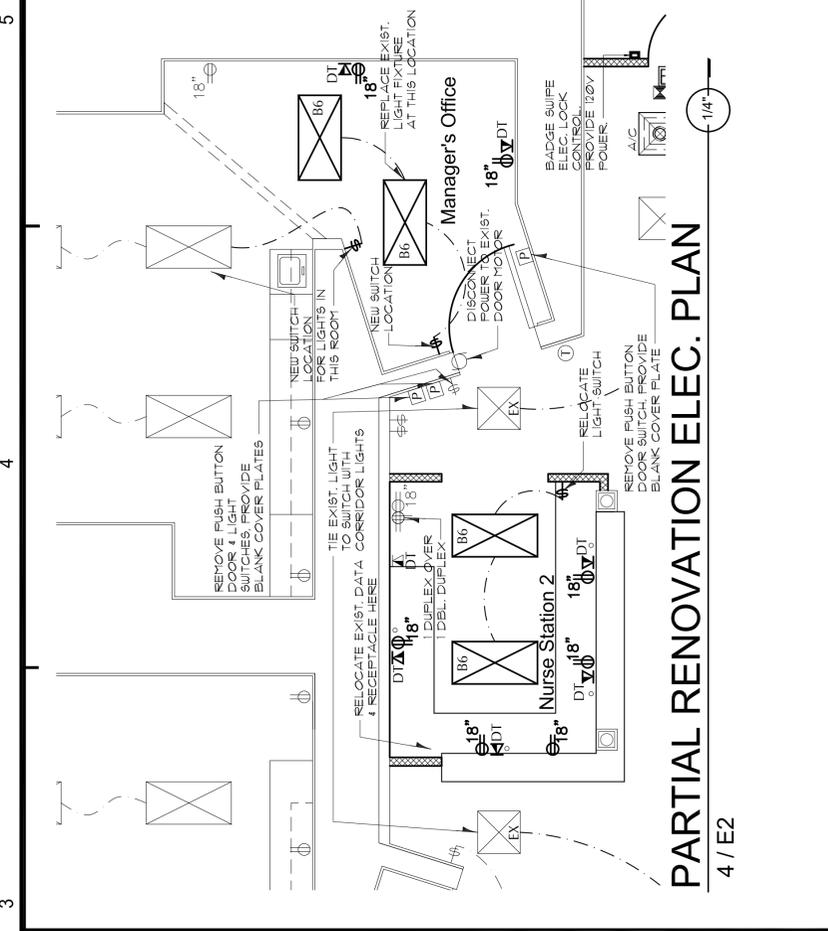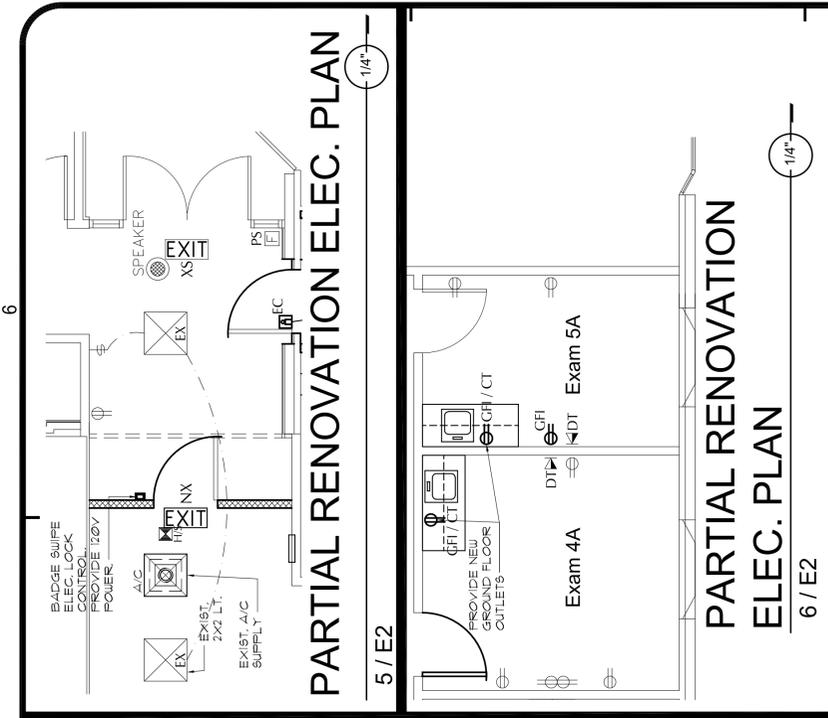

ELECTRICAL NOTES:

1. ALL ELECTRICAL INSTALLATION SHALL MEET OR EXCEED THE REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE AND ALL STATE AND LOCAL CODES. ALL MATERIAL AND EQUIPMENT SHALL BEAR THE LABEL OR APPROVAL OF THE UNDERWRITERS LABORATORIES, INC.
2. ELECTRICAL CONTRACTOR SHALL PROVIDE A COMPLETE GROUNDING AND OPERATING ELECTRICAL SYSTEM, FURNISH AND INSTALL ALL FIXTURES, DEVICES, MATERIALS, WIRING, WORKMANSHIP, SHALL CONFORM TO THE N.E.C. AND THOSE AUTHORITIES HAVING JURISDICTION. COORDINATE WITH OTHER TRADES TO PROVIDE A COMPLETE WORKING SYSTEM.
3. ARRANGE AND PAY ALL PERMITS, DEPOSITS, FEES AND INSPECTIONS AS REQUIRED BY THE AUTHORITIES HAVING JURISDICTION.
4. ALL WIRING SHALL BE COPPER. ALUMINUM WIRING IS NOT ACCEPTABLE.
5. LIGHTS AND RECEPTACLES SHALL BE ON SEPARATE CIRCUITS. MAXIMUM 1800 WATTS PER LIGHT CIRCUIT AND MAXIMUM 8 RECEPTACLES PER CIRCUIT. * INDICATES RECEPTACLE IS ON ITS OWN SEPARATE CIRCUIT. ALSO PROVIDE SEPARATE CIRCUIT FOR ANY NEW EQUIPMENT BEING INSTALLED WHEN RECOMMENDED BY EQUIPMENT MANUFACTURER.
6. MOUNTING HEIGHTS: RECEPTACLES 18" ABOVE FLOOR TO CENTER, EXCEPT WHERE ABOVE COUNTERS, THE BOTTOMS OF SWITCHES AND THERMOSTATS SHALL BE 48" ABOVE FLOOR.
7. GROUND FAULT INTERRUPTED RECEPTACLES SHALL BE PROVIDED AT ALL NEW RECEPTACLES LOCATED IN BATHROOMS, OR WITHIN 5'-0" OF ANY SINK.
8. RUN ALL WIRING CONCEALED, IN CODE-APPROVED CONDUIT. WIRE SIZE: #12 MINIMUM INCLUDING SWITCH LEGS. 30 AMP CIRCUITS SHALL HAVE #8 MINIMUM WIRE SIZE. BRANCH CIRCUITS 60" OR MORE FROM LOAD CENTER SHALL HAVE #10 WIRE SIZE FOR 20 AMP CIRCUIT PER N.E.C.
9. GANG MULTIPLE DEVICES IN GANG BOXES WITH GANG COVER PLATES.
10. INSTALL NEW 20A CIRCUIT BREAKERS IN NEAREST PANEL WITH AVAILABLE CAPACITY FOR NEW DEDICATED 20A RECEPTACLES.
11. ELECTRICAL CONTRACTOR TO SEAL ALL PENETRATIONS THRU ATTIC SMOKE PARTITIONS AS PER CODE.
12. CONTRACTOR SHALL PROVIDE WALL BOXES AND EMPTY 1/2" CONDUIT STUBBED INTO ATTIC FOR ALL NEW DATA, VOICE & TV LOCATIONS SHOWN ON DRAWINGS.
13. ALL DATA, VOICE, AND TV WIRING & DEVICES SHALL BE FURNISHED & INSTALLED BY OWNER.
14. ALL ELECTRICAL FIXTURES LOCATED IN WET OR DAMP LOCATIONS SHALL BE RATED FOR THOSE AREAS.
15. ALL WORK ASSOCIATED WITH FIRE ALARM, SECURITY, ALARM, AND NURSE CALL SYSTEM SHALL BE PROVIDED BY OWNER UNDER SEPARATE CONTRACT.

