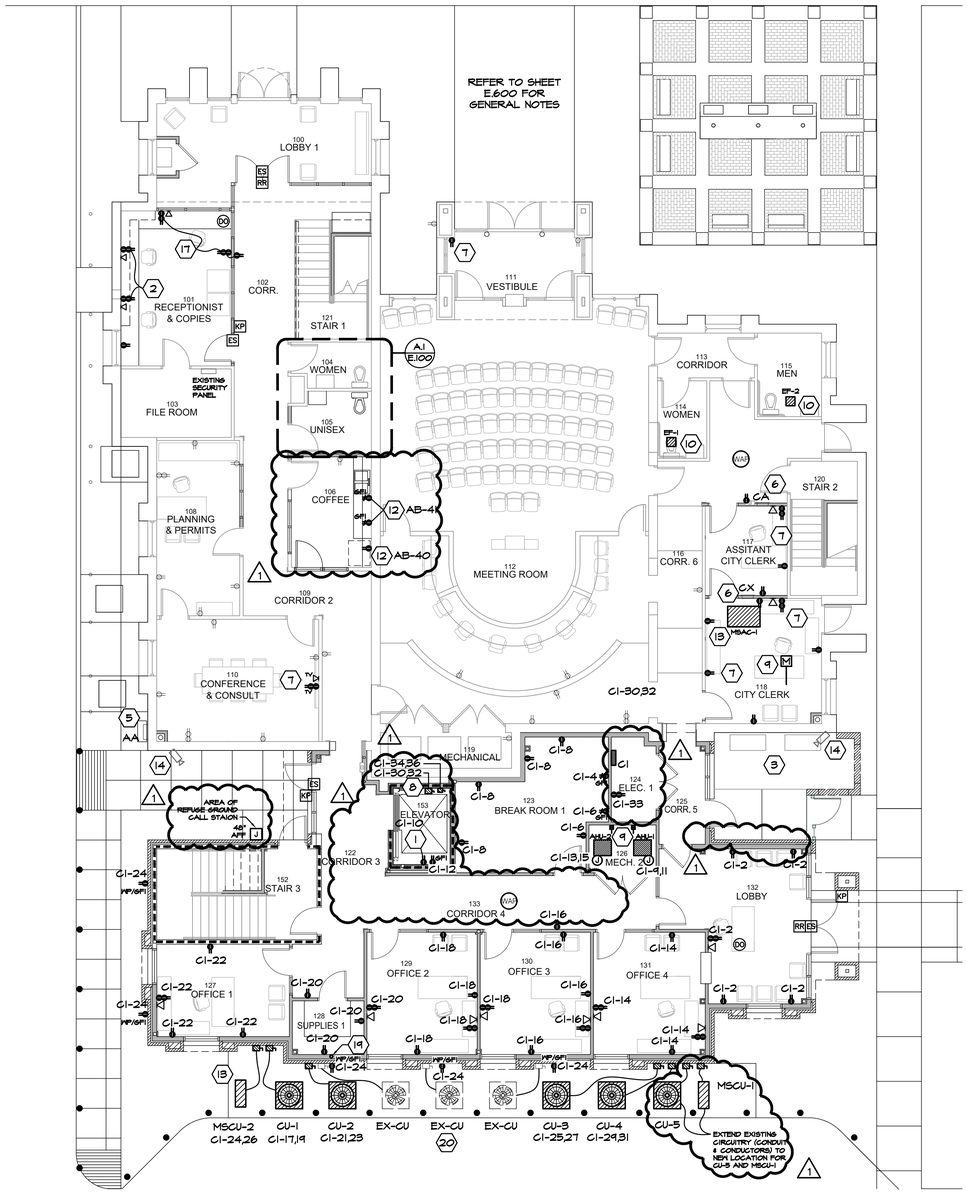

A.1 FIRST LEVEL ELECTRICAL PLAN

SCALE: 1/8" =1'-0" (IF PRINTED IN 24" x 36" FORMAT)

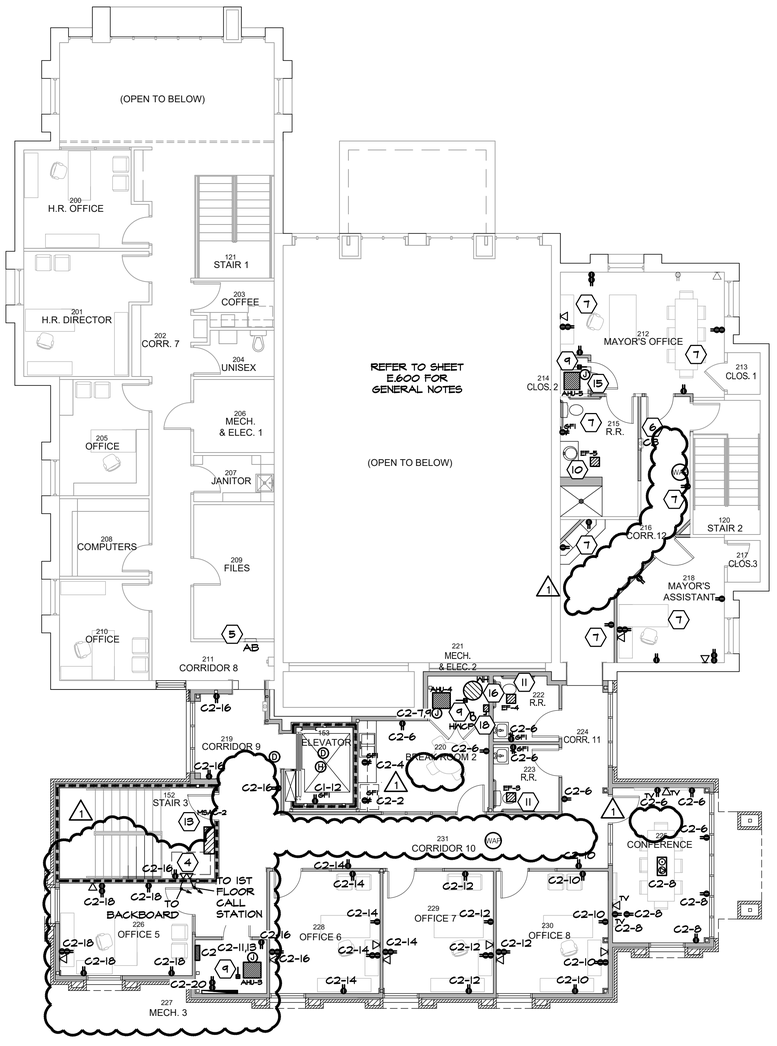

A.8 SECOND LEVEL ELECTRICAL PLAN

SCALE: 1/8" =1'-0" (IF PRINTED IN 24" x 36" FORMAT)

1 ADDENDUM 5-14-26

ELECTRICAL KEYNOTES:

1. SUMP PUMP RECEPTACLE. CONNECT TO PANEL CIRCUIT INDICATED.
2. CONNECT OUTLETS TO NEW 120 VOLT, 20 AMP CIRCUIT. PROVIDE A NEW CIRCUIT BREAKER AND A NEW TYPE WRITTEN PANEL SCHEDULE.
3. EXISTING PANEL TO REMAIN. CONNECT NEW CIRCUITS FOR MECHANICAL EQUIPMENT TO THIS PANEL. PROVIDE CIRCUIT BREAKERS FOR NEW EQUIPMENT AND PROVIDE A NEW TYPE WRITTEN PANEL SCHEDULE.
4. PROVIDE TWO-WAY COMMUNICATION MASTER SYSTEM AS SHOWN. COORDINATE WITH ARCHITECT PRIOR TO ROUGH-IN AND FINAL INSTALLATION. REFER TO D.1/D.8 AND ELECTRICAL SPECIFICATIONS FOR ADDITIONAL INFORMATION.
5. EXISTING PANELS TO REMAIN.
6. NEW LOCATION OF RELOCATED PANEL NOTED. CONTRACTOR SHALL EXTEND EXISTING BRANCH CIRCUITRY AND MAIN FEEDERS AS NEEDED TO RE-TERMINATE TO PANEL CIRCUIT BREAKERS AND MAIN LUGS.
7. RECEPTACLE TO BE WIRED TO EXISTING RECEPTACLE CIRCUIT SERVING THIS SPACE.
8. CONTRACTOR SHALL INSTALL DISCONNECTS SERVING ELEVATOR AT THE TOP OF HOIST WAY. VERIFY FINAL LOCATION ELEVATOR MANUFACTURER PRIOR TO ROUGH-IN. PROVIDE ALL AUXILIARY CONTACTS.
9. MOTORIZED DAMPER. CONNECT TO NEAREST UNSWITCHED 120V CIRCUIT AVAILABLE.
10. EXHAUST FAN. DISCONNECT EXISTING AND REPLACE WITH NEW. CONNECT EXISTING CIRCUITRY TO NEW EXHAUST FAN.
11. EXHAUST FAN. CONNECT TO LIGHTING CIRCUIT SERVING THIS SPACE. CONTROLS PROVIDED BY MECHANICAL, INSTALLED BY ELECTRICAL.
12. RECEPTACLES IN THIS SPACE SHALL BE WIRED TO CIRCUIT INDICATED. RUN 2-#12 AND 1-#12G IN 1/2" CONDUIT; MC CABLE IS ACCEPTABLE.
13. CONTRACTOR SHALL PROVIDE ALL CONTROL POWER/WIRING RACEWAY BETWEEN MSAC AND MSCU AS REQUIRED BY MINI-SPLIT MANUFACTURER. INDOOR UNIT IS POWERED BY OUTDOOR UNIT.
14. EXISTING SECURITY CAMERA TO REMAIN.
15. CONTRACTOR TO CONNECT AHU-5 TO EXISTING PANEL CURRENTLY SERVING POWER. PROVIDE A 2p60A BREAKER AND RUN 2-#6 AND 1-#10G IN 3/4" CONDUIT.
16. CONTRACTOR TO CONNECT WATER HEATER TO EXISTING PANEL CURRENTLY SERVING POWER. PROVIDE A 2p40A
17. CONTRACTOR SHALL CONNECT RECEPTACLES TO EXISTING RECEPTACLE CIRCUIT CURRENTLY SERVING THIS AREA.
18. CONTRACTOR TO PROVIDE RECEPTACLE FOR HVCP. CONNECT TO CIRCUIT C2-6. COORDINATE WITH PLUMBING CONTRACTOR FOR FINAL EXACT LOCATION PRIOR TO ROUGH-IN.
19. FOUR (4) INCH CONDUIT FOR TELECOMMUNICATION CABLE REROUTING. REFER TO SHEET E.000 FOR ADDITIONAL INFORMATION.
20. CONTRACTOR SHALL SALVAGE EXISTING DISCONNECTS FOR CONDENSING UNITS TO BE RELOCATED. INSTALL AS INDICATED. REROUTE/EXTEND EXISTING CIRCUITRY AND CONDUIT AS NEEDED.

ADG ENGINEERING
ASSOCIATED DESIGN GROUP, INC.
3909 W Congress Street, Suite 201
Lafayette, Louisiana 70506
Phone: (337) 234-5710
Email: adginc@adginc.org

Project No. 25097

NO.	REVISIONS/SUBMISSIONS	DATE
1	ADDENDUM NO. 4	05.14.2026

Lynn Guidry ARCHITECT
411 ARCENEAUX ROAD CARENCRO LOUISIANA 70520
337.896.8645 email: lynn@lynnguidryarchitect.com

CARENCRO CITY HALL EXPANSION 2026

210 EAST ST. PETER STREET CARENCRO, LOUISIANA

Drawing Title: ELECTRICAL POWER & SPECIAL SYSTEMS

STATE OF LOUISIANA DAVID B. STERLY License No. 28070 PROFESSIONAL ENGINEER 05/07/2026

Designed	PM, CM
Drawn	GW
Checked	DS
Reviewed	
Date	FEB. 10, 2026
Project No.	2024.006
Scale	AS NOTED
Drawing No.	E.101R
	81 of 83