**POWER / DATA KEYNOTES:**

- 1 VERIFY FINAL DEVICE LOCATIONS WITH MILLWORK SUBMITTALS / ARCHITECT PRIOR TO ROUGH-IN.
- 2 INSTALL RECEPTACLE IN WATER COOLER FRAME. COORDINATE LOCATION WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN. CIRCUIT BREAKER SERVING RECEPTACLE SHALL BE GFI TYPE.
- 3 PROVIDE ONE SET OF DEVICES AT 18" AND THE OTHER AT 72" FOR TV. VERIFY EXACT HEIGHT OF EQUIPMENT WITH ARCHITECT PRIOR TO ROUGH-IN. SEE TYPICAL TV DETAIL.
- 4 ALL LOW VOLTAGE CABLING THIS ABOVE CEILING AREA TO BE IN CONDUIT.
- 5 PROVIDE ONE 3/4" CONDUIT BELOW FLOOR/SLAB TO NEARBY WALL, UP TO ACCESSIBLE CEILING FOR POWER AND ONE 1" CONDUIT BELOW FLOOR/SLAB TO NEARBY WALL, UP TO ACCESSIBLE CEILING FOR DATA.
- 6 PROVIDE ONE SET OF DEVICES AT 48" AND THE OTHER AT 72" FOR TV. VERIFY EXACT HEIGHT OF EQUIPMENT WITH ARCHITECT PRIOR TO ROUGH-IN. SEE TYPICAL TV DETAIL.
- 7 COORDINATE WITH PLUMBING CONTRACTOR AND PROVIDE 120V POWER TO TRANSFORMERS (FURNISHED BY PLUMBING CONTRACTOR) FOR FLUSH VALVE AUTO SENSORS. ELECTRICAL CONTRACTOR SHALL INSTALL TRANSFORMER ABOVE AND PROVIDE AND INSTALL ALL LOW VOLTAGE CABLING IN WALL TO PLUMBING FIXTURE(S).
- 8 CONTROL WITH PHOTOCELL / TIMECLOCK. VERIFY EXACT CONTROLS AND TERMINATION REQUIREMENTS WITH SIGNAGE SUPPLIER.
- 9 REFER TO STACKED TRANSFORMER DETAIL SHEET E-201.


POWER / DATA GENERAL NOTES:

- PRIOR TO ORDER OF ANY ELECTRICAL GEAR, COORDINATE THE REQUIRED SIZE OF ALL CIRCUIT BREAKERS FEEDING EQUIPMENT, (I.E. MOTORS, HVAC, KITCHEN EQUIPMENT, SPECIAL PURPOSE OUTLETS, ELEVATORS, OWNER FURNISHED EQUIPMENT ETC.) WITH APPROVED EQUIPMENT SHOP DRAWINGS AND OWNER REPRESENTATIVES. BREAKERS SHALL BE SIZED PER THE NEC, THE EQUIPMENT NAME PLATE AND MANUFACTURERS RECOMMENDATIONS.
- RECEPTACLES WITHIN 6' OF SINK OR LAV SHALL BE GFI.
- ALL 20 AMP 125 VOLT DUPLEX RECEPTACLES INSTALLED OUTDOORS SHALL HAVE GFCI PROTECTION AND SHALL RECEIVE WEATHER PROOF WHILE IN USE COVER, AS SPECIFIED.
- ALL 120V 15A & 20 RECEPTACLES IN FOOD PREP AND SHOP AREAS SHALL BE GFCI PROTECTED AS REQUIRED BY NEC.
- COORDINATE EXACT INSTALLATION REQUIREMENTS OF OUTLETS IN MILLWORK WITH ARCHITECTURAL DRAWINGS, APPROVED SHOP DRAWINGS, AND MILLWORK INSTALLER PRIOR TO ROUGH-IN. DO NOT ROUGH-IN BEHIND CABINETS, DRAWERS, ETC RENDERING DEVICE UNUSABLE.
- ALL RECEPTACLE CIRCUITS SHALL BE PROVIDED WITH A DEDICATED NEUTRAL FOR EACH PHASE CONDUCTOR.
- CONDUIT FOR DATA DROPS SHALL BE 1" UNLESS NOTED OTHERWISE.
- ALL NEW LOW VOLTAGE CABLING TO BE ROUTED ON J-HOOKS WHERE ABOVE ACCESSIBLE CEILING AND IN CONDUIT WHERE EXPOSED. REFER TO DETAILS.



ASSOCIATED DESIGN GROUP, INC.
3909 West Congress Street, Suite 201
Lafayette, Louisiana 70506
Phone: (337) 234-5710
Email: adginc@adginc.org

Project No. 25326

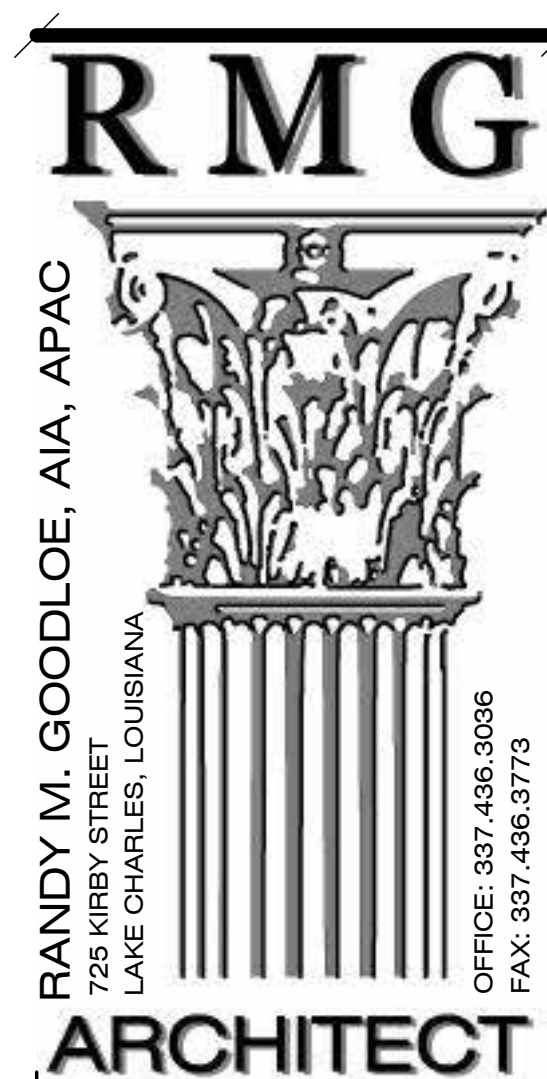

RANDY M. GOODLOE, AIA, APAC
725 KIRBY STREET
LAKE CHARLES, LOUISIANA

OFFICE: 337.436.3036
FAX: 337.436.3773



LA LICENSE NO. 4086

NEW CONSTRUCTION
FORD PRO
FOR
MIKE WILLIS
2010 PATTON ST.

© COPYRIGHT 2019,
RANDY M. GOODLOE, A.I.A. APAC
ALL INFORMATION, EITHER DRAWN, WRITTEN,
OR IMPLIED APPEARING IN THIS DOCUMENT
SHALL NOT BE DUPLICATED, DISCLOSED, OR
OTHERWISE USED WITHOUT THE WRITTEN
PERMISSION OF THE AUTHOR, RANDY M.
GOODLOE, AIA APAC. THIS DOCUMENT IS AN
INSTRUMENT OF SERVICE AND IS THE SOLE
PROPERTY OF THE AUTHOR. FURTHERMORE,
THE USE OF THIS DOCUMENT FOR ANY
PURPOSE SHALL BE REVOKED, IF THE INTENT
OF THE DESIGN OR THE CONSTRUCTION
TECHNIQUES OR DETAILS SHOWN HEREIN
ARE NOT ADHERED TO OR THE
CONTRACTUAL AGREEMENT GOVERNING
THEIR USE ARE NOT STRICTLY ADHERED TO.

PROJECT NO.

25012


PROJECT MANAGER

TM

DATE ISSUED

2026.05.22

REVISED

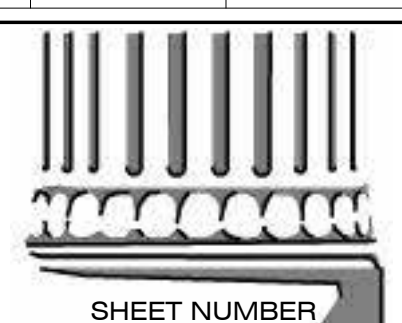

E-203
1ST FLOOR ENLARGED
POWER AND DATA
PLAN