



[illegible]

<p><b>PANEL SCHEDULE NOTES. (APPLIES TO ALL PANEL SCHEDULES)</b></p> <ol style="list-style-type: none"> <li>1. GFI TYPE BREAKER.</li> <li>2. TWO PARALLEL SETS OF CONDUIT / CONDUCTORS.</li> <li>3. THREE PARALLEL SETS OF CONDUIT / CONDUCTORS.</li> <li>4. FOR FIRE ALARM- PROVIDE RED BREAKER LOCKABLE IN "ON" POSITION.</li> <li>5. FOR SPD - PROVIDE BREAKER LOCKABLE IN "ON" POSITION.</li> </ol>
---

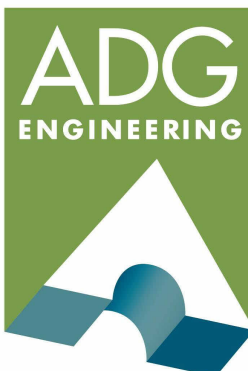

**ASSOCIATED DESIGN GROUP, INC.**  
3909 West Congress Street, Suite 201  
Lafayette, Louisiana 70506  
Phone: (337) 234-5710  
Email: [adginc@adginc.org](mailto:adginc@adginc.org)

Project No. 25326

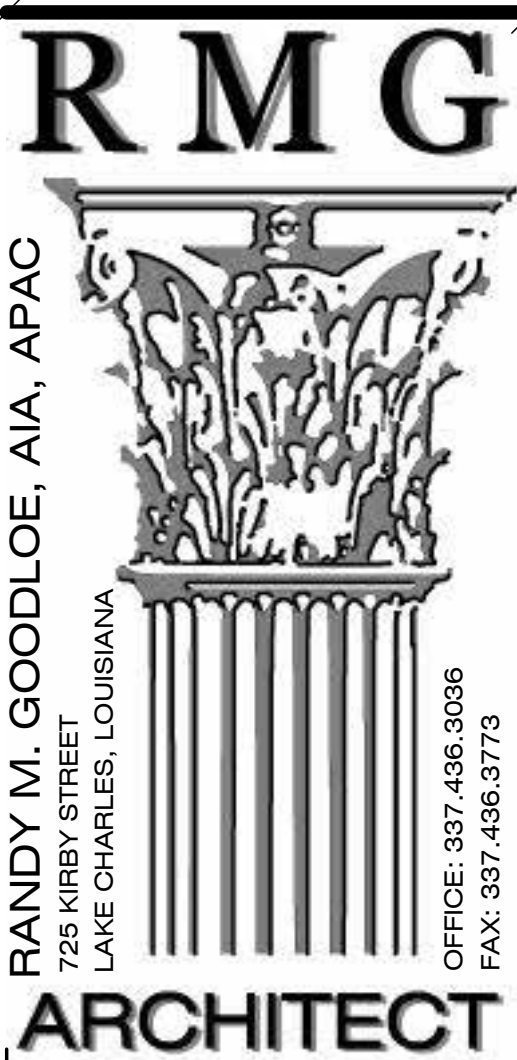

LA. LICENSE NO. 4086

NEW CONSTRUCTION  
**FORD PRO**  
FOR  
**MIKE WILLIS**  
2010 PATTON ST.

© COPYRIGHT 2019,  
RANDY M. GOODLOE, A.I.A. APAC.  
ALL INFORMATION, EITHER DRAWN, WRITTEN,  
OR IMPLIED APPEARING IN THIS DOCUMENT  
SHALL NOT BE DUPLICATED, DISCLOSED, OR  
OTHERWISE USED WITHOUT THE WRITTEN  
PERMISSION OF THE AUTHOR. RANDY  
GOODLOE, A.I.A. APAC. THIS DOCUMENT IS AN  
INSTRUMENT OF SERVICE AND IS THE SOLE  
PROPERTY OF THE AUTHOR. FURTHERMORE,  
THE USE OF THIS DOCUMENT FOR ANY  
PURPOSE SHALL BE REVOKED, IF THE INTENT  
OF THE USER IS TO REPRODUCE, REUSE,  
OR OTHERWISE DISCLOSE THE CONTENTS,  
TECHNIQUES OR DETAILS SHOWN HEREIN  
ARE NOT ADHERED TO OR THE  
CONTRACTUAL AGREEMENT GOVERNING  
THEIR USE ARE NOT STRICTLY ADHERED TO.

PROJECT NO.

25012

PROJECT MANAGER

TM

DATE ISSUED

2026.05.25

REVISED

--	--

--	--


--	--

--	--


--	--

--	--

— 100 —



• • • • •

© 1999 Blackwell Science Ltd, *Journal of Internal Medicine* 245: 399–405

SHEET NUMBER

00

67

50

## ELECTRICAL P

## SCHEDULE

---