

PLUMBING KEYNOTES:

- 1 REFER TO DETAIL #1 SHEET P-100 FOR CONTINUATION.
- 2 REFER TO DETAIL #1 SHEET P-101 FOR CONTINUATION.
- 3 PROVIDE A CUTOFF VALVE IN A CAST IRON VALVE BOX WITH METAL COVER MARKED "WATER". RISE UP IN EXTERIOR WALL AND CONTINUE WITH INSULATED WATER LINES TO ABOVE CEILING.
- 4 3/4" INSULATED COLD WATER LINE DOWN IN WALL AND OUT TO HOSE BIBB. PROVIDE BALL TYPE CUTOFF VALVE IN ACCESSIBLE LOCATION.
- 5 1/2" COLD WATER LINE DOWN IN WALL TO ICE MAKER VALVE BOX. MAKE FINAL CONNECTION TO REFRIGERATOR ICE MAKER. PROVIDE BALL TYPE CUTOFF VALVE IN ACCESSIBLE LOCATION.
- 6 TAP OFF LAVATORY P-TRAP WITH 1/2" CHROME LINE TO WALL AND CONTINUE IN WALL WITH 1/2" SOFT COPPER LINE TO BELOW GRADE TO TRAP PRIMER CONNECTION ON FLOOR DRAIN. ALL EXPOSED SUPPLY LINE SHALL BE CHROME (DEARBORN 831-1 OR EQUAL P-TRAP TYPE).
- 7 PROVIDE PROSET TRAP GUARD OR APPROVED EQUAL IN FLOOR DRAIN.
- 8 PROVIDE INSULATED HUB DRAIN ABOVE CEILING FOR DUCTLESS SPLIT SYSTEM CONDENSATE DRAIN. INSULATE DOWN TO BELOW SLAB. REFER TO SHEET P-203 DETAIL #13. COORDINATE EXACT ELEVATION AND LOCATION IN FIELD WITH MECHANICAL CONTRACTORS PRIOR TO ROUGH-IN.
- 9 PROVIDE INSULATED HUB DRAIN ON WALL FOR GRAVITY FED DUCTLESS SPLIT SYSTEM CONDENSATE DRAIN. INSULATE DOWN TO BELOW SLAB. REFER TO SHEET P-203 DETAIL #13. COORDINATE EXACT ELEVATION AND LOCATION IN FIELD WITH MECHANICAL AND ELECTRICAL CONTRACTORS PRIOR TO ROUGH-IN.
- 10 INSTALL WATER HEATER ON 18" GALVANIZED STEEL STAND (IPS WHS2 OR APPROVED EQUAL) IN DRAIN PAN AS DETAILED ON SHEET P-203. EXTEND WATER HEATER RELIEF LINE FULL SIZE TO FLOOR DRAIN. EXTEND EMERGENCY DRAIN PAN DRAIN LINE TO FLOOR DRAIN.
- 11 PROVIDE HOT WATER CIRCULATOR PER DETAILS #10 ON SHEET P-203. INTERLOCK RECIRC PUMP WITH HOT WATER HEATER PER MANUFACTURERS INSTALLATION INSTRUCTIONS WITH TIMER AND AQUASTAT.
- 12 COORDINATE FLOOR DRAIN LOCATIONS WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN. FLOOR DRAINS AND CLEANOUTS SHALL NOT BE INSTALLED BENEATH MECHANICAL EQUIPMENT.
- 13 REFER TO DETAIL #3 SHEET P-103 FOR CONTINUATION.
- 14 COORDINATE EXACT SHOWER HEAD AND DRAIN LOCATIONS WITH ARCHITECT'S PLANS AND TO MEET ADA REQUIREMENTS PRIOR TO ROUGH-IN. COORDINATE WITH GENERAL CONTRACTOR TO ENSURE PROPER STAGING OF SHOWER INSERT WITH ALL TRADES.
- 15 MAINTAIN MINIMUM 10' CLEARANCE BETWEEN ROOFTOP OUTSIDE AIR INTAKE HOOD AND SEWER VENTS. COORDINATE WITH HVAC CONTRACTOR PRIOR TO ROUGH-IN.
- 16 DOMESTIC COLD, HOT, AND HOT WATER RETURN PIPING WITHIN THE UN-CONDITION AND UN-HEATED SERVICE BAY AREAS SHALL BE PRE-INSULATED CROSSLINKED POLYETHYLENE PEX PIPING. REFER TO SPECIFICATIONS SECTION 220519 PART2 2.1.1.


NOTE:
PROPERLY FIRE CAULK ALL PENETRATIONS THROUGH RATED WALLS. COORDINATE FIRE CAULKING WITH ASSEMBLY REQUIREMENTS. COORDINATE WITH ARCHITECT'S PLANS, NOTES, SPECIFICATIONS, ETC.

NOTE:
COORDINATE P-TRAP INSTALLATION HEIGHT WITH ARCHITECT'S KNEE SPACE COVER PANELS AND COUNTER TOP HEIGHTS PRIOR TO ROUGH-IN.



ASSOCIATED DESIGN GROUP, INC.
3909 W Congress Street, Suite 201
Lafayette, Louisiana 70506
Phone: (337) 234-5710
Email: adginc@adginc.org

Project No. 25326

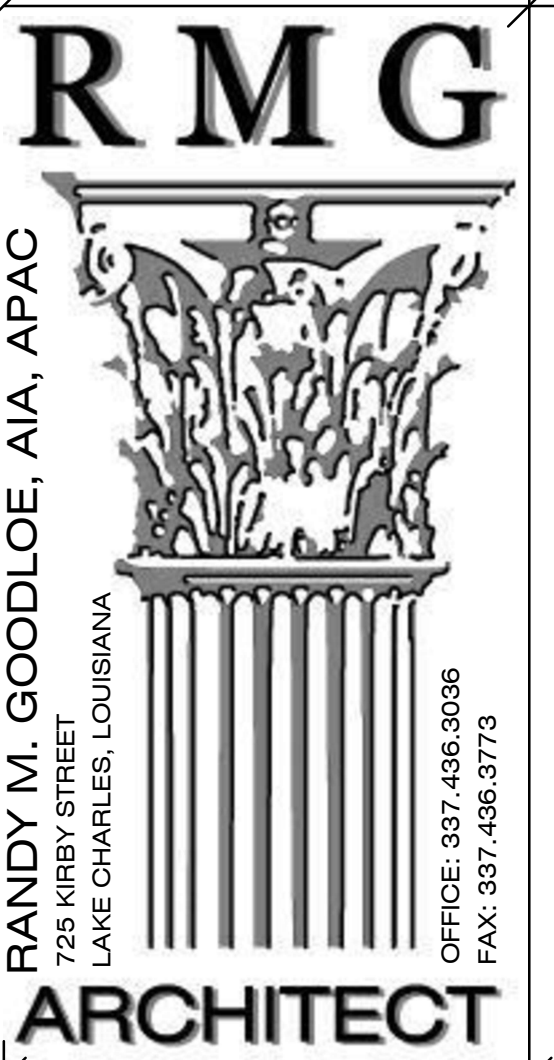


NEW CONSTRUCTION
FORD PRO
FOR
MIKE WILLIS
2010 PATTON ST.

© COPYRIGHT 2019,
RANDY M. GOODLOE, A.I.A. APAC
ALL INFORMATION, EITHER DRAWN, WRITTEN,
OR IMPLIED APPEARING IN THIS DOCUMENT
SHALL NOT BE DUPLICATED, DISCLOSED, OR
OTHERWISE USED WITHOUT THE WRITTEN
PERMISSION OF THE AUTHOR, RANDY M.
GOODLOE, A.I.A. APAC. THIS DOCUMENT IS AN
INSTRUMENT OF SERVICE AND IS THE SOLE
PROPERTY OF THE AUTHOR. FURTHERMORE,
THE USE OF THIS DOCUMENT FOR ANY
PURPOSE SHALL BE REVOKED, IF THE INTENT
OF THE DESIGN OR THE CONSTRUCTION
TECHNIQUES OR DETAILS SHOWN HEREIN
ARE NOT ADHERED TO OR THE
CONTRACTUAL AGREEMENT GOVERNING
THEIR USE ARE NOT STRICTLY ADHERED TO.

PROJECT NO.
25012
PROJECT MANAGER
JM

DATE ISSUED
2026.05.22

REVISED

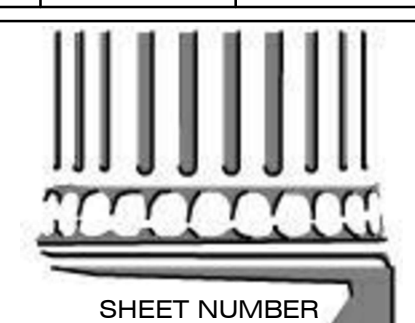

P-102
ENLARGED
PLUMBING PLANS