

**GENERAL ELECTRICAL NOTES**

CONFIRM ELECTRICAL REQUIREMENTS OF MECHANICAL EQUIPMENT WITH MECHANICAL CONTRACTOR PRIOR TO PROCURING ASSOCIATED ELECTRICAL EQUIPMENT. PROVIDE WIRE, CIRCUIT BREAKERS, DISCONNECT SWITCHES, FUSES, ETC. SIZES PER NAMEPLATE DATA. VERIFY LOCATION OF ALL EQUIPMENT IN FIELD.

**KEYNOTES**

1. ROUGH-IN AS REQUIRED FOR HVAC EQUIPMENT. PROVIDE FUSIBLE DISCONNECT SWITCH AND FUSE PER NAMEPLATE DATA.

2. CONNECT EXHAUST FAN POWER AS REQUIRED. PROVIDE TOGGLE STYLE DISCONNECT ADJACENT TO FAN AND CONNECT AS REQUIRED TO COMPLETELY REMOVE POWER TO FAN. COORDINATE LOCATION WITH MECHANICAL CONTRACTOR. PROVIDE WEATHERPROOF COVER IF LOCATED OUTSIDE.

3. LOCATE WITHIN CORD LENGTH OF CIRCULATION PUMP.

4. PROVIDE NEW 40A/2P CIRCUIT BREAKER IN EXISTING PANEL B2 ON 2ND FLOOR AND CONNECT USING 2#10, 1#10G, 3/4"C.





Office of the State  
Public Defender  
District 8  
Office Building

111 West Main Street  
Winnfield, LA 71483

**CDMorgan**

& ASSOCIATES, INC.  
ENGINEERING CONSULTANTS  
A PROFESSIONAL ENGINEERING AND ARCHITECTURAL  
CORPORATION

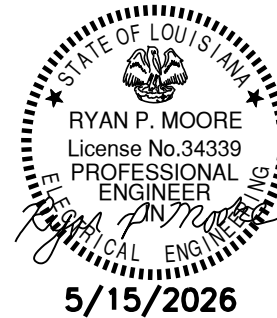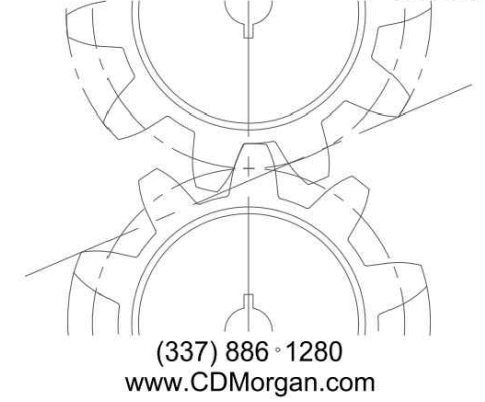

Seal:

May 15, 2026  
**Construction Documents**

No.	Description	Date

KEY PLAN

1ST FLOOR MECHANICAL  
CONNECTIONS PLAN

Project No.: BLO001-25 Drawn By: GP

**E3.2**

OSPD

Sheet No.: