

GENERAL ELECTRICAL NOTES

CONFIRM ELECTRICAL REQUIREMENTS OF MECHANICAL EQUIPMENT WITH MECHANICAL CONTRACTOR PRIOR TO PROCURING ASSOCIATED ELECTRICAL EQUIPMENT. PROVIDE WIRE, CIRCUIT BREAKERS, DISCONNECT SWITCHES, FUSES, ETC. SIZES PER NAMEPLATE DATA. VERIFY LOCATION OF ALL EQUIPMENT IN FIELD.

KEYNOTES

1. ROUGH-IN AS REQUIRED FOR HVAC EQUIPMENT. PROVIDE FUSIBLE DISCONNECT SWITCH AND FUSE PER NAMEPLATE DATA.

2. PROVIDE 60A/2P CIRCUIT BREAKER IN EXISTING PANEL B2 AND CONNECT USING 2#6, 1#8, 1"C. PROVIDE UPDATED, TYPED PANEL SCHEDULE.




Office of the State
Public Defender
District 8
Office Building

111 West Main Street
Winnfield, LA 71483

CDMorgan

& ASSOCIATES, INC.
ENGINEERING CONSULTANTS
A PROFESSIONAL ENGINEERING AND ARCHITECTURAL CORPORATION
CARENCRO LOUISIANA

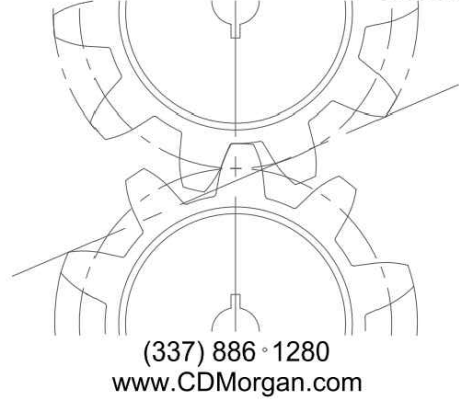

Seal:

May 15, 2026
Construction Documents

No.	Description	Date

KEY PLAN
2ND FLOOR MECHANICAL
CONNECTIONS PLAN

Project No.: BLO001-25 Drawn By: GP

E4.2

OSPD

Sheet No.: