



(INDICATE EQUIPMENT DESCRIPTION)
FUSED AT ___ AMPERES
FED FROM
(INDICATE FEEDER ORIENTATION I.D.)
(PANEL AND CIRCUIT NO.)
TYPICAL DISCONNECT PLAQUE

THEY ANGLE OF ANY BEND SHALL
NOT BE LESS THAN 90 DEGREES

4) ACCEPTABLE GROUND CONDUCTOR BENDING NO SCALE



7) TYPICAL LIGHT STANDARD FOUNDATION DETAIL
NO SCALE

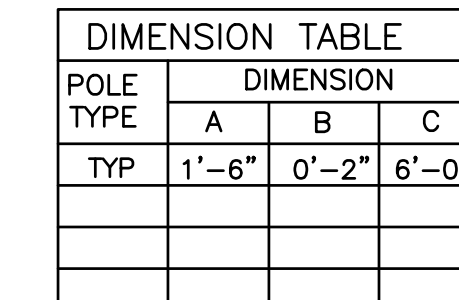

- H.D. GALVANIZED LEVELING NUTS
- POLE PLATE
- PROVIDE GROUTING AFTER POLE IS PROPERLY LEVEL AND SET